

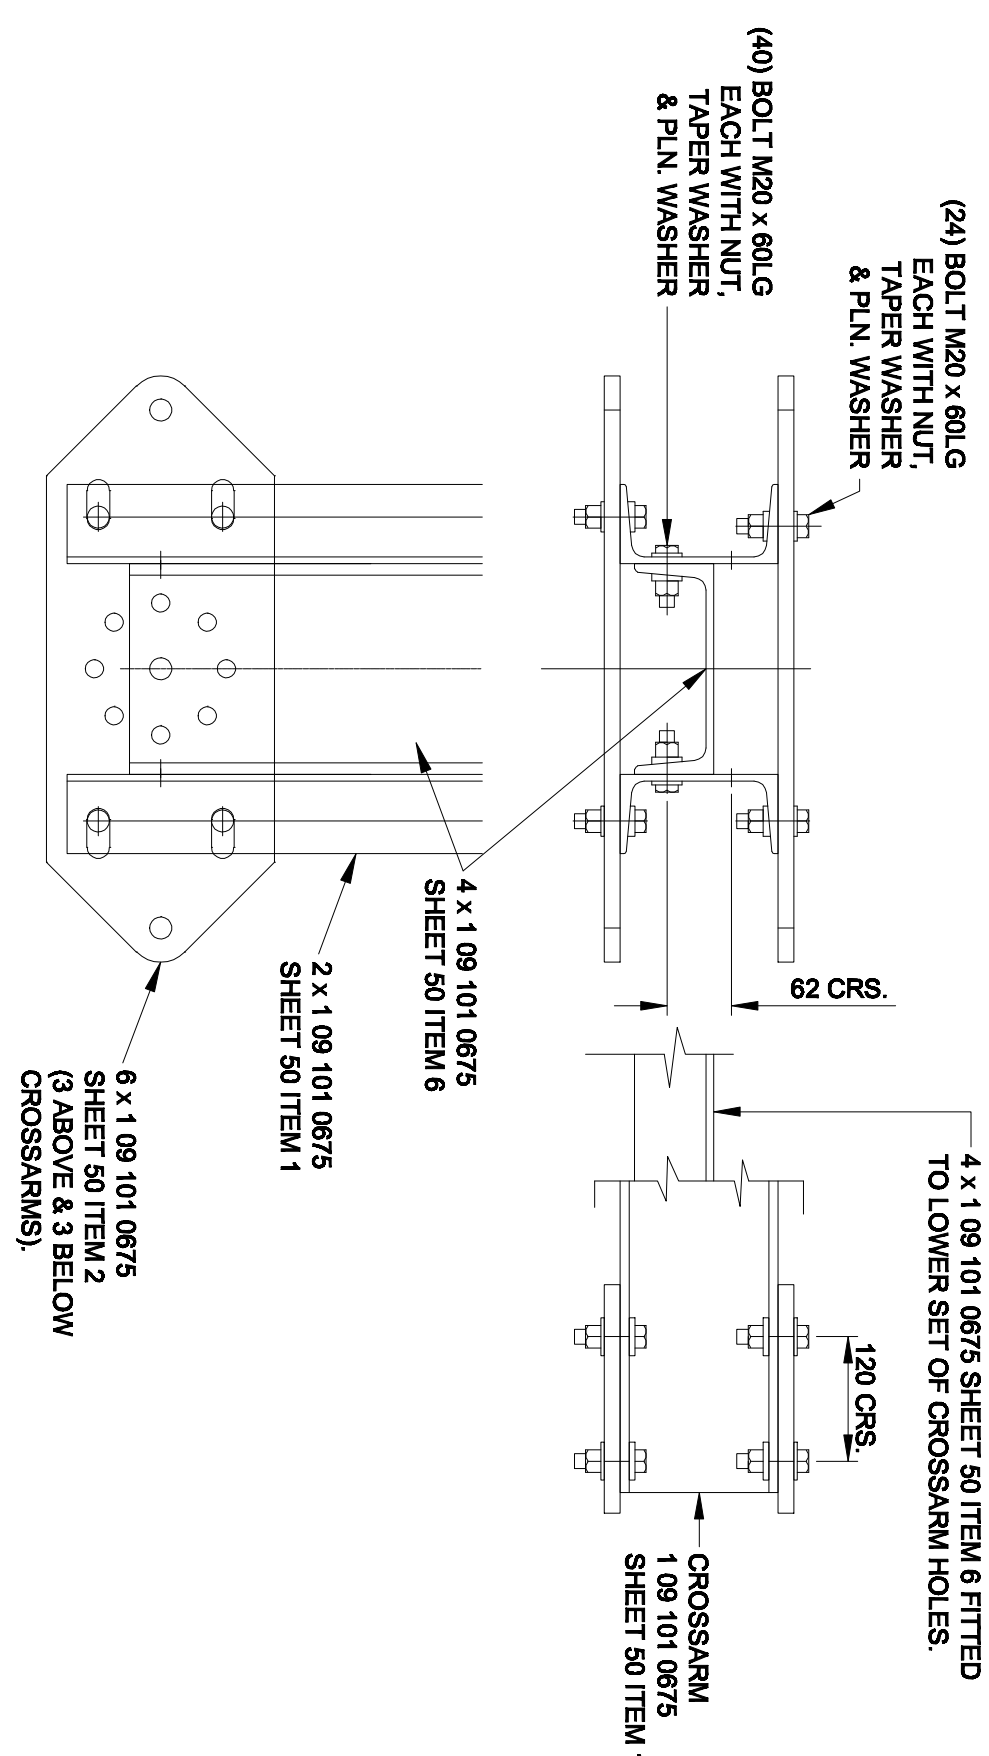
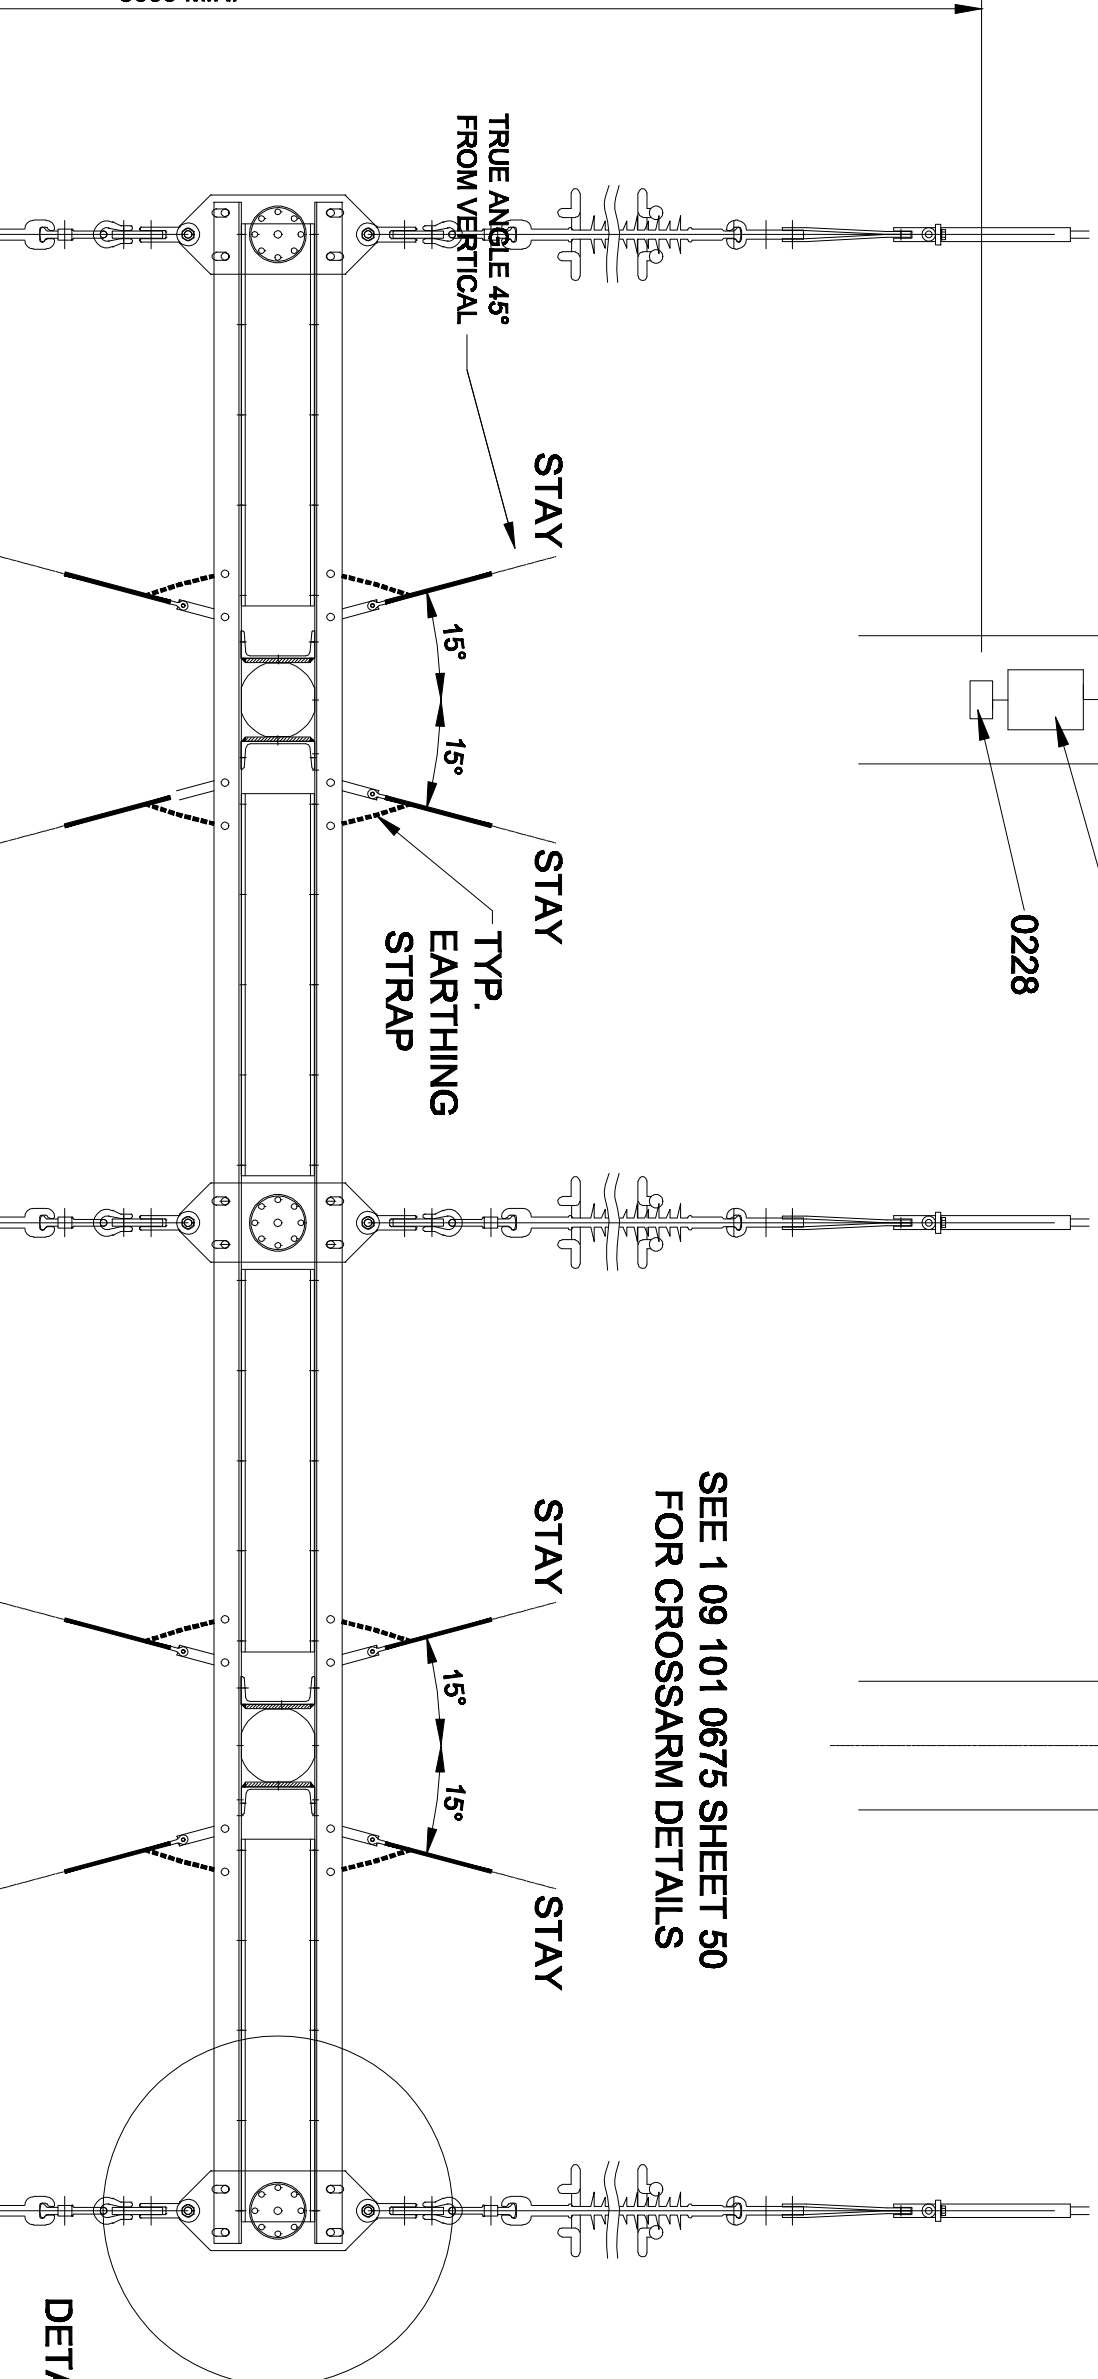
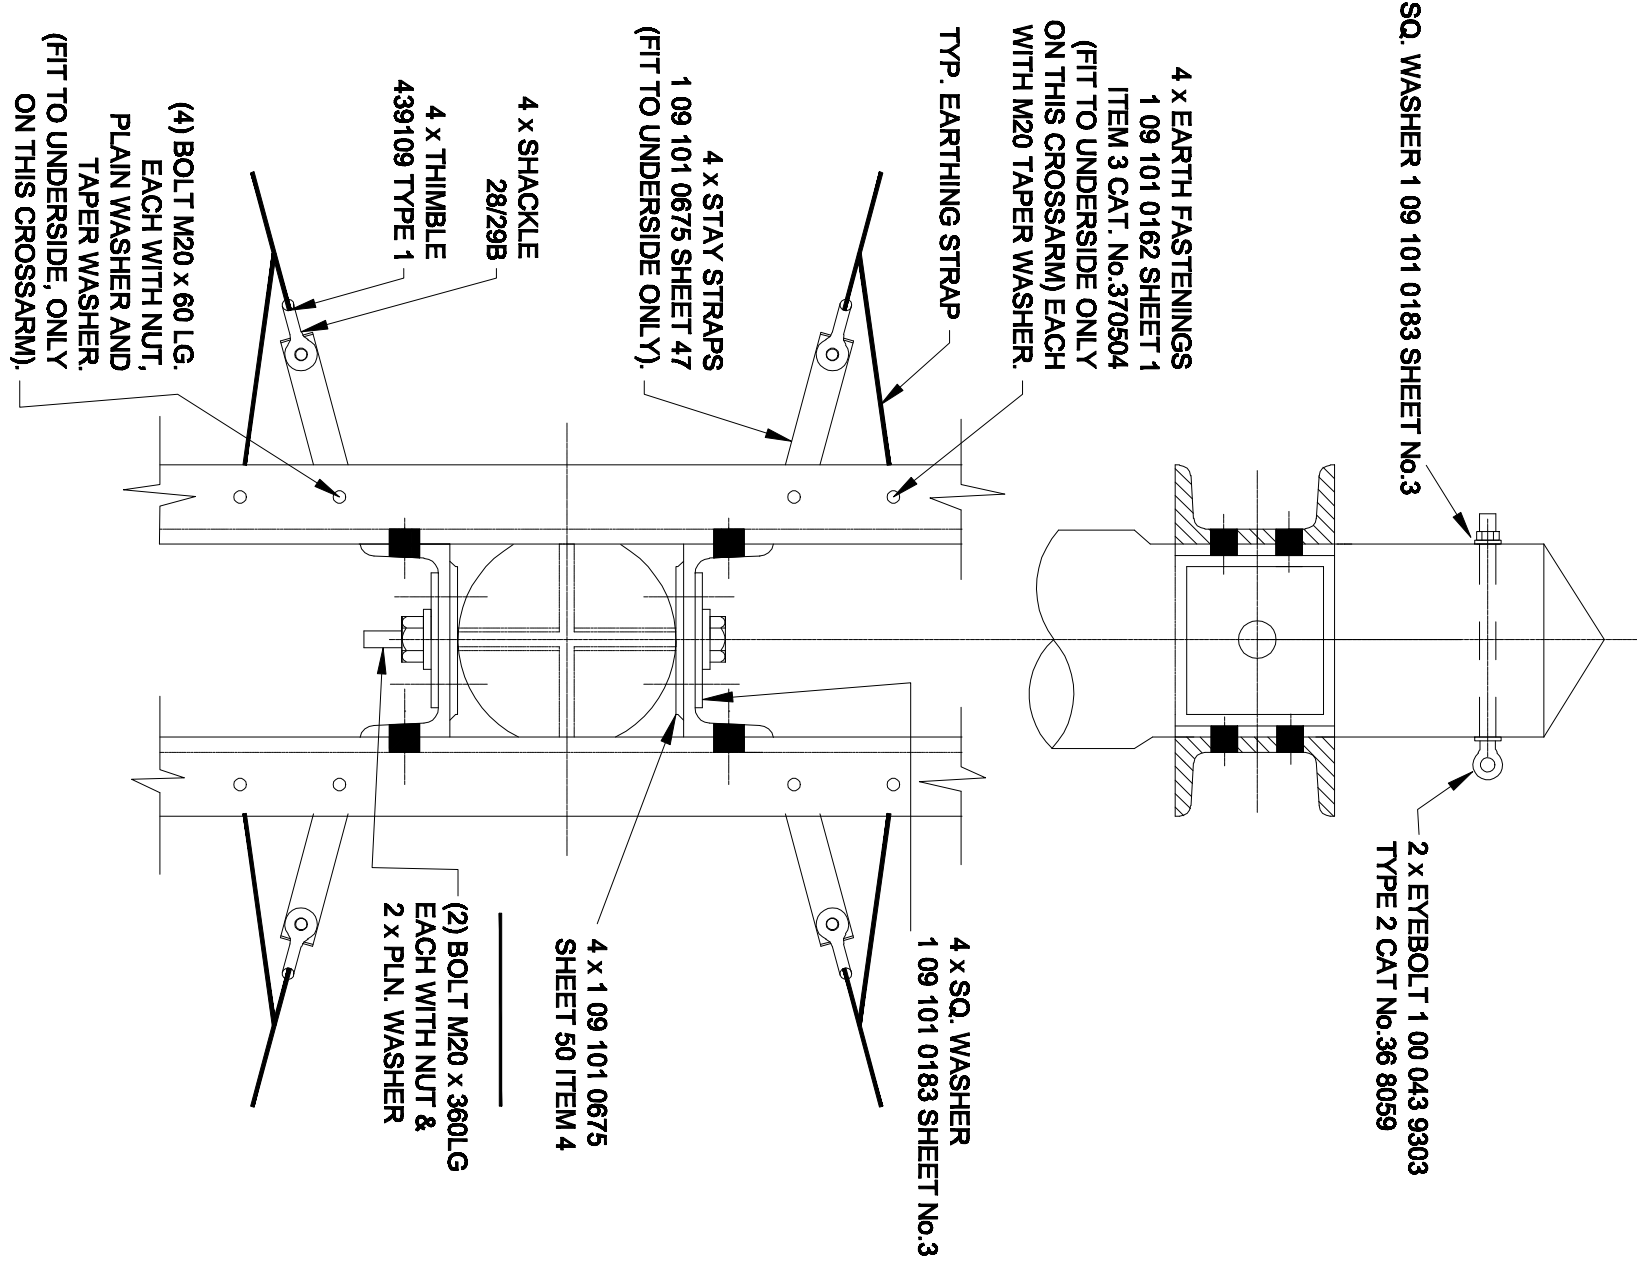
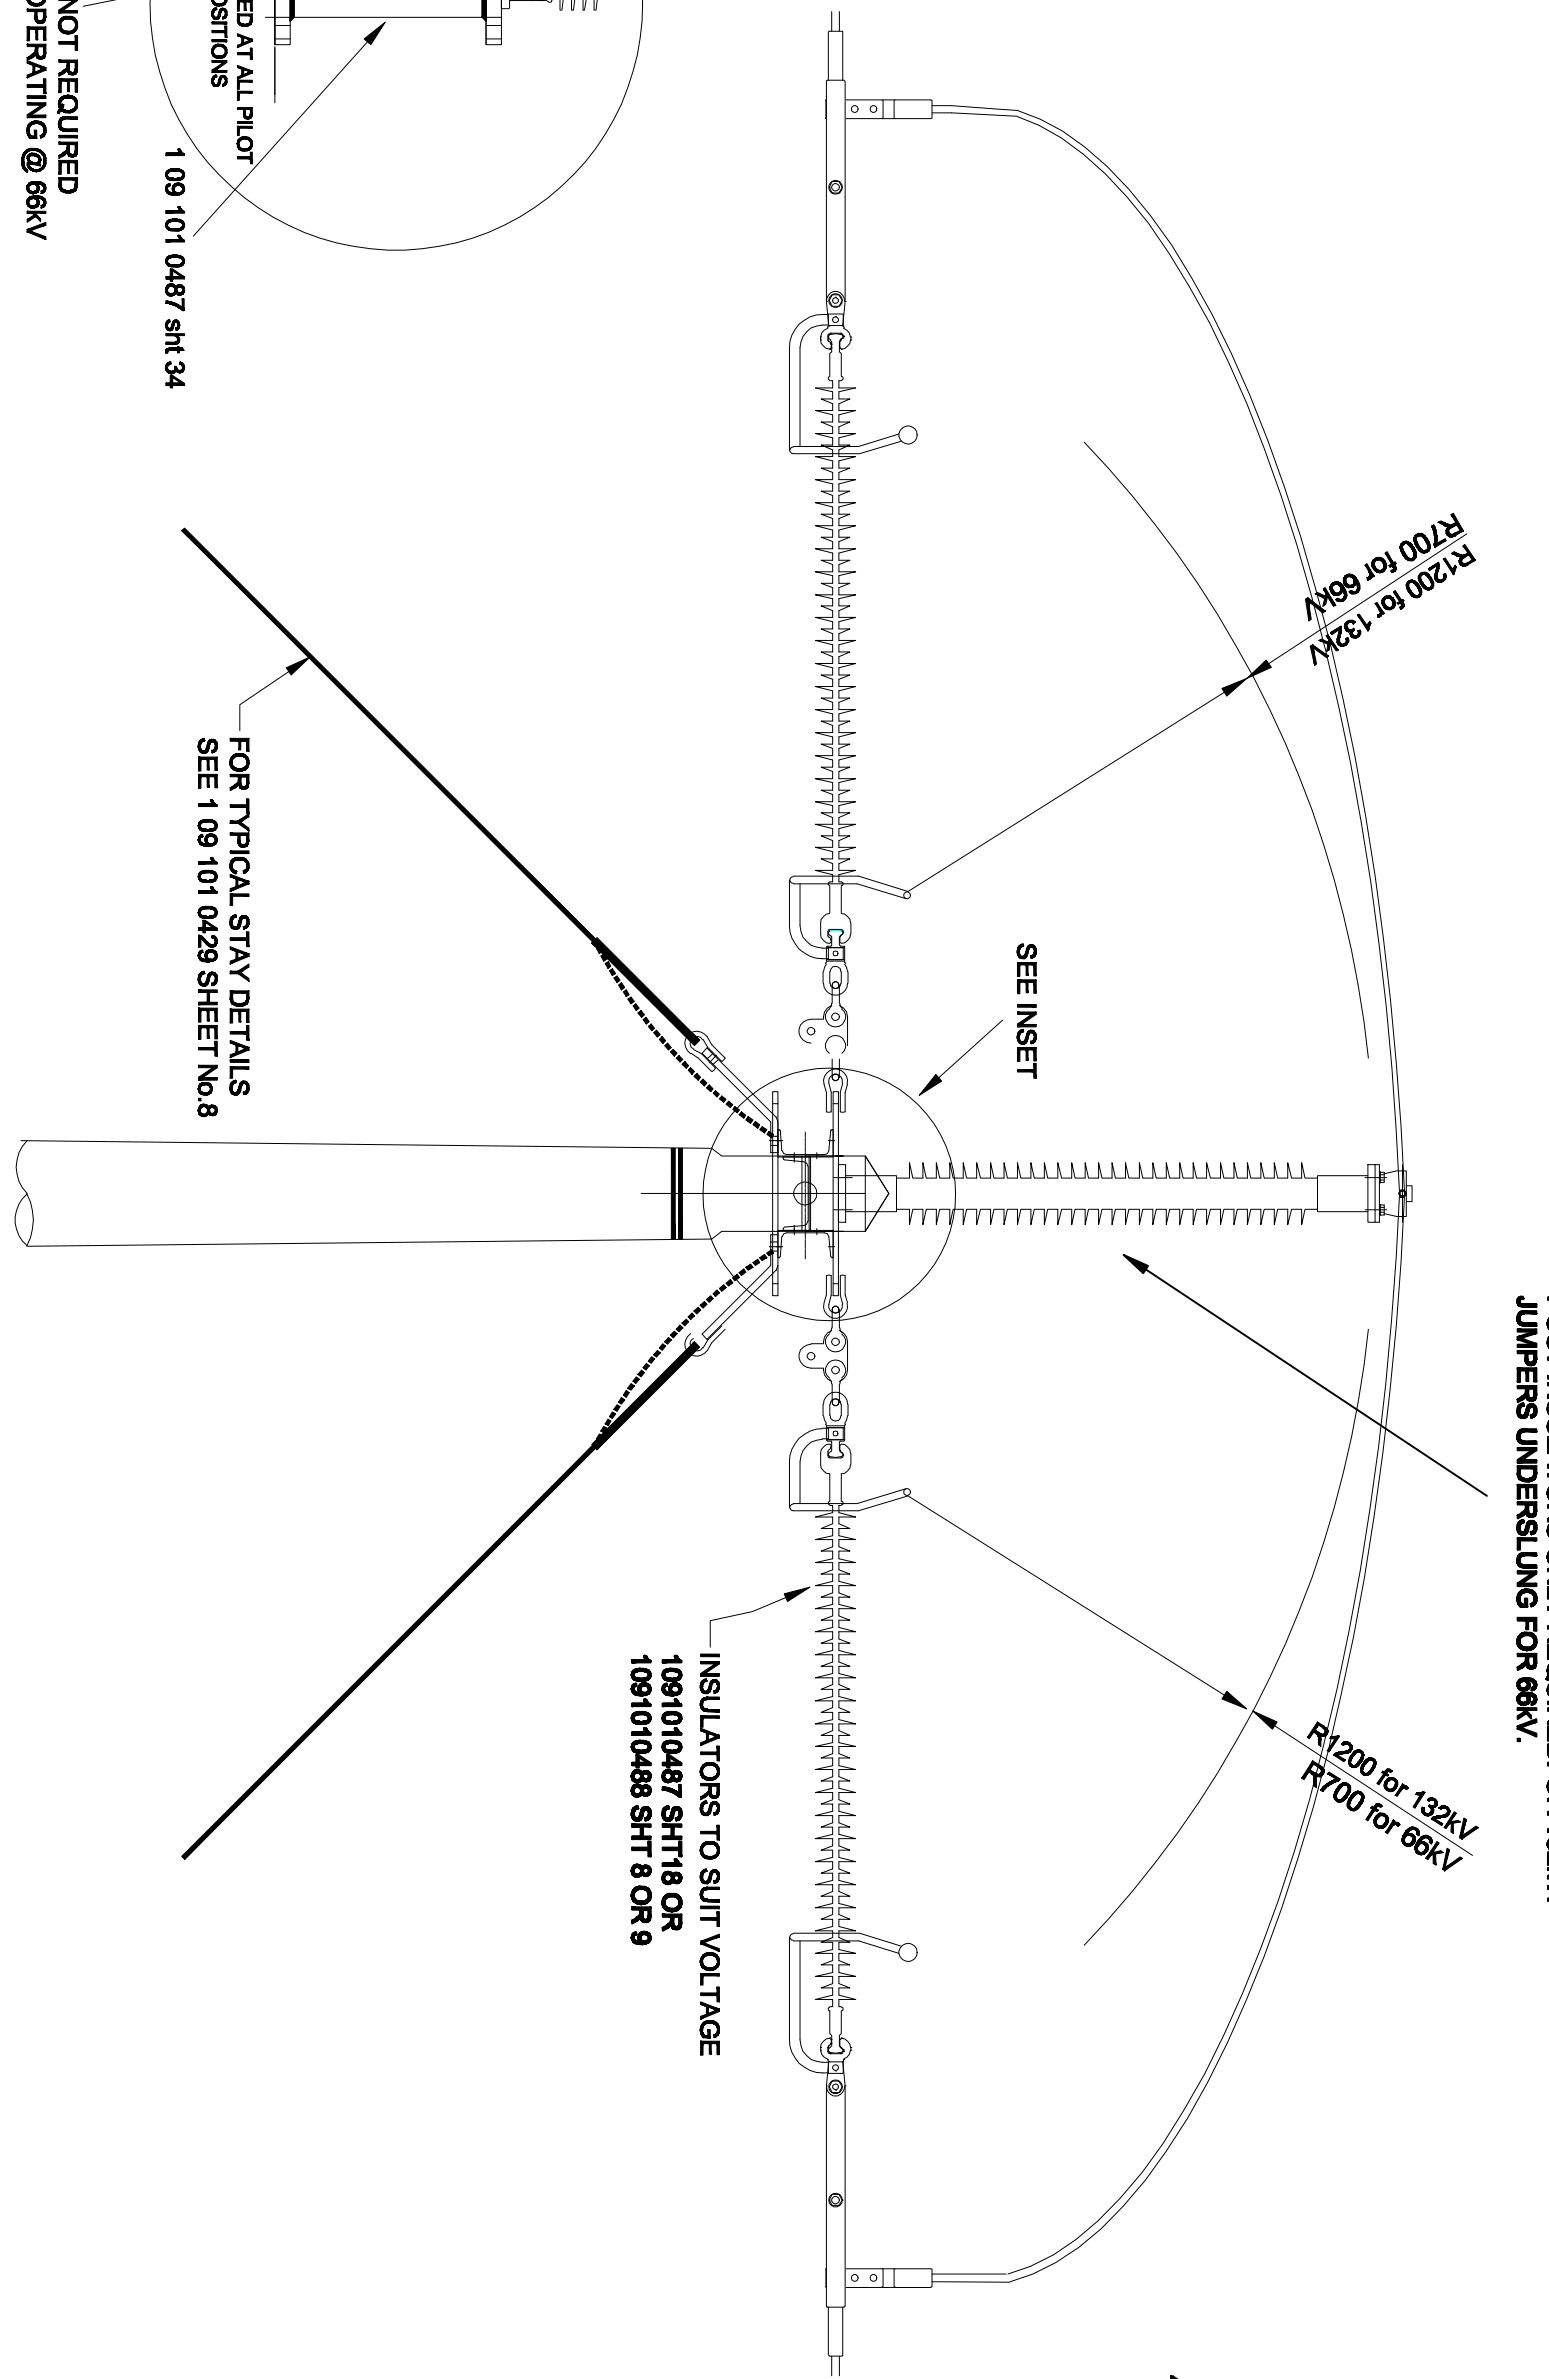
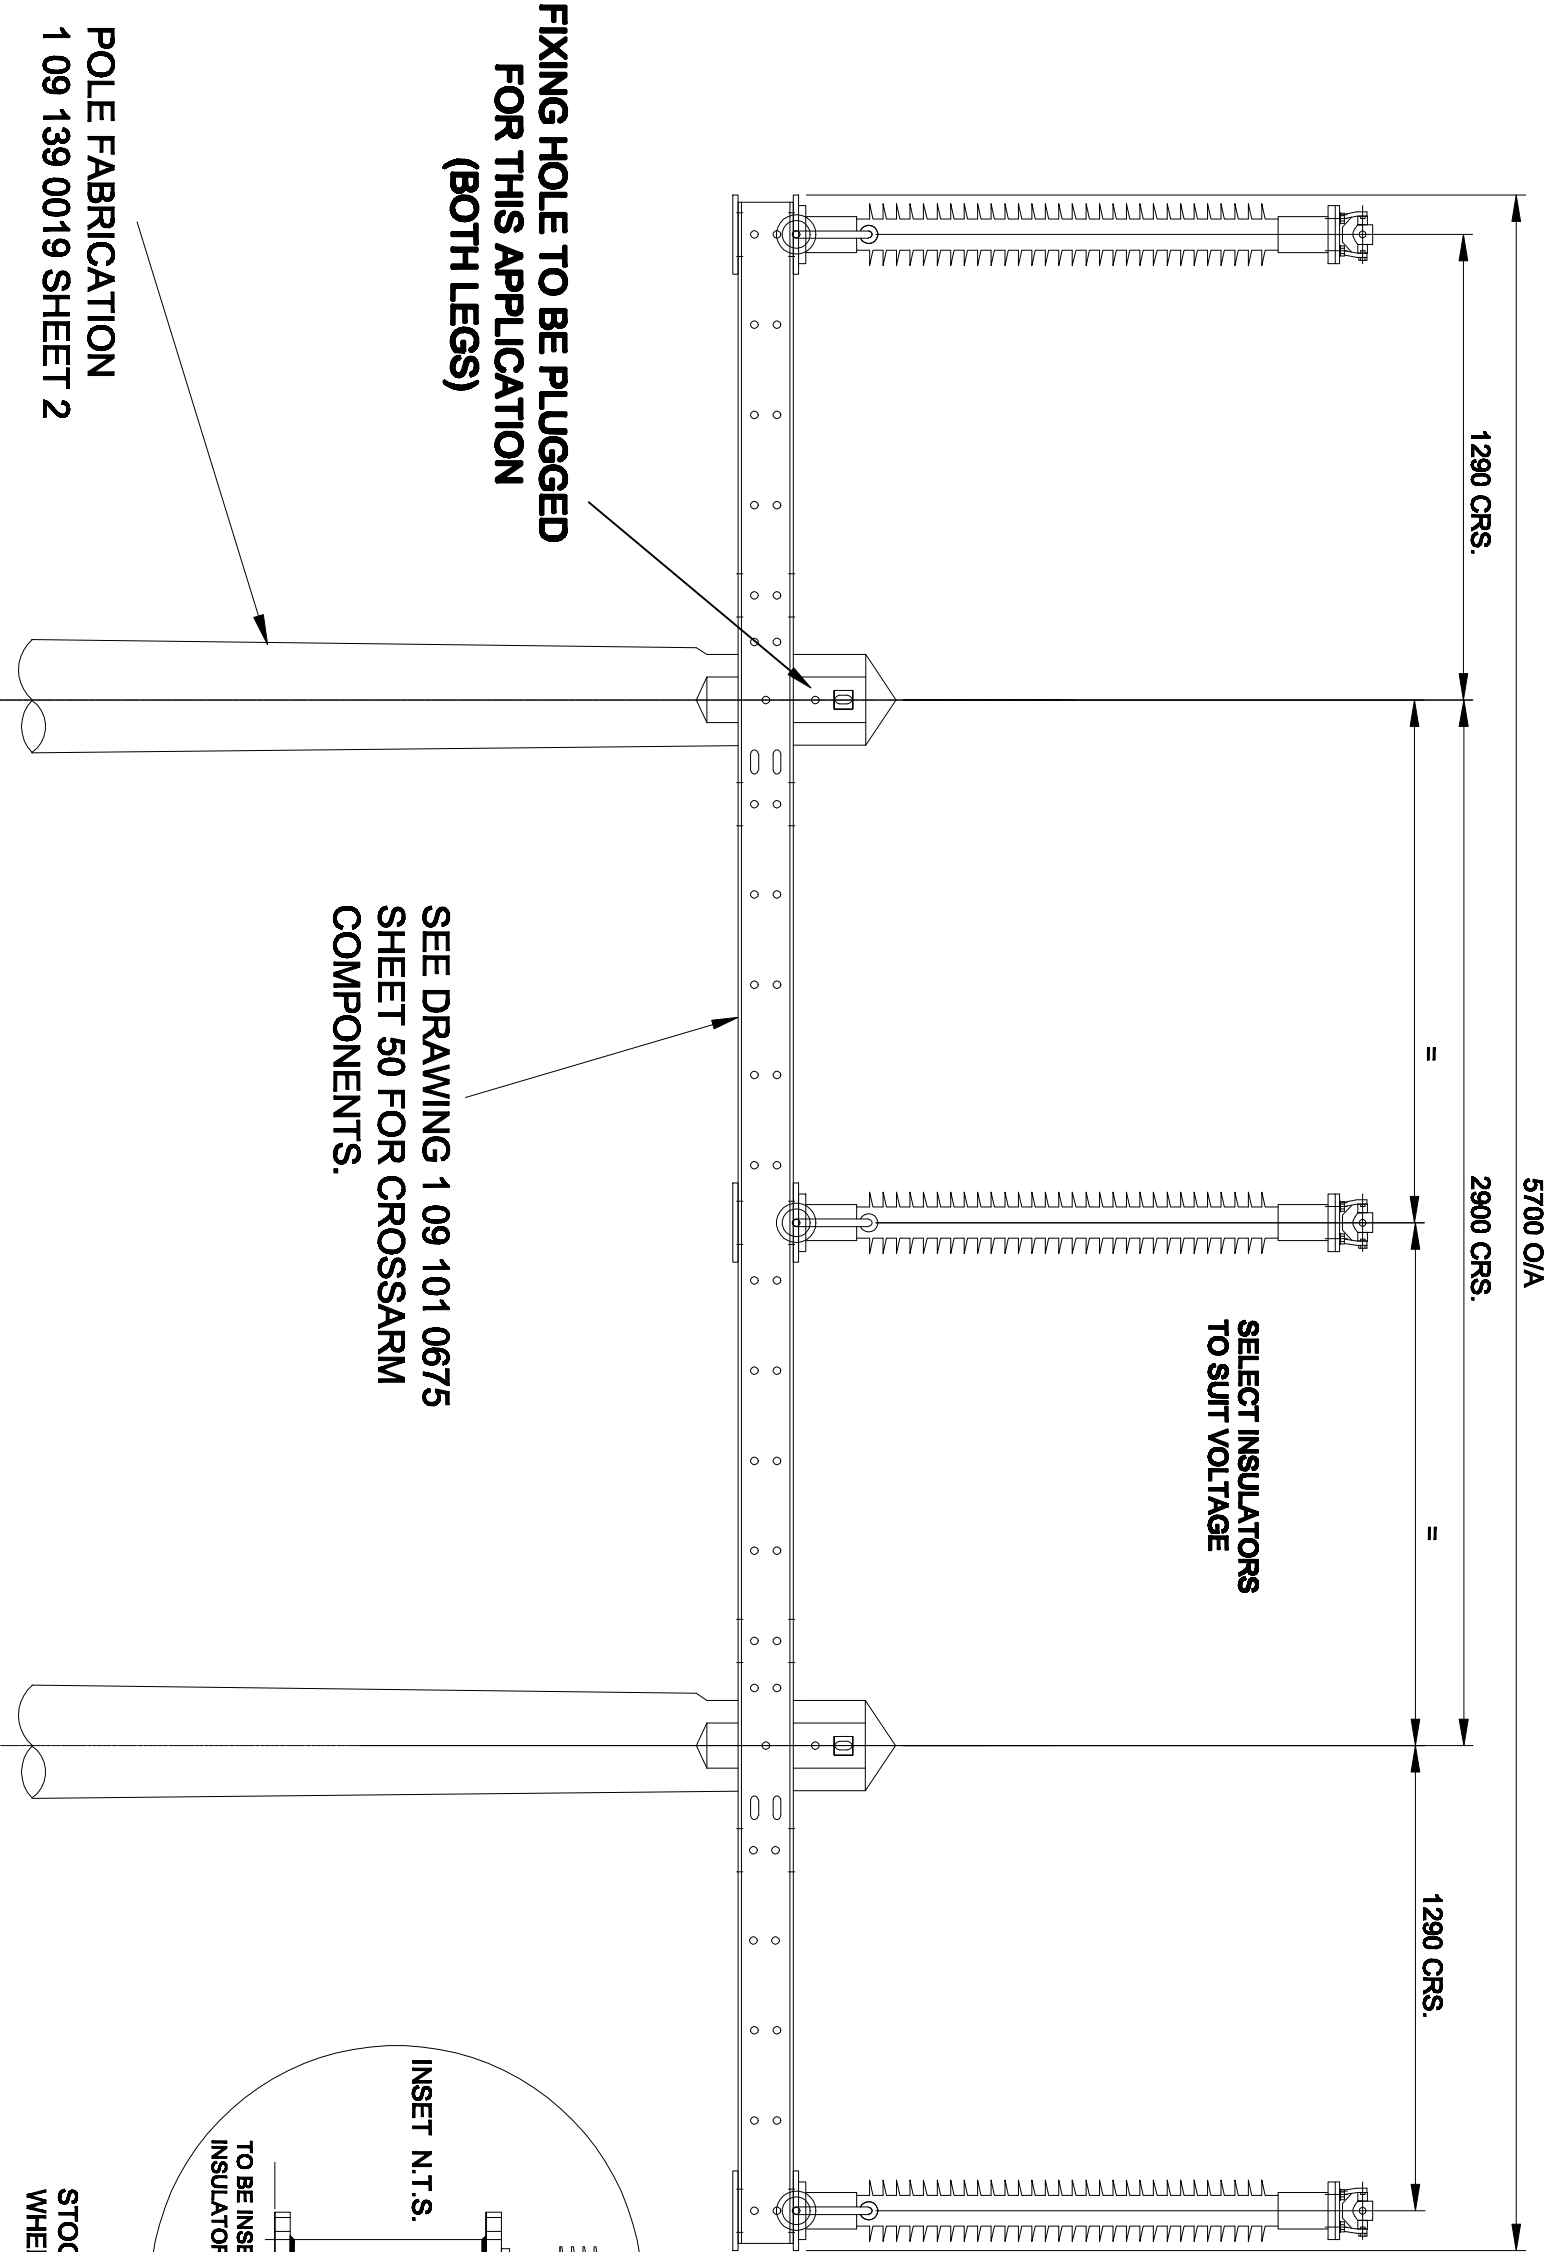


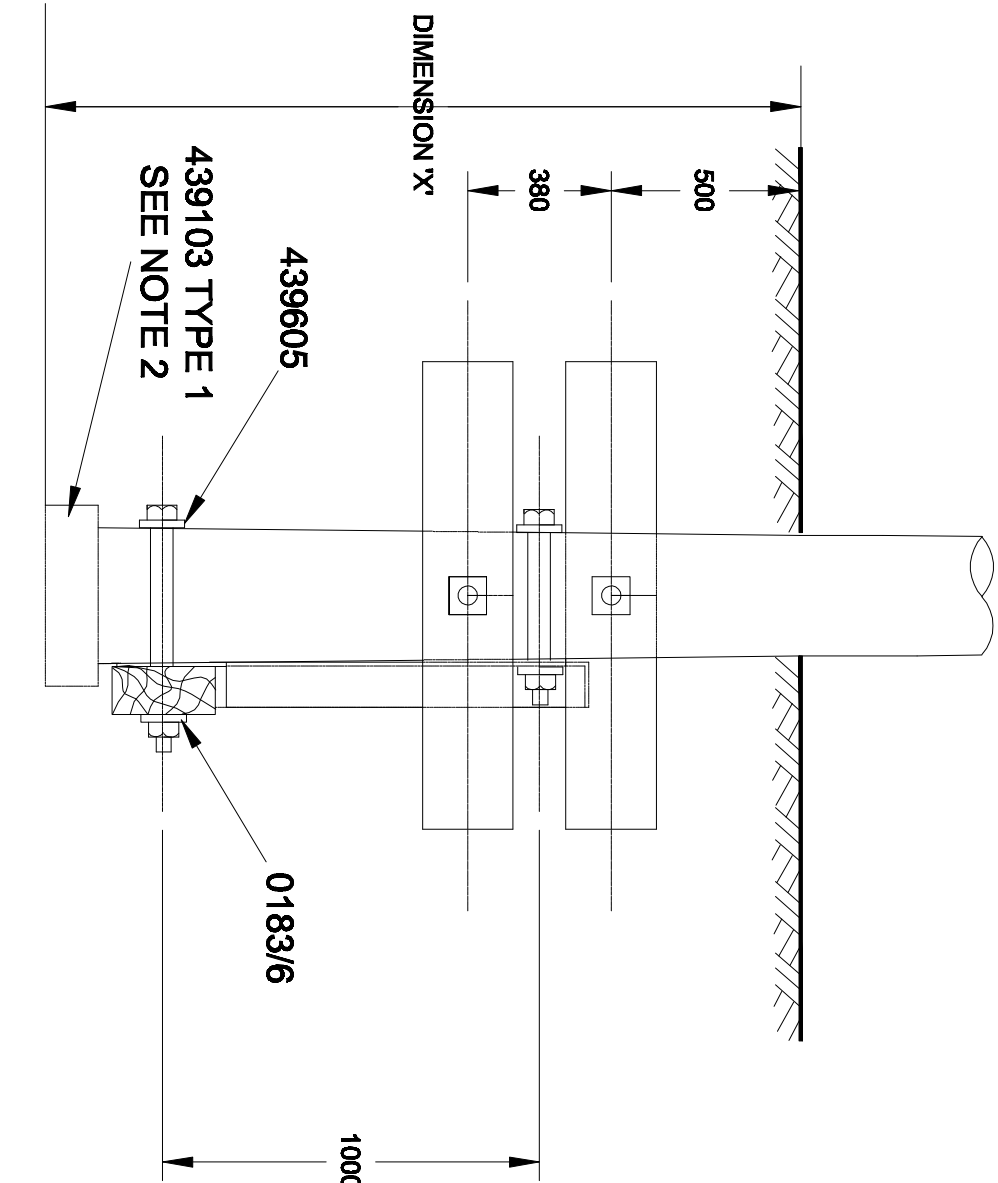

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

ENLARGED SCALE DETAIL 'A'

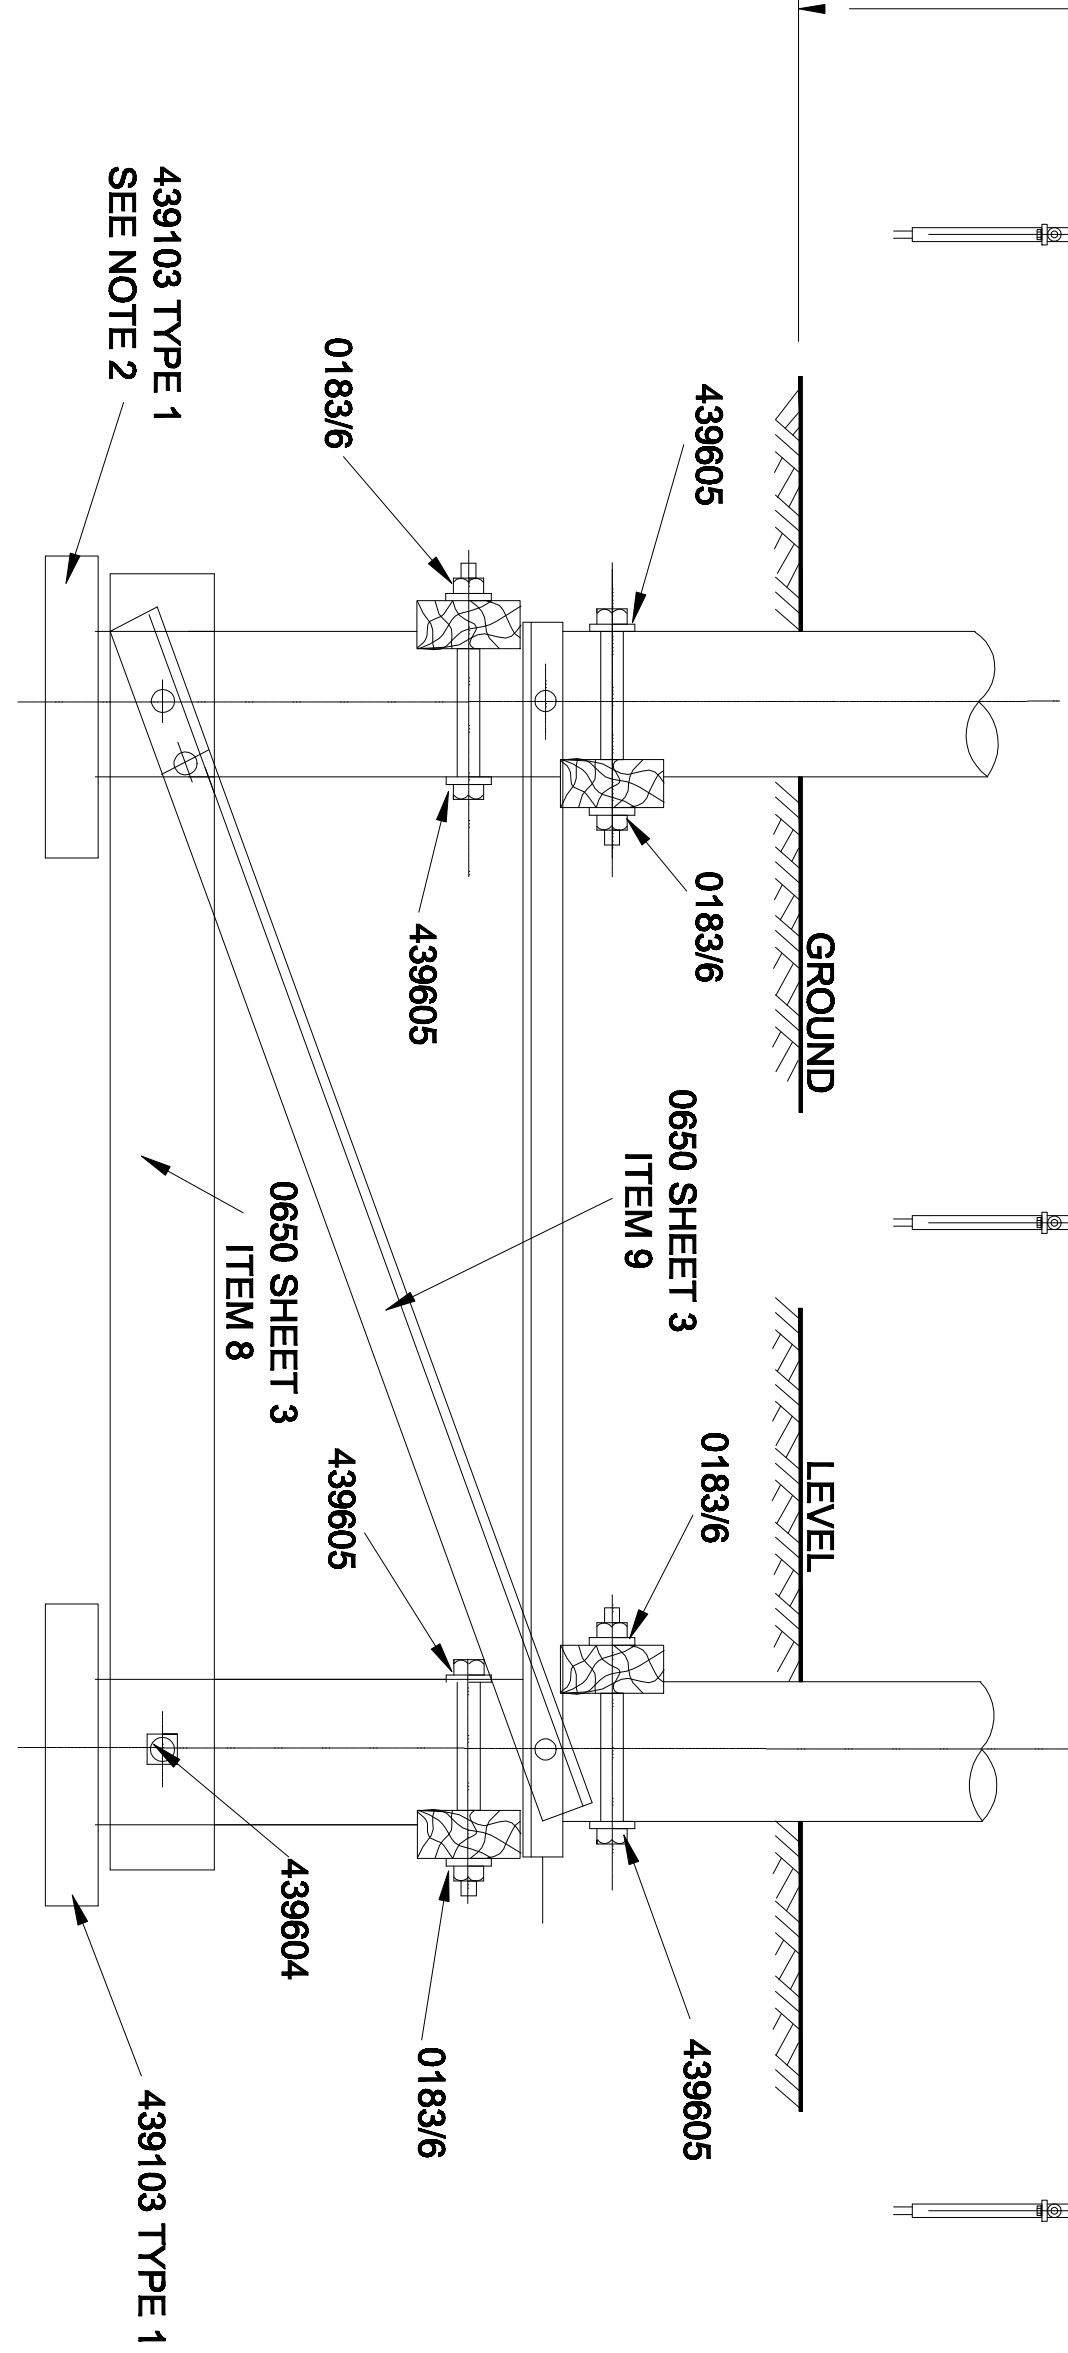

- NOTES**
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 NO WOOD BAULKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
 3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
 4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 1200mm
 5. CLEARANCE BETWEEN PHASES TO BE 1500mm
 6. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 NO ROUND WASHER UNDER NUT AND 1 NO ROUND WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE
 7. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
 8. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

ALL DIMENSION SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

ENLARGED SCALE DETAIL OF CROSSARM FIXING

CE Electric UK

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

66/132kV SINGLE CIRCUIT OVERHEAD LINES

OUT OF BALANCE SECTION ARRANGEMENT

2.0M. CTRS 'H' POLE

Manufacturer Details	Scale	N.T.S.	Type	OVERHEAD	POLES	Historic Dwg No.	1091390021
Sheet No.	1		Revised By	John Oakley	Grid Reference	Ref No.	C990129
Revised	25/09/10		Checked By	G HAMMILL	Revision	Notes	