


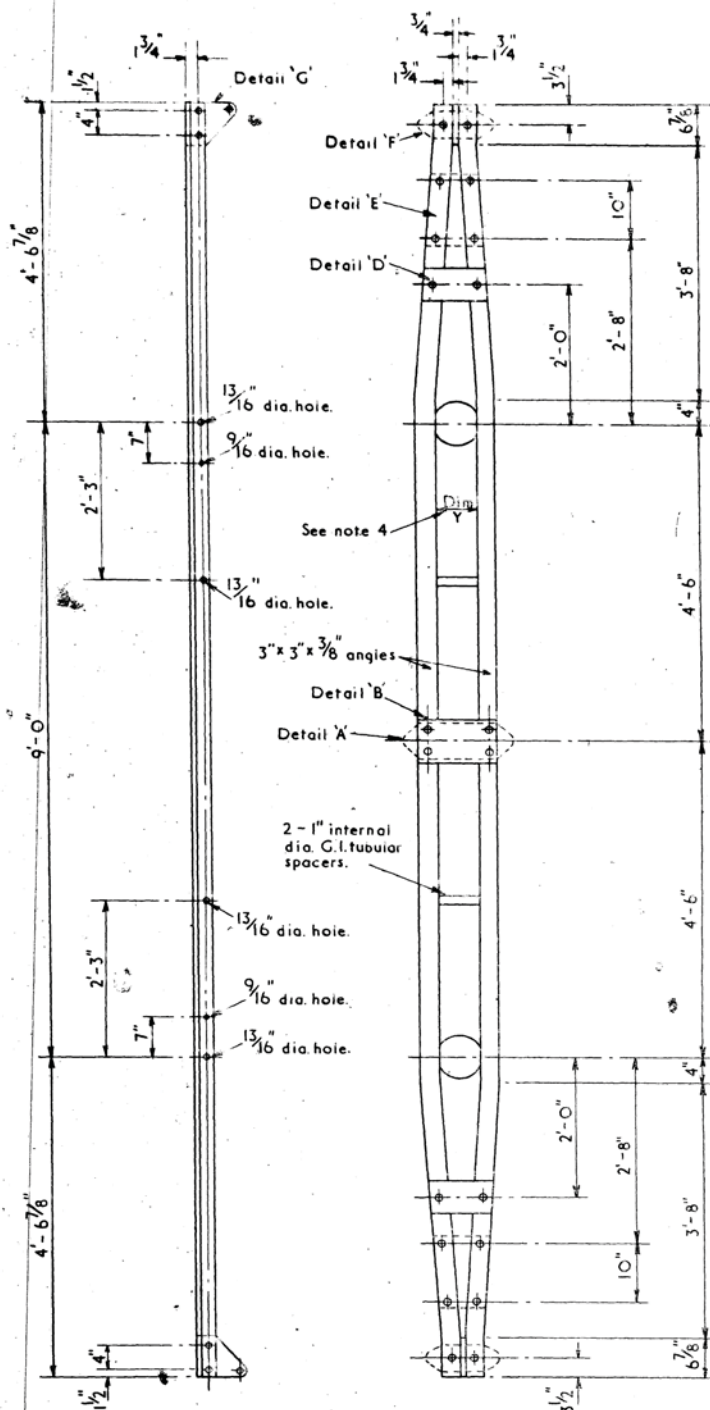


ARRANGEMENT OF CROSSARMS.


SCALE: $\frac{3}{4}'' \equiv 1'-0''$

NOTES.


1. DETAILS OF STEELWORK WHEN $3'' \times 3'' \times \frac{3}{8}''$ ANGLE IS SPECIFIED IN LIEU OF $3\frac{1}{2}'' \times 2\frac{1}{2}'' \times \frac{1}{4}''$ ANGLE.
2. STEELWORK TO BE 28/33 TON QUALITY TO B.S.4 PART 1 & B.S.15 GALVANISED TO B.S.729.
3. ALL HOLES $\frac{11}{16}''$ DIA. UNLESS OTHERWISE STATED.
4. DIM. 'Y' FOR MEDIUM WOOD - $6\frac{1}{2}''$
STOUT WOOD - $8''$




DETAIL 'G' $\frac{3}{4}''$ W.I. PLATE

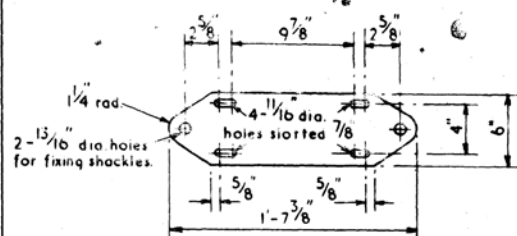


DETAIL 'A' $\frac{5}{8}''$ M.S. PLATE

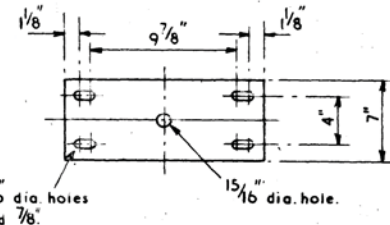


DETAIL 'B' $\frac{5}{8}''$ M.S. PLATE

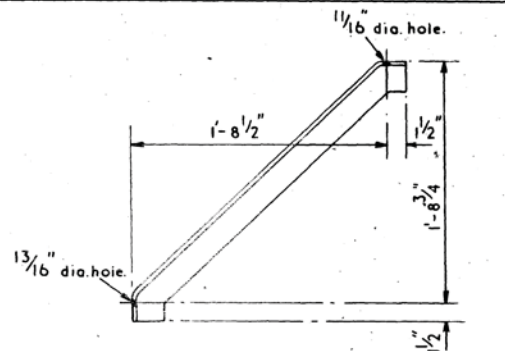


DETAIL 'C' $2\frac{1}{2}'' \times 2\frac{1}{2}'' \times \frac{1}{4}''$ M.S. ANGLE

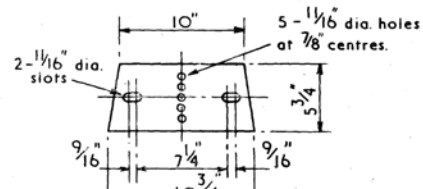

DETAIL 'D' $\frac{1}{2}''$ M.S. PLATE

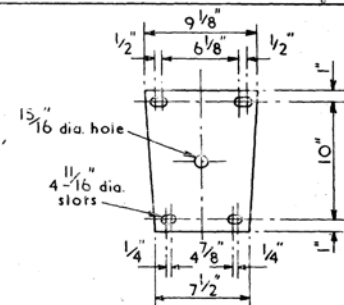

DETAIL 'E' $\frac{5}{8}''$ M.S. PLATE

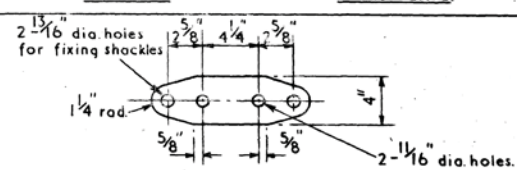

DETAIL 'F' $\frac{5}{8}''$ M.S. PLATE

SCALE OF DETAILS: $\frac{1}{2}'' \equiv 1'-0''$

THE NORTH EASTERN ELECTRICITY BOARD



66kV PORTAL POLE CONSTRUCTION

Date	3-5-57	Drawn by	Traced by	Checked by
		P.W.		
DRG. No.	66-5/10-1161			
SHEET 3	NO. OF SHEETS 10			

Redrawn
now 3
sheets.
2-4-73 P.J.M.
Mod. C
2 sheets
amended
to 4 sheets
7-6-66
Mod. B
Dim. Y for
M. wood &
stout wood
was $5\frac{3}{4}''$ & $7''$
respectively
6-8-59
Mod. A

Muds. A/B/C

DETAILS DRAWN AT $\frac{1}{2}'' \equiv 1'-0''$

0369

ARRANGEMENT DRAWN AT $\frac{3}{4}'' \equiv 1'-0''$

SCALES: 1