



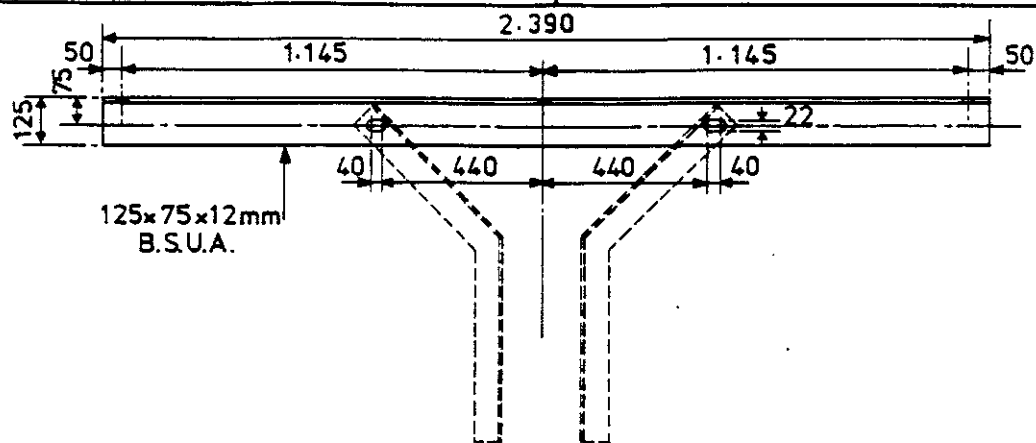

ELEVATION




PLAN

MATERIALS

ALL STEELWORK TO BS 4 PART 1 & BS 4360 GRADE 43 A
GALVANISED TO BS 729
NUTS & BOLTS TO ESI STANDARD 43-96.


BOLTS

2 No.	20mm DIA. x 45 LONG THREADED 45mm COMPLETE WITH NUT.	BRACKET/CROSSARM
2 No.	20mm DIA. x 300 LONG THREADED 150mm COMPLETE WITH NUT.	BRACKETS / POLE

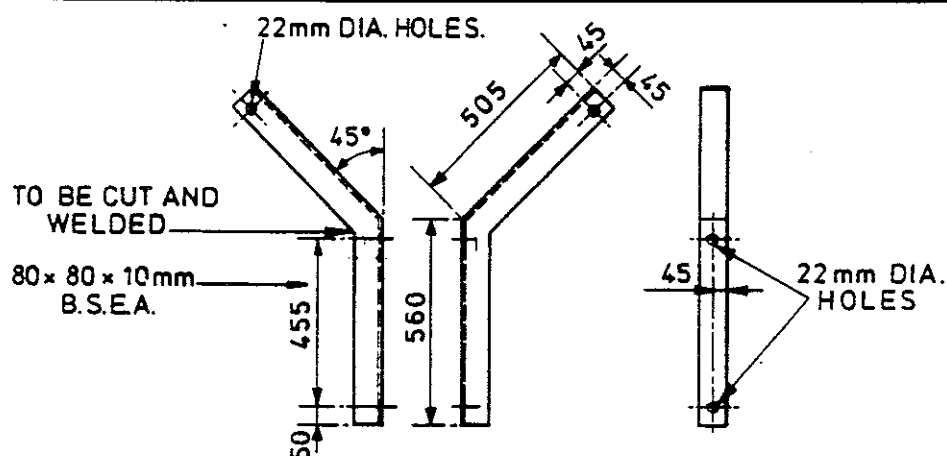

DETAIL OF CROSSARM BRACKET
(SUPPLIED IN PAIRS)

D		drawn N.F.	OVERHEAD LINES SPEC CE/C/36
		traced J.M.P.	
C		checked ☒	
		date 24.9.87	
B		original scale 1:20	CROSSARM STEELWORK & BRACKET FOR INTERMEDIATE SUPPORT
A	REDRAWN AND METRICATED AND DETAIL ADDED. J.M.P. 24.9.87	Yorkshire Electricity Board	Y003 X 3305

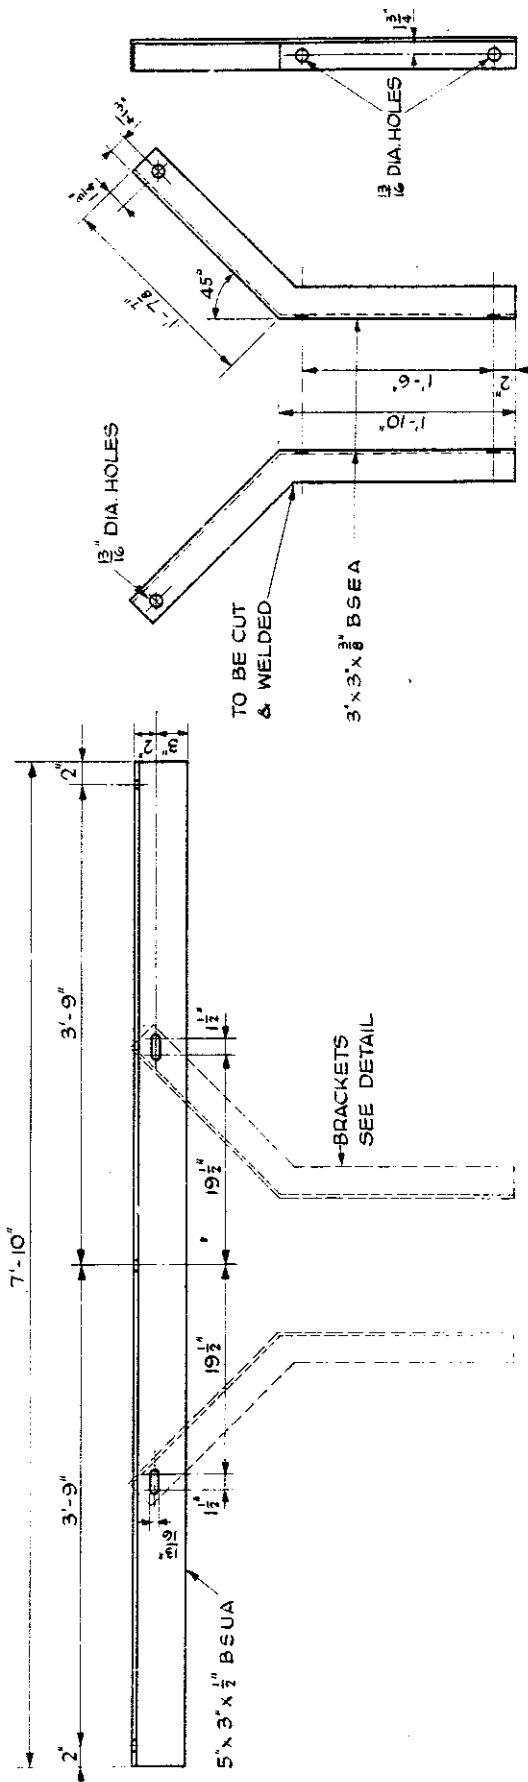

ELEVATION

DETAIL OF CROSSARM BRACKET
SUPPLIED IN PAIRS



PLAN

MATERIALS
ALL STEELWORK TO B.S.4 PART 1 & B.S.4360 GRADE 43A
GALVANISED TO B.S.729
BOLTS TO B.S.916 THREADED B.S. WHITWORTH

BOLTS

No	Description	Quantity	Unit	Remarks
2	1/2" DIA. 14" LONG SCREWED 1" COMPLETE WITH NUT	2	BRACKETS / CROSSARM	
2	3/4" DIA. 16" LONG SCREWED 5" COMPLETE WITH NUT	2	BRACKETS / POLE	

drawn		checked		date		scale	
M.G.B.		M.G.B.		26.3.69		1" = 1'	
OVERHEAD LINES SPEC. CE/C/36							
CROSSARM STEELWORK FOR INTERMEDIATE SUPPORT (ACSR CONDUCTORS-SPAN 255' - 350')							
Yorkshire Electricity Board				Y003 X 3306			



NOTE:--
HOLES FOR ALTERNATIVE POSITIONS OF PILOT INSULATOR SPINDLES. ONLY TO BE PROVIDED WHEN SPECIFIED WHERE POSSIBLE ALL WELDS SHOULD BE 6mm FILLET.



MATERIALS

ALL STEELWORK TO B.S.4 PART 1 AND B.S.4360 GRADE 43A
GALVANISED TO B.S.729
BOLTS TO ESI 43-96

drawn	NF
traced	NJR
checked	
date	19. 10. 87.
original scale	1 : 10

4. Nº	MIG DIA x 50. LONG SCREWED 38 COMPLETE WITH NUT	CROSSARM/GUSSET
4. Nº	M20 DIA x 300 LONG SCREWED 150 COMPLETE WITH NUT	CROSSARM/GUSSET/ POLE

A	ADDITIONAL HOLES FOR INSULATOR SPINDLE ADDED.	B	C	D	Yorkshire Electricity Board	Y003 X 3307
	5.11.82	19.10.87				

DATE 01/11/88 (10/11)