



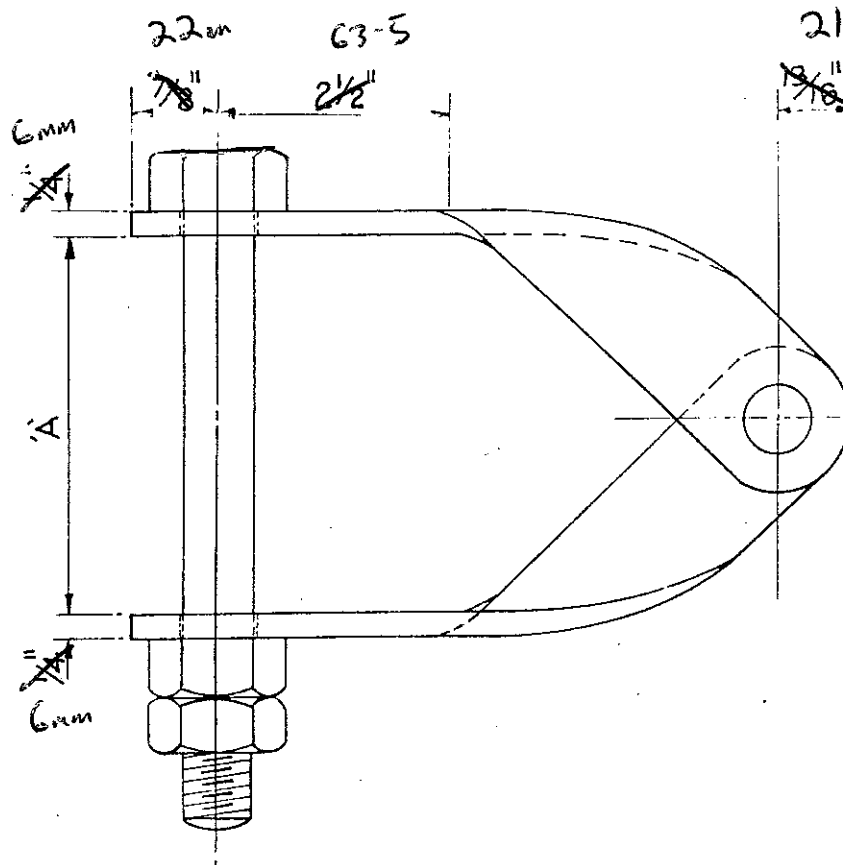

ELEVATION

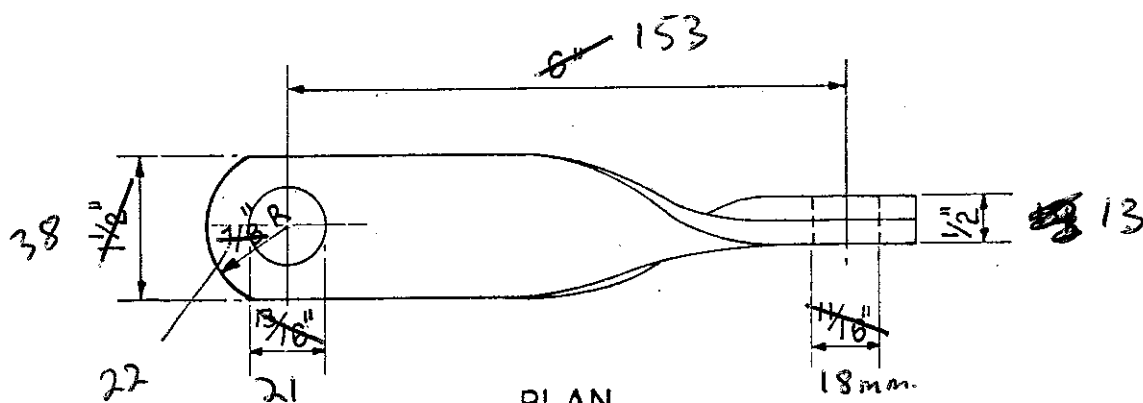

PLAN

140 14 203 BOLT DATA 63-5

A	DIA	LENGTH	REMARKS	NUT	THR'D
5 1/2	3/4	8	CROSSARM STRAPS/CR ARM	2	2 1/2
4 1/2	3/4	6 1/2	"	2	2

114 22 165 50

BOLTS TO BS 916 THREADED BSW SUPPLIED WITH STRAP MATERIAL:-MILD STEEL GALVANISED TO BS 729

1091010563 sh1

D		drawn N.F.	HV. OVERHEAD LINES
		Traced RS-S	
C	7/8" RADIUS WAS 1" SQUARE RS-S 24-9-70	checked JLS	
		date 24-9-70	
B	DIMENSION 'A' ALTERED RS-S 5.11.70	scale 1/2 F.S.	CROSSARM STRAP 1500016 M.F.L.
A	END OF STRAP MODIFIED		
Yorkshire Electricity Board			Y003X2210