





ARRANGEMENT OF ROCKING TYPE ABSD ON
SECTION POLE TO Y003X1312

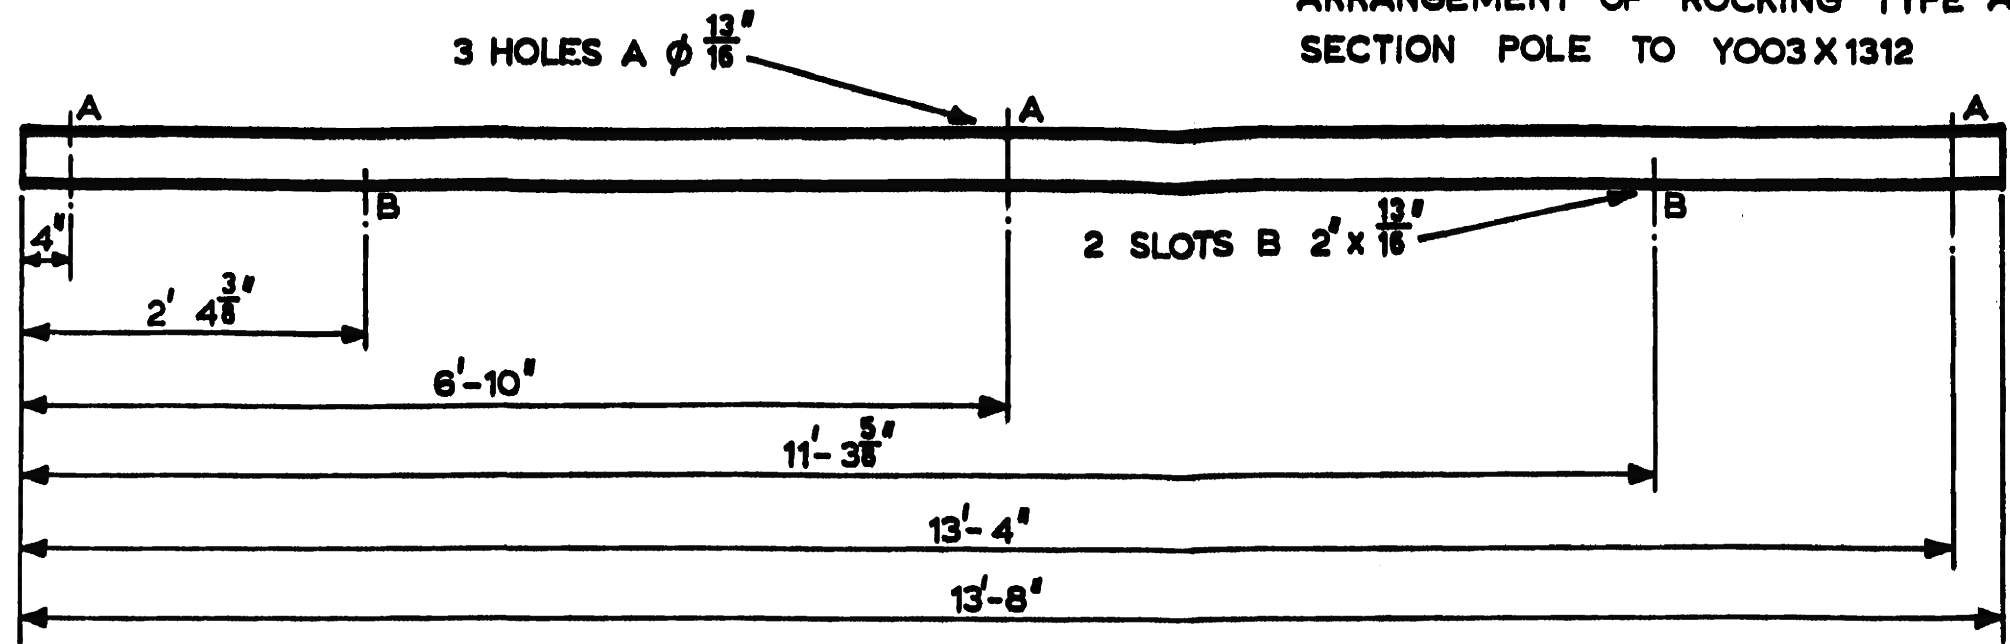

ELEVATION
ITEM ①

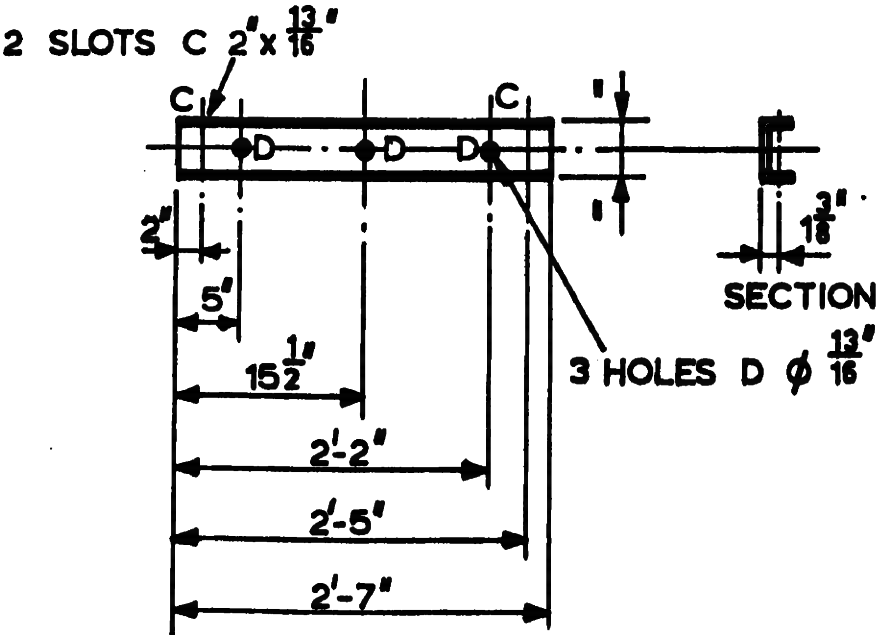

ELEVATION
ITEM ②

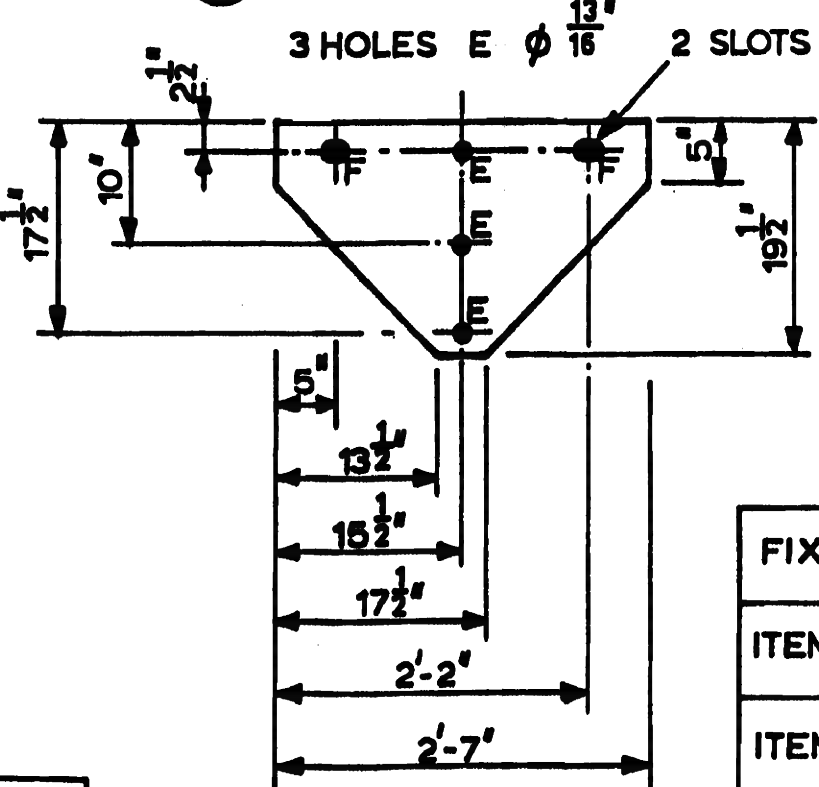

ELEVATION
ITEM ③

ALL STEELWORK TO BE IN ACCORDANCE WITH
BS 4360 GRADE 43A AND BS 4 PART 1
GALVANISED IN ACCORDANCE WITH BS 729
ALL BOLTS TO BS 916 SCREWED BSW AND
GALVANISED IN ACCORDANCE WITH BS 729

BOLT LIST

FIXING BETWEEN	WASHERS	SIZE	No REQUIRED
ITEM ① AND ITEM ②	8 TAPER	2 $\frac{1}{2}$ " x $\frac{3}{4}$ " DIA	4
ITEM ② AND ITEM ③	8 ROUND	2" x $\frac{3}{4}$ " DIA	4
ITEM ③ AND WOOD POLES	6 CURVED 6 ROUND	12" x $\frac{3}{4}$ " DIA	6

ITEM	DESCRIPTION	MATERIAL	No. REQUIRED
①	CROSS CHANNEL	127 x 64 x 14.9 kg / m BS CHANNEL	2
②	SUPPORT	127 x 64 x 14.9 kg / m BS CHANNEL	2
③	GUSSET PLATE	$\frac{1}{4}$ " THK MS PLATE	2

A		B		C	
---	--	---	--	---	--

DRAWING WAS FORMERLY Y003X3433

drawn M.W. 17.7.97	OVERHEAD LINES CE/C/37	
traced J.E.F. 17.7.97	33kV ROCKING TYPE AIR BREAK SWITCH DISCONNECTOR SUPPORT- STEELWORK DETAILS	
checked -	date -	original scale $\frac{3}{4}$ " TO 1'
approved -		Y204L0912

