



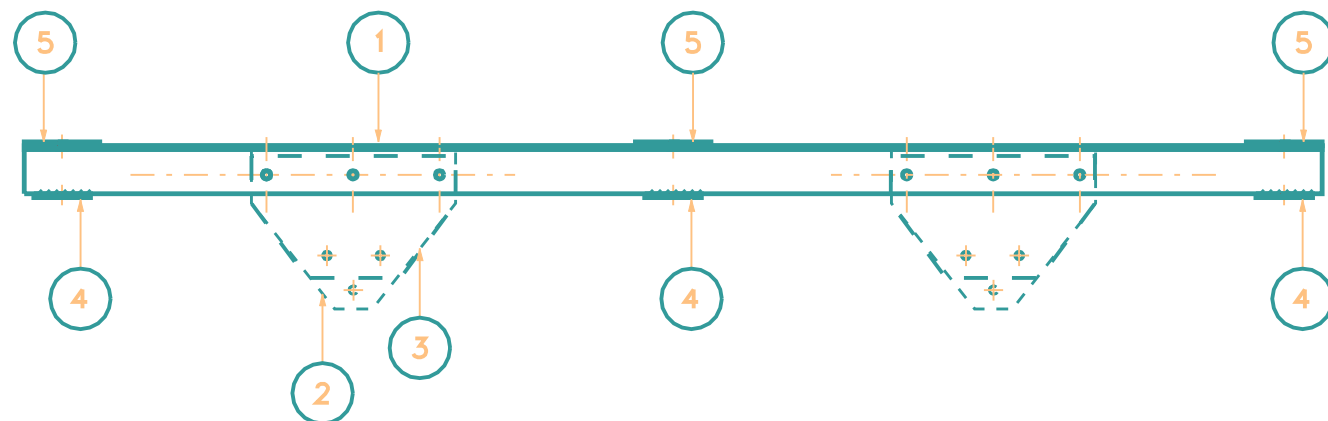

ELEVATION

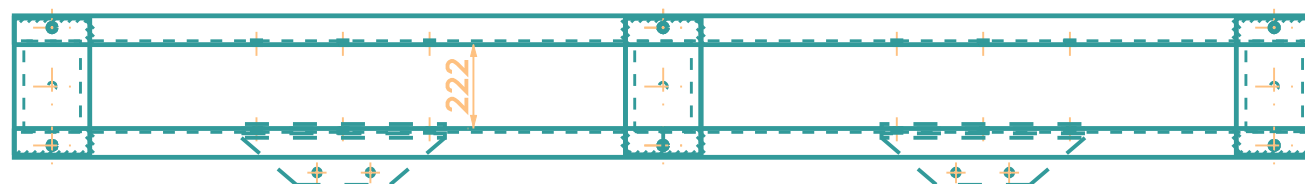


PLAN

CROSSARM

WELDED ASSEMBLY OF ITEMS ①, ④ & ⑤
1 No REQUIRED

NOTES

- 1 ALL WELDS TO BE 6mm FILLET ARE SHOWN THUS 
- 2 GALVANISED TO BS729 AFTER WELDED FABRICATION
- 3 ITEMS ② & ③ SHOWN DOTTED ARE TO BE ASSEMBLED ON SITE WITH THE CROSSARM ASSEMBLY
- 4 FOR ARRANGEMENT DRG SEE Y104L0109

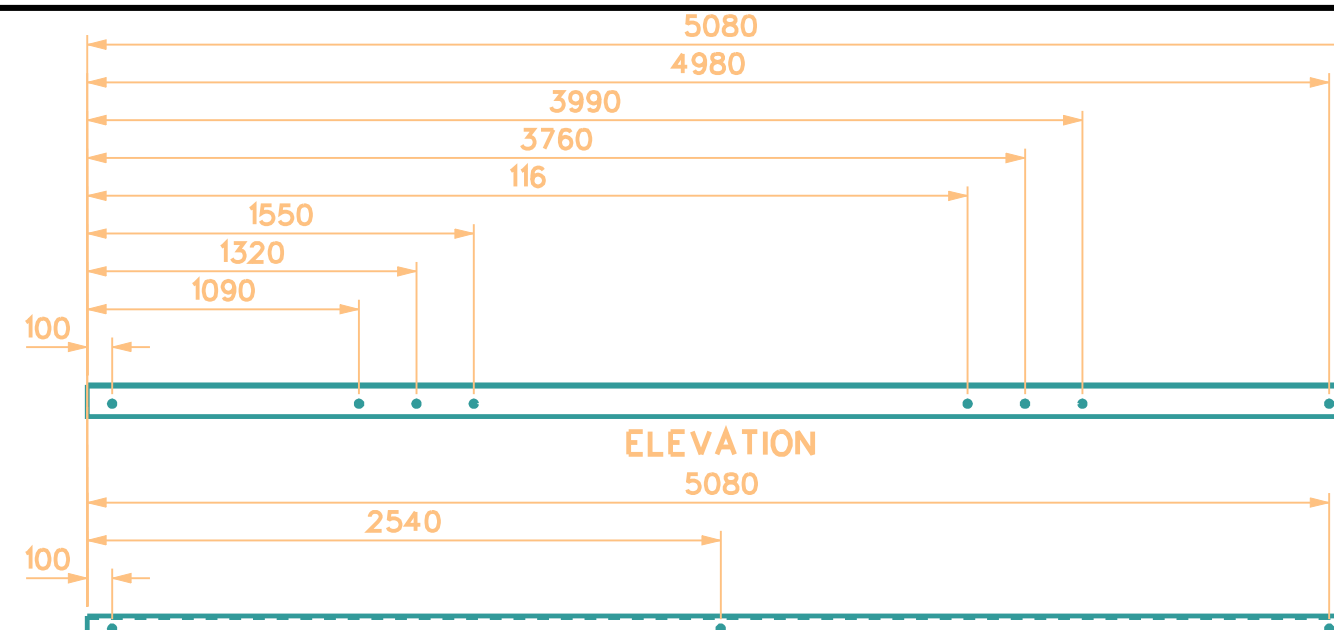


ELEVATION



PLAN


ITEM No ①
2 No REQUIRED

125x75x12 BSUA

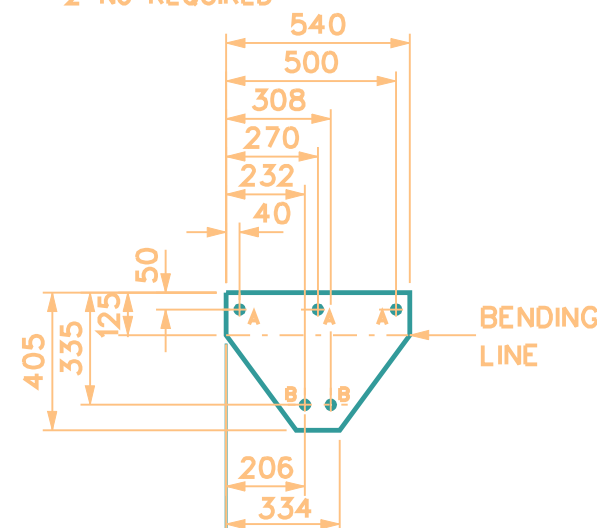


ELEVATION

BENDING
DETAIL

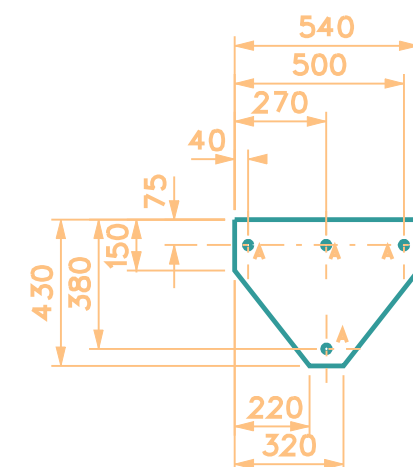


ITEM No ②
2 No REQUIRED

ITEM No ②
2 No REQUIRED

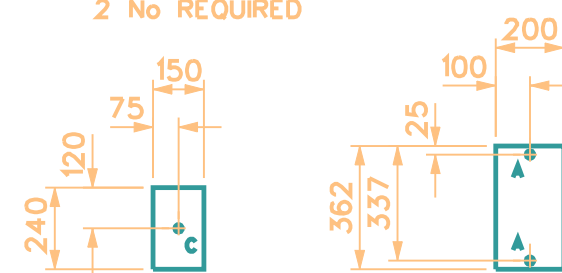

ITEM No ④
3 No REQUIRED



ITEM No ⑤
3 No REQUIRED

NOTES

- 1 HOLES MARKED "A" Ø22
- 2 HOLES MARKED "B" Ø27
- 3 HOLES MARKED "C" Ø18
- 4 ALL STEELWORK TO BS4848 PART4 & BS4360 GRADE 43A
- 5 GAVANISED TO BS729 AFTER FABRICATION
- 6 ITEMS ②, ③, ④ & ⑤ MADE FROM 10mm MS PLATE
- 7 FOR ARRANGEMENT DRG SEE Y003X9203

DIMENSIONS IN MILLIMETRES

drawn	C.R. 20.7.92	CROSSARM STEELWORK FOR 33kV POLYMERIC CABLE TERMINATION CE/C/37 - CE/OM/DC1		
traced	J.E.F. 23.7.92			
checked	J.M.P. 23.7.92			
approved	G.R.	date	9.8.94	original scale
		Y204L0916		CAD

**YE
DL**
RELENTLESSLY
AT YOUR SERVICE