



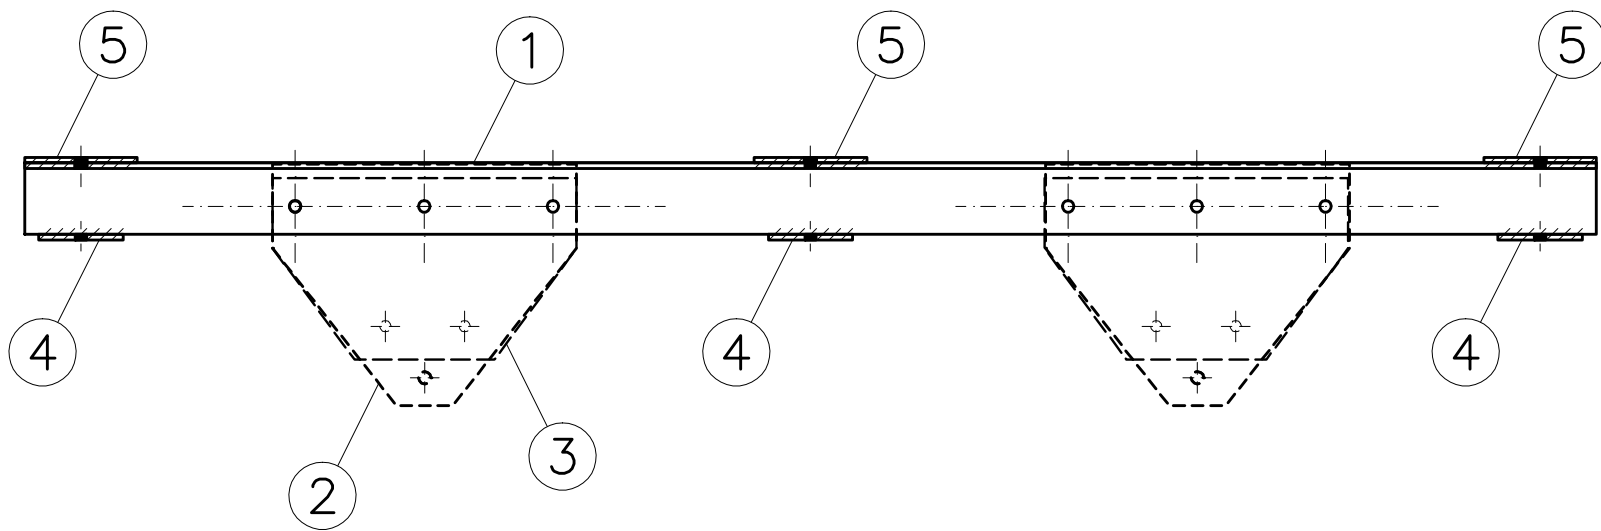

ELEVATION

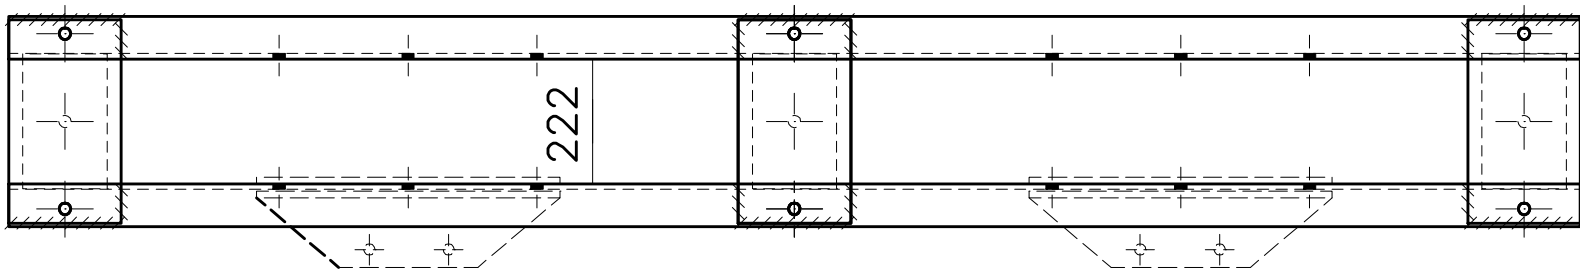

PLAN

CROSSARM

WELDED ASSEMBLY OF ITEMS 1○, ④ & ⑤
 1 No. REQUIRED

NOTES

- 1 ALL WELDS TO BE 6mm FILLET ARE SHOWN THUS ////////
- 2 GALVANISED TO BS729 AFTER WELDED FABRICATION
- 3 ITEMS ② & ③ SHOWN DOTTED ARE TO BE ASSEMBLED ON SITE WITH THE CROSSARM ASSEMBLY
- 4 FOR ARRANGEMENT DRG SEE Y003X9203

DIMMENSIONS IN MILLIMETRES

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		CROSSARM STEEL WORK DETAIL 33KV POLYMERIC CABLE TERMINATION WITH SURGE DIVERTERS CE / C / 36 (M)			
Sheet No. 1	Scale N.T.S.				
Prepared By Janis.Webb		Type OVERHEAD		LINES	
Revised 30/05/07	Grid Reference	Ref No.	C948808	Historic Drg.No.	Y208L0901
Date Issued 29/05/07	Checked By	Revision	A	Notes	