



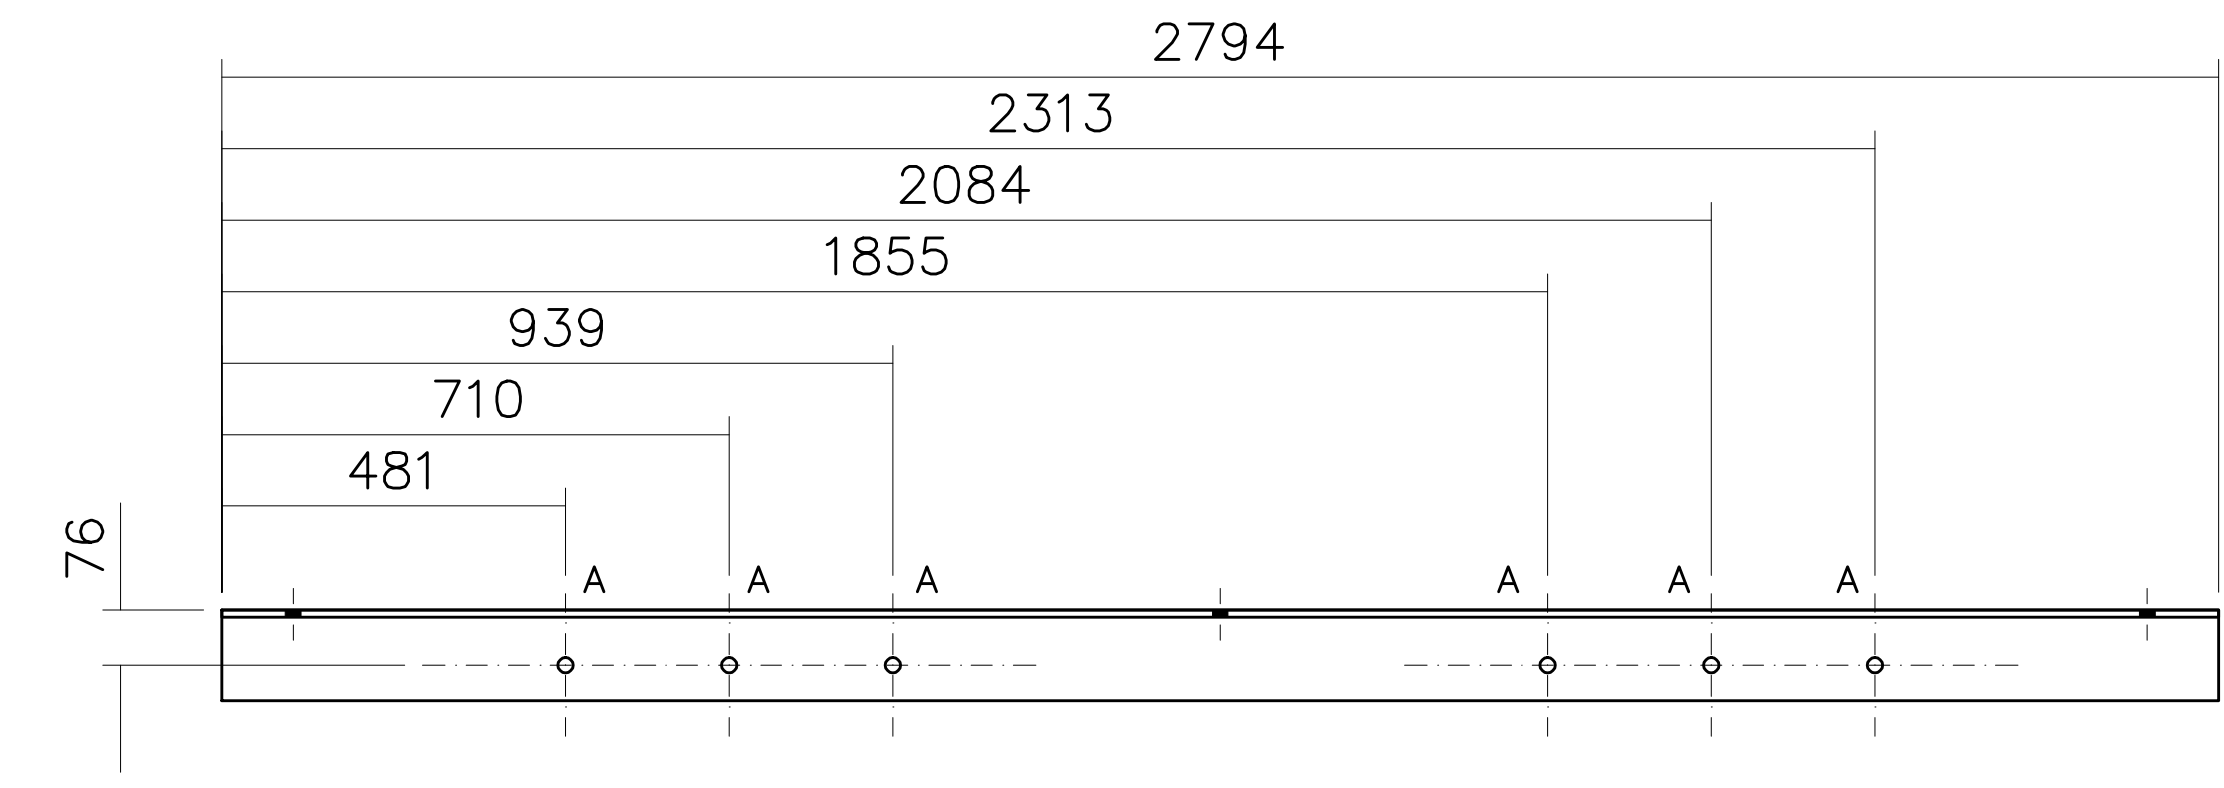


ELEVATION

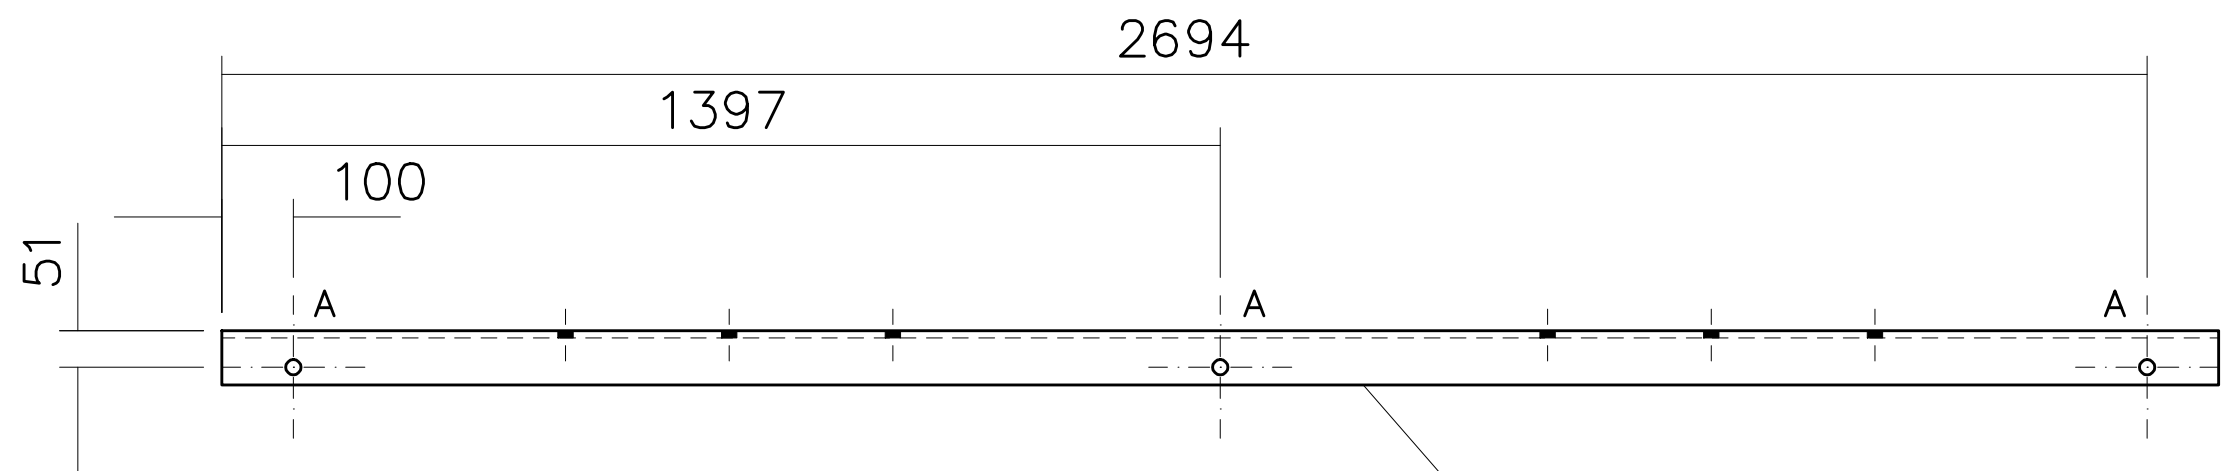


PLAN

125 X 75 X 12 BSUA

ITEM No. ①
2 No. REQUIRED

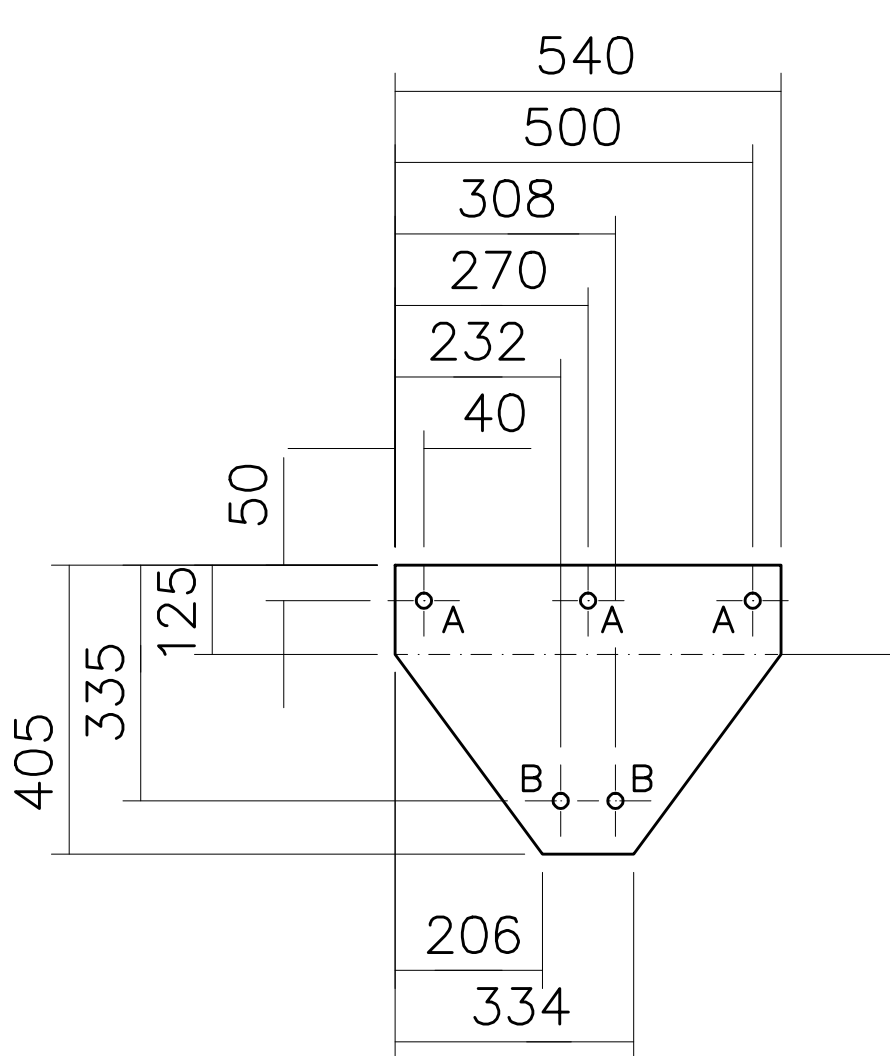


BENDING
LINE




BENDING
DETAIL


ITEM No. ②
2 No. REQUIRED

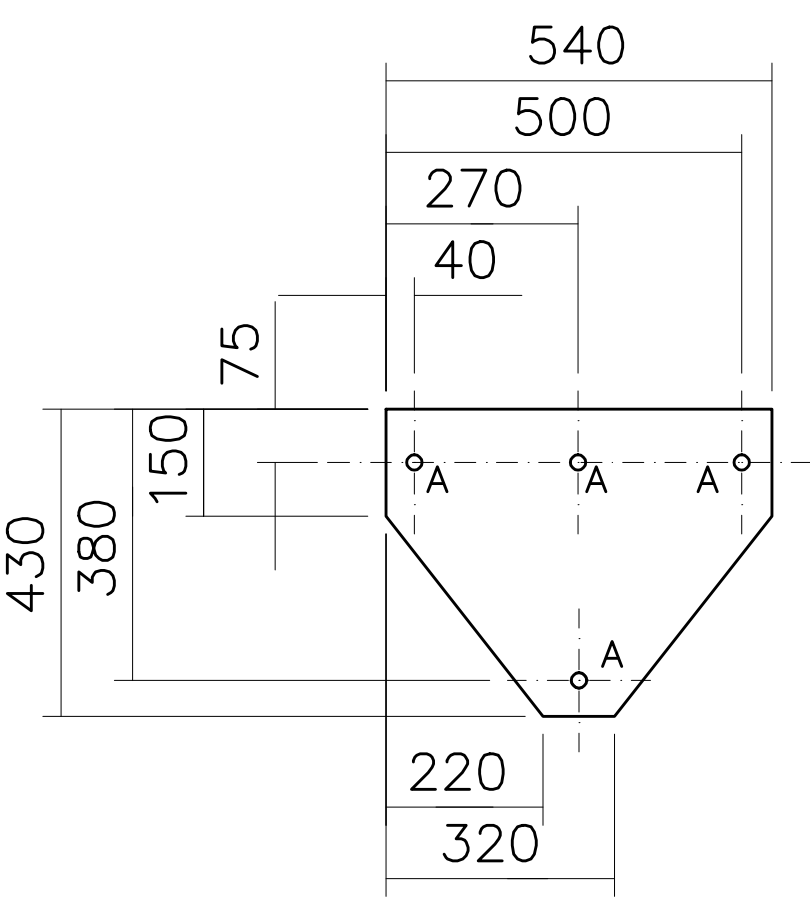

ITEM No. ③
2 No. REQUIRED

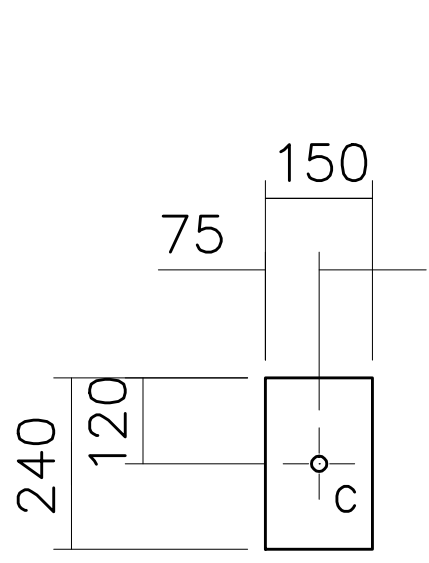

ITEM No. ④
3 No. REQUIRED

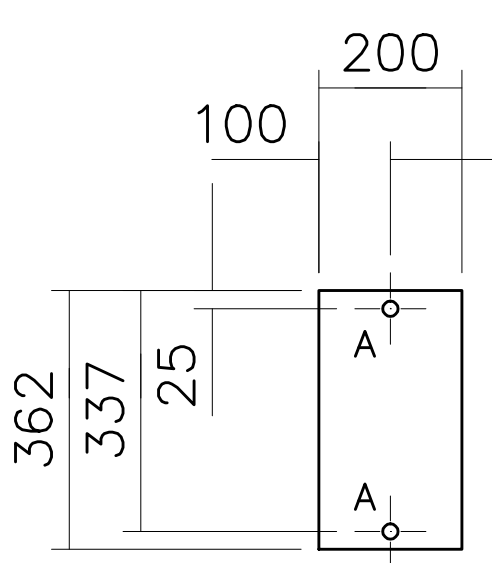

ITEM No. ⑤
3 No. REQUIRED

- NOTES
- 1 HOLES MARKED "A" Ø22
 - 2 HOLES MARKED "B" Ø27
 - 3 HOLES MARKED "C" Ø18
 - 4 ALL STEELWORK TO BS4848 PART4 & BS4360 GRADE 43A
 - 5 GAVANISED TO BS729 AFTER FABRICATION
 - 6 ITEMS ② ③ ④ & ⑤ MADE FROM 10mm MS PLATE
 - 7 FOR ARRANGEMENT DRG SEE Y003X9203

DIMMENSIONS IN MILLIMETRES

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		CROSSARM STEEL WORK DETAIL 33KV POLYMERIC CABLE TERMINATION WITH SURGE DIVERTERS CE / C / 36 (M)			
Sheet No. 2	Scale N.T.S.				
Prepared By Janis.Webb		Type OVERHEAD		LINES	
Revised 30/05/07	Grid Reference	Ref No.	C948809	Historic Drg.No.	Y208L0901
Date Issued 29/05/07	Checked By	Revision A		Notes	