


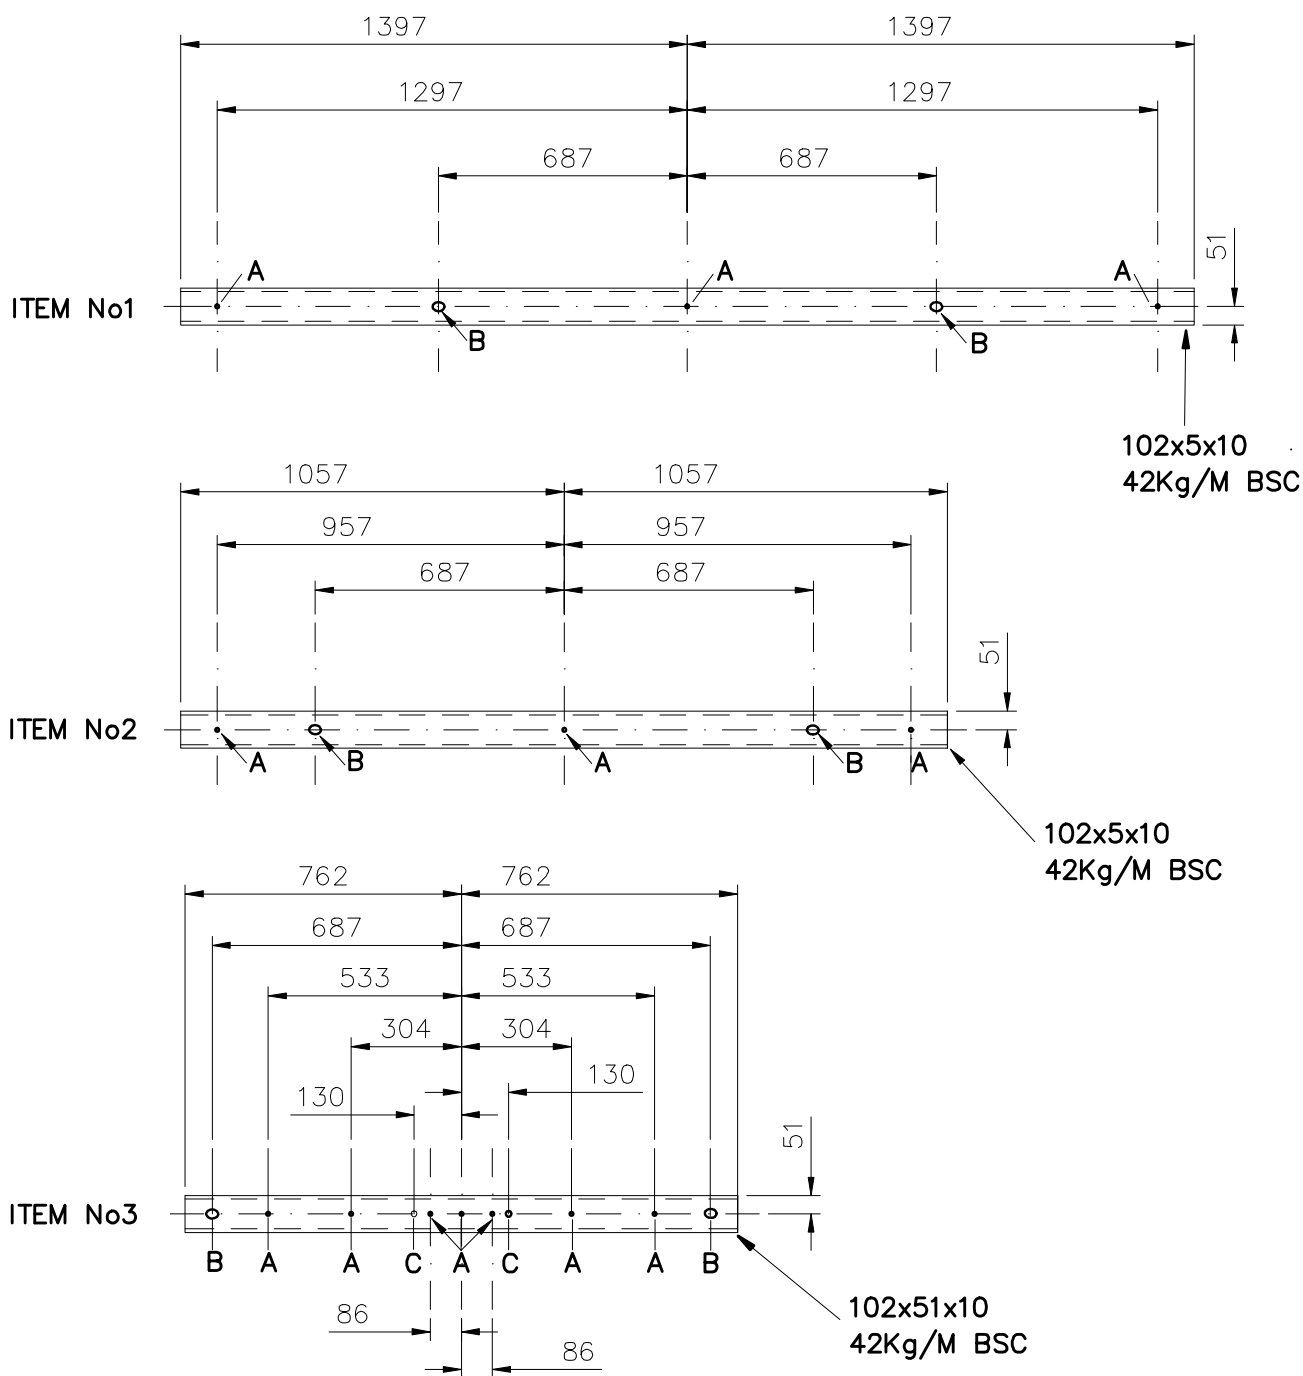

3No REQUIRED FOR 12m POLE
 4No " " 14m POLE
 5No " " 16m POLE
 6No " " 18m POLE

FOR ARRANGEMENT DRG SEE Y208L0901
 DIMENSIONS IN MILLIMETRES

NOTES

- 1 HOLES MARKED 'A' $\varnothing 12$
- 2 HOLES MARKED 'C' $\varnothing 12$
- 3 SLOTS MARKED 'B' 22x23 CTR
- 4 ALL STEELWORK TO BS4848
PART 4 & BS4360 GRADE 43
- 5 GALVANISED IN ACCORDANCE
WITH BS729 AFTER FABRICATION

CE Electric UK

Manufacturer Details

Sheet No.
1

Scale
1:20

Prepared By
Janis.Webb

Revised
30/05/07

Grid Reference

Date Issued
30/05/07

Checked By

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

CABLE SUPPORT STEEL WORK FOR 33KV POLYMERIC CABLE TERMINATION CE / C / 36

Type
OVERHEAD

LINES

Ref No. C948824

Historic
Drg.No.

Y208L0902

Revision B Notes