


NOT

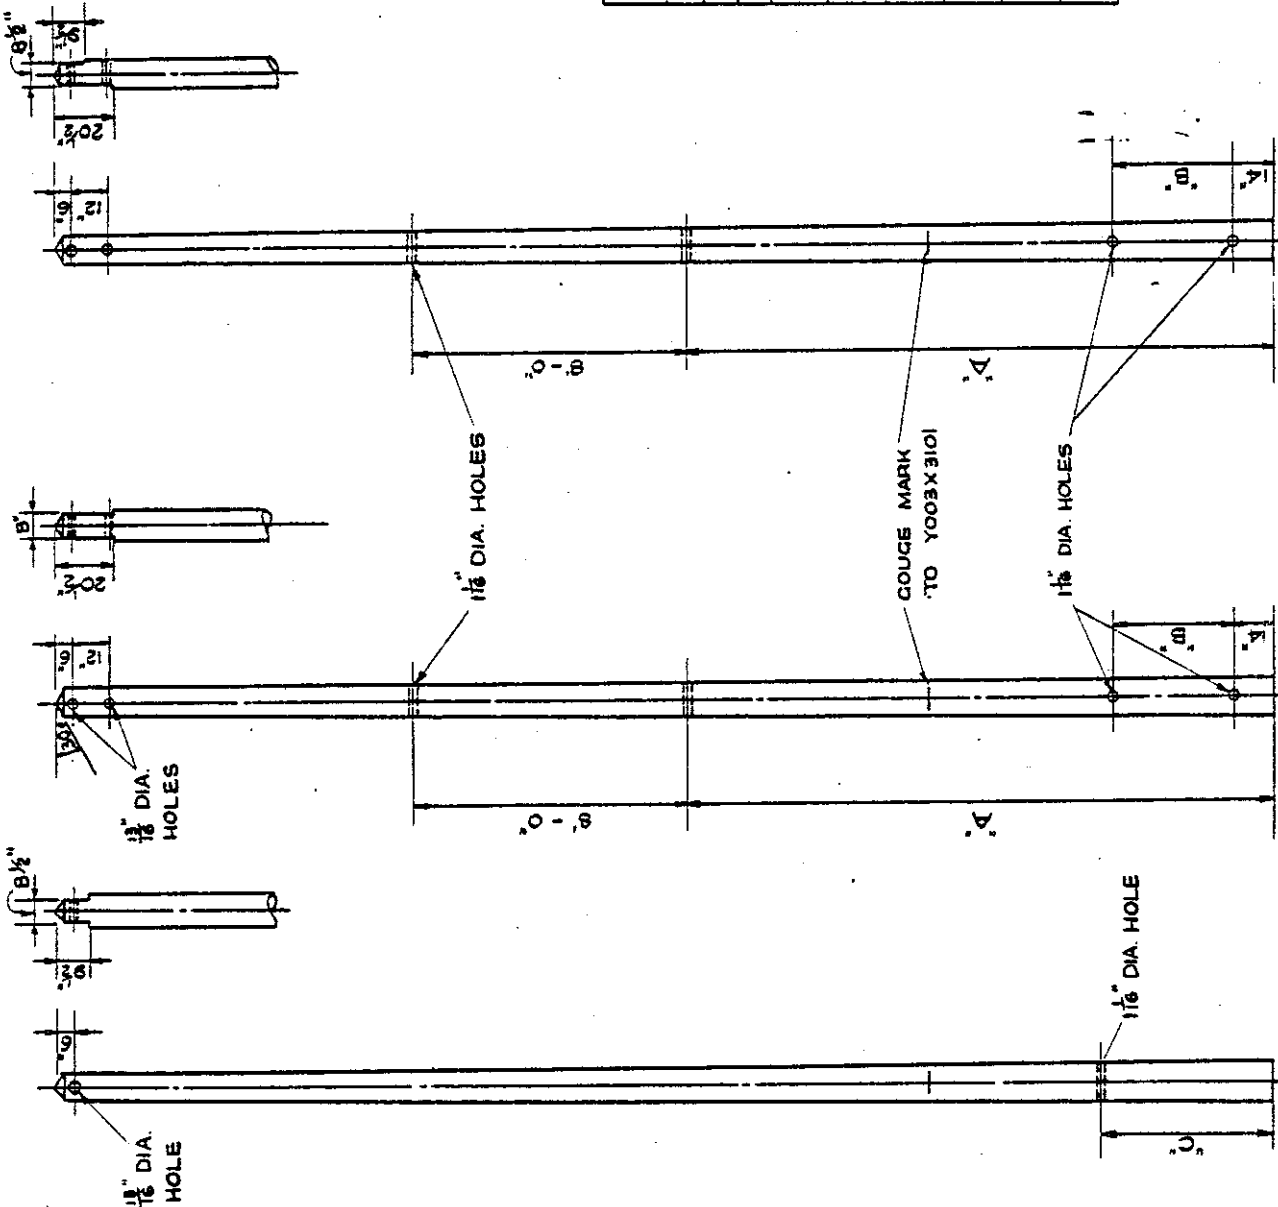

1. POLES TO BE STOUT CLASS TO B.S. 1990, CREOSOTED TO B.S. 913 BY THE RUEPING PROCESS AFTER ALL DRILLING AND SCARFING IS COMPLETE.
2. POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS FROM 1 ONWARDS.
3. POLES SELECTED FOR ANGLE AND TERMINAL STRUCTURES TO HAVE A POLE TOP DIAMETER NOT LESS THAN $\frac{3}{4}$ " (20mm) ABOVE THE MINIMUM SPECIFIED IN BS 1990, TABLE 3.
4. POLE TOP DIAMETER BEFORE SCARFING TO BE NOT LESS THAN 8" (205mm) FOR INTERMEDIATE SUPPORTS AND 8 1/2" (215mm) FOR SECTION SUPPORTS. SCARFING ONLY REQUIRED WHERE THE POLE TOP DIAMETER EXCEEDS 8 1/2" (215mm).
5. BRACINGS TO Y003X3105 REQUIRED ON ANGLE AND TERMINAL POLES ONLY.

POLE LENGTH METRES	POLE LENGTH FEET	DIM 'A'	DIM 'B'	DIM 'C'
UP TO 11.5	UP TO 38'-0"	19'-0"	2'-10"	4'-6"
12 - 13	40'-0" - 42'-0"	19'-0"	3'-4"	5'-0"
14	45'-0"	22'-0"	3'-10"	5'-6"
15	50'-0"	19'-0"	3'-10"	5'-6"
16		22'-0"	4'-4"	6'-0"
17	55'-0"	24'-0"	4'-4"	6'-0"
18	60'-0"	27'-0"	4'-10"	6'-6"
20		34'-0"	4'-10"	6'-6"
22		39'-0"	4'-10"	6'-6"

drawn J.A.
checked W.
date 11.4.69
scale 1/4" TO 1 FT.

HV OVERHEAD LINES SPEC. CE/C/37

POLE DETAILS FOR PORTAL SUPPORTS

A | TABLE AND NOTES
MODIFIED HEIGHT TO CODE 8

C

D

Yorkshire Electricity Board | Y003X3103