
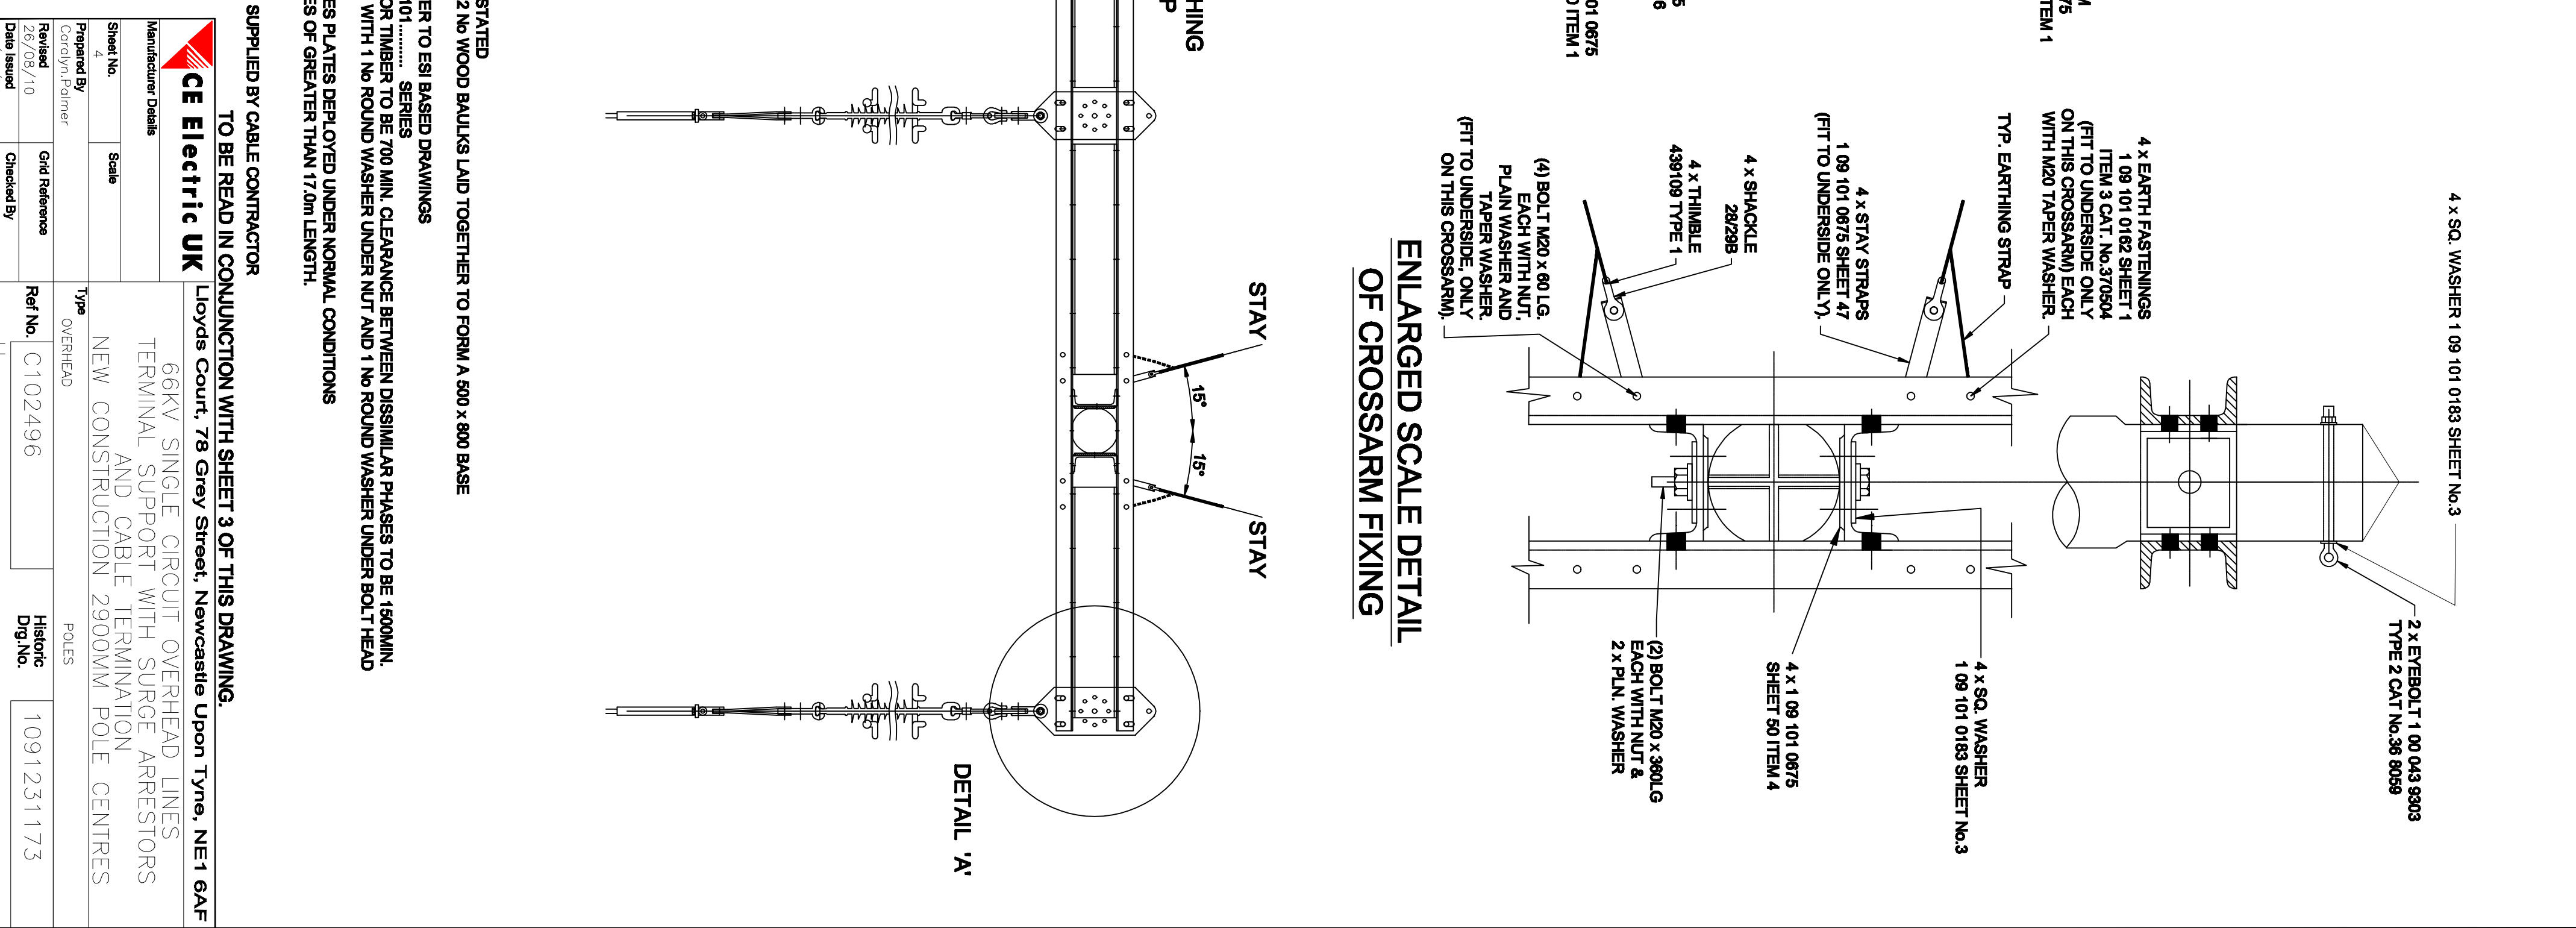
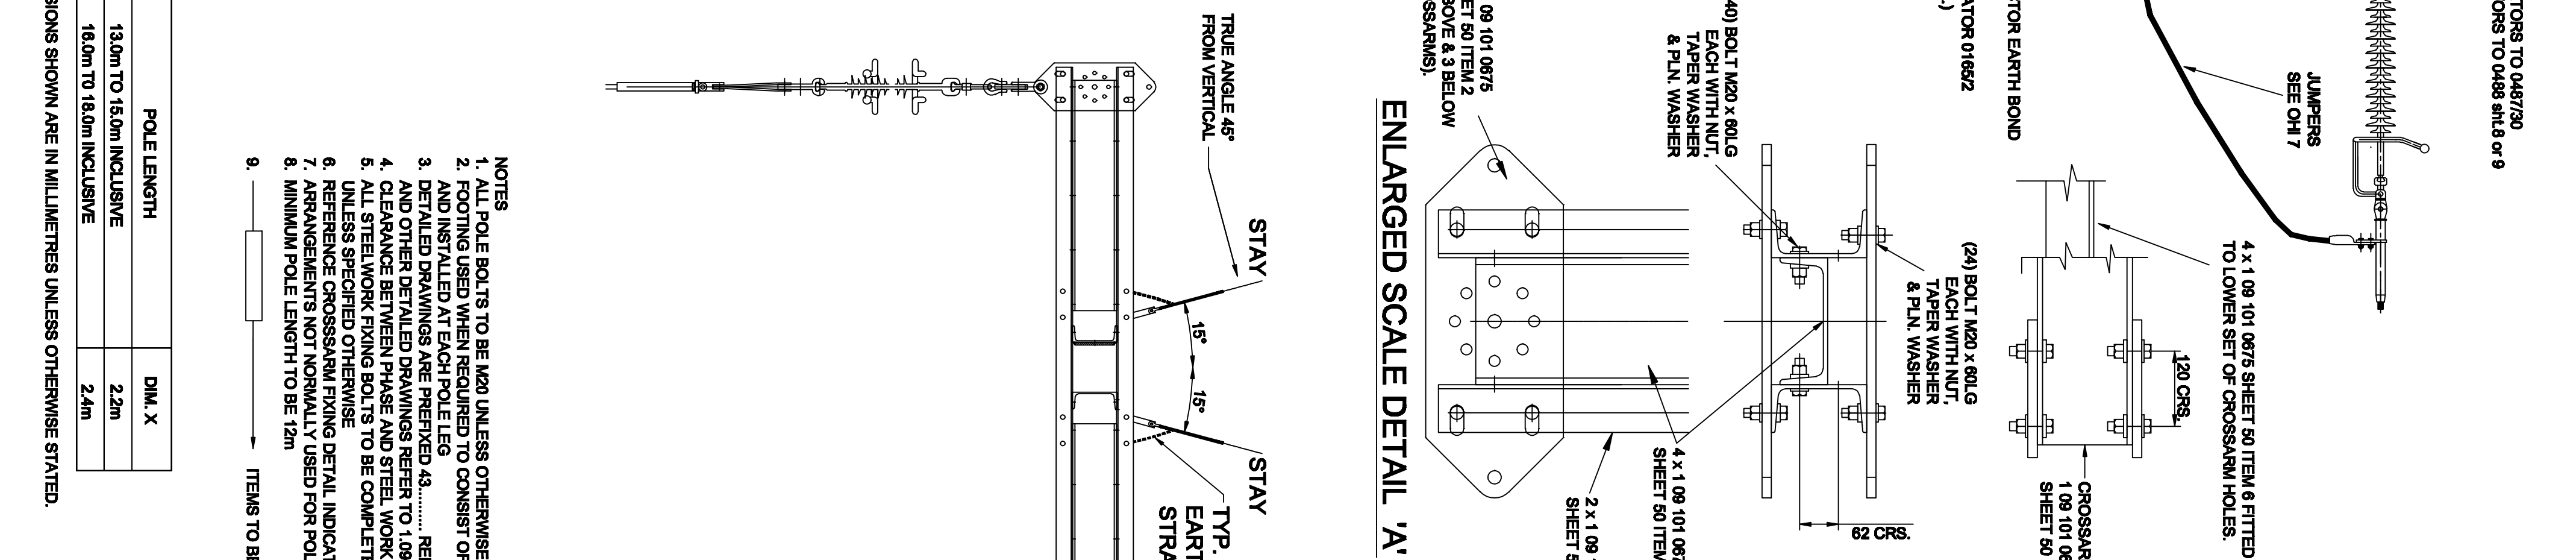
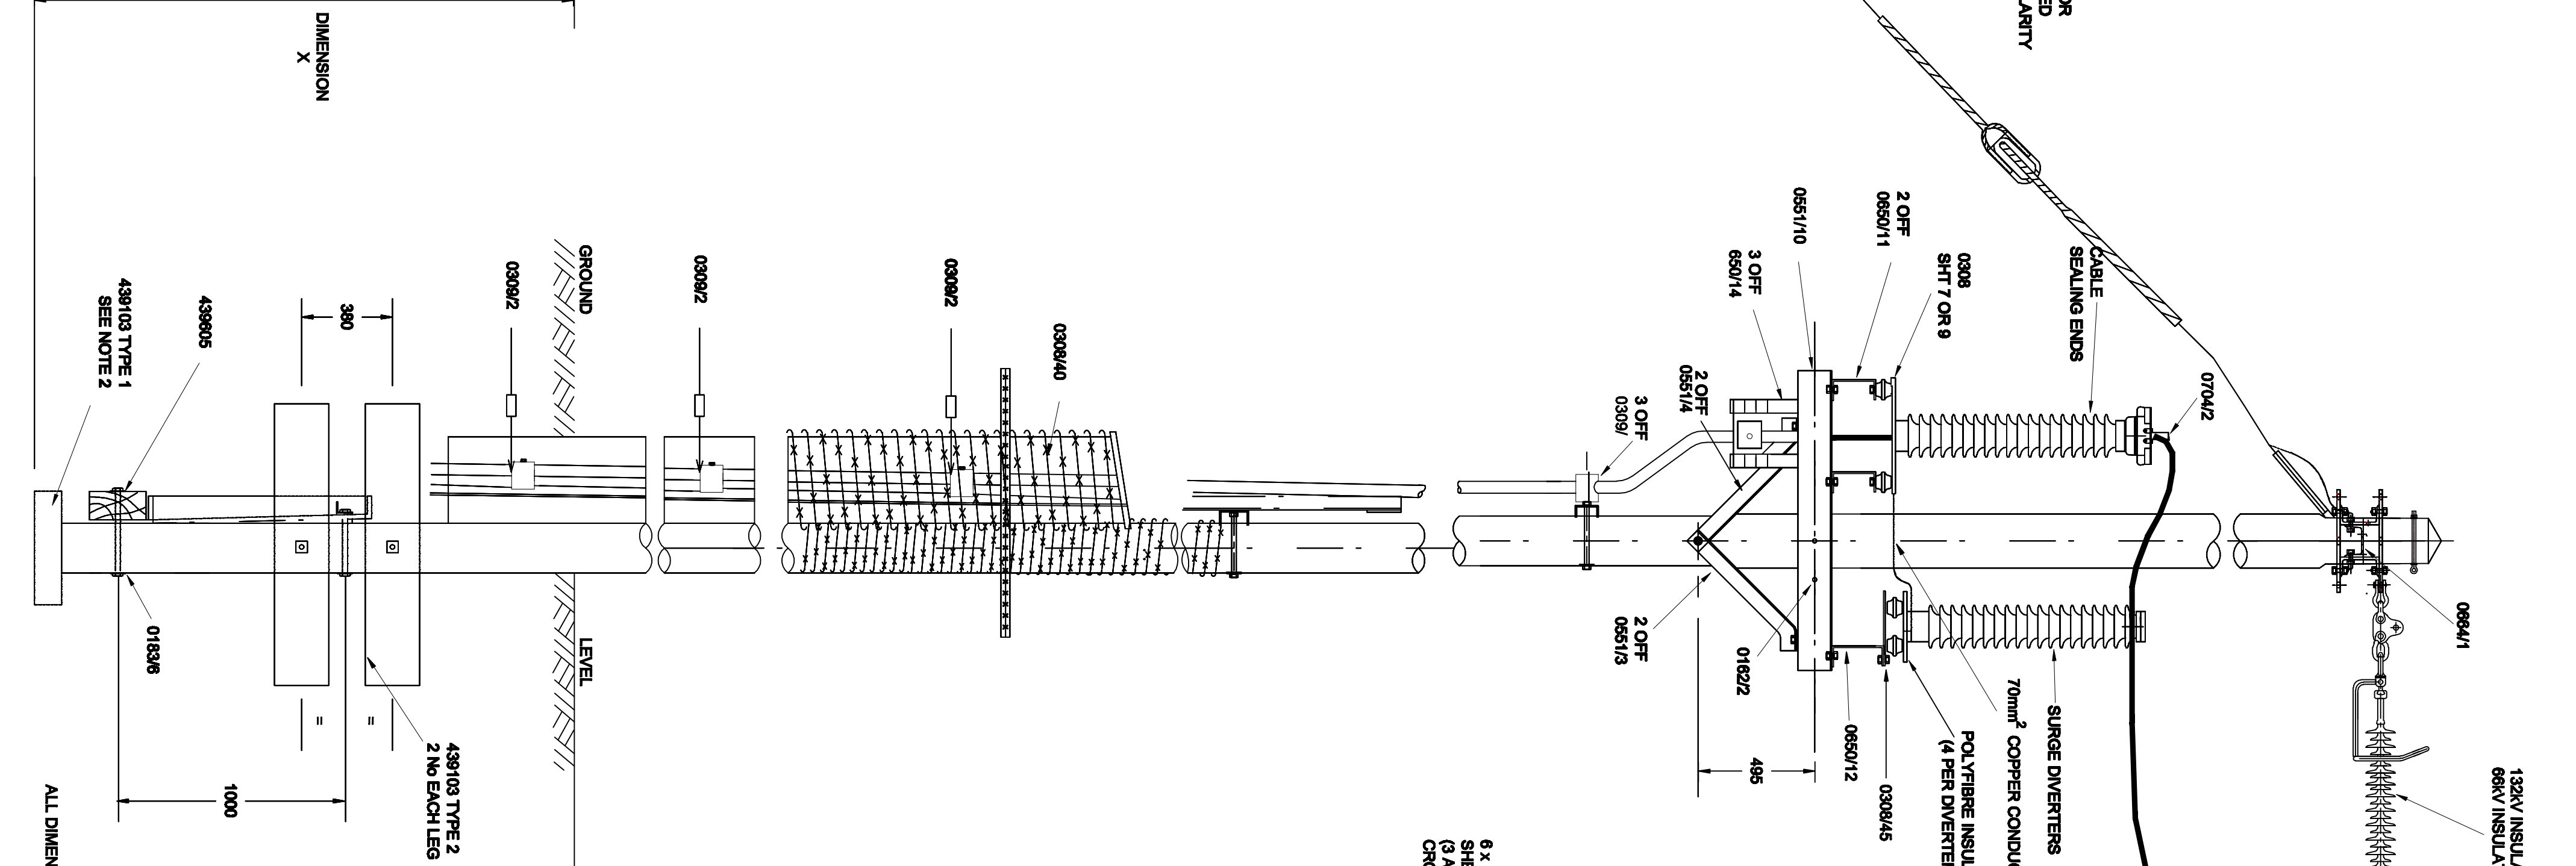


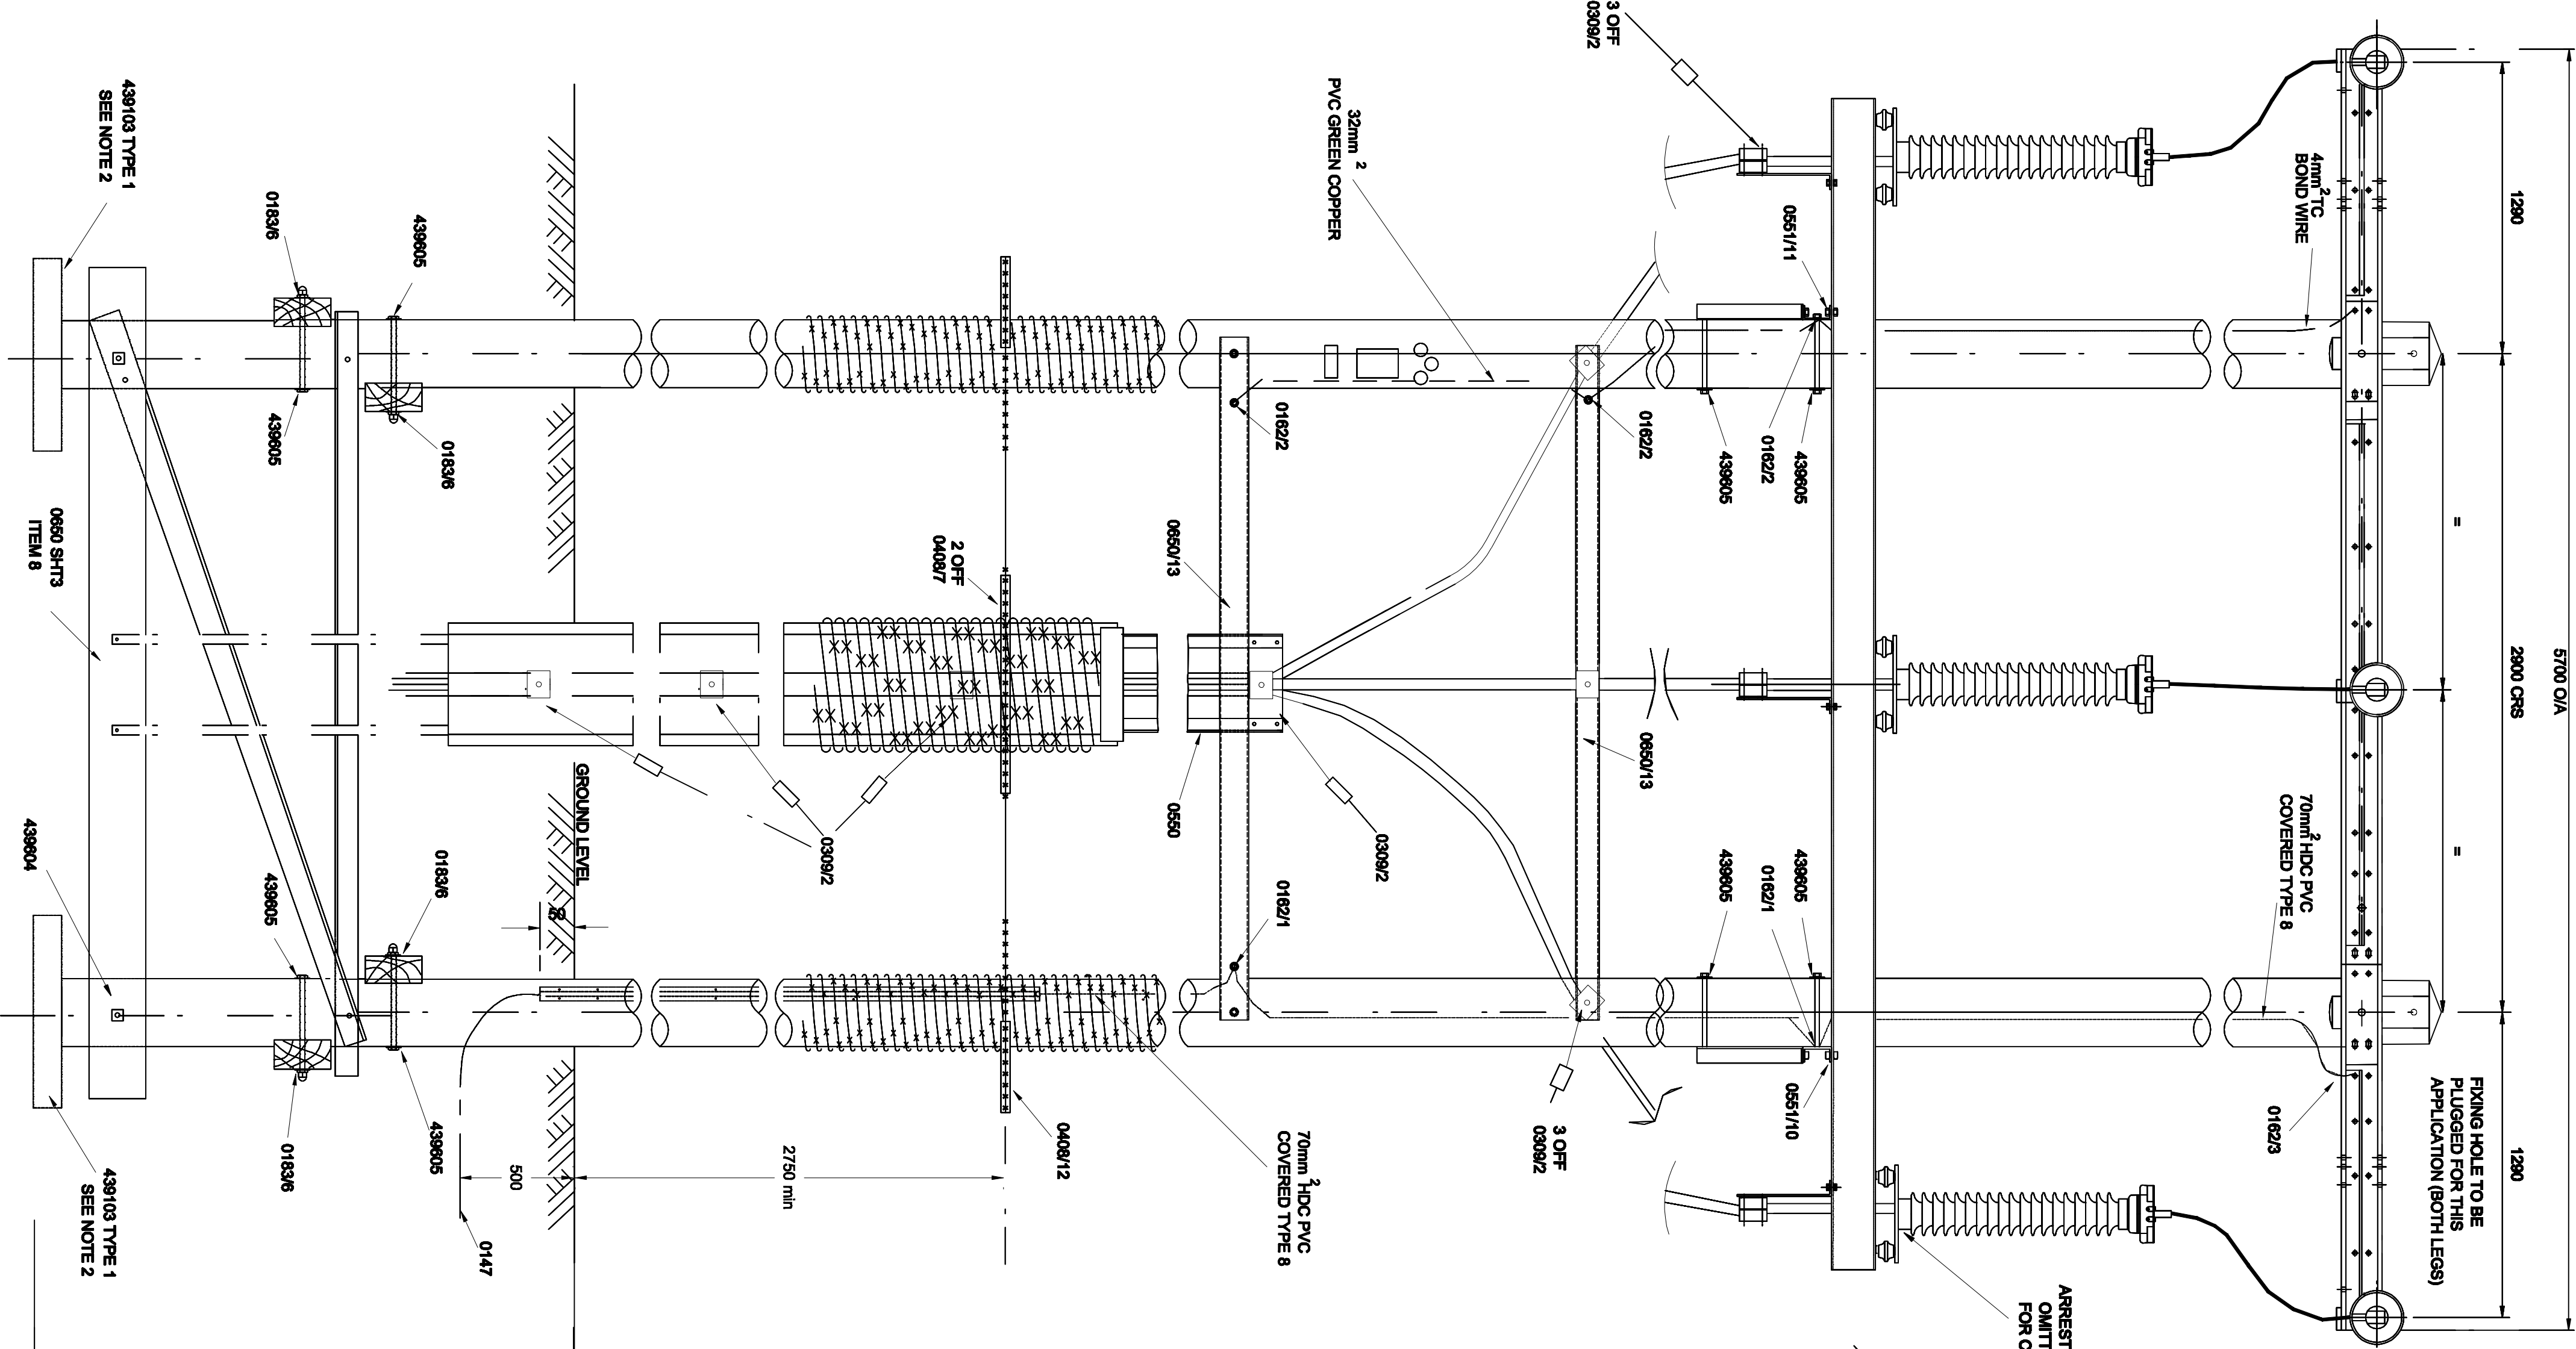

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FOOTING USED WHEN REQUIRED TO CONSIST OF 2 No WOOD BALKS LAID TOGETHER TO FORM A 600 x 800 BASE
 3. AND INSTALLED AT EACH POLE LEG
 4. DETAILED DRAWINGS ARE PREPARED AS..... REFER TO ESI BASED DRAWINGS
 5. ALL SURGE DETAIL DRAWINGS REFER TO 100 101..... SERIES
 6. ALL SURGE DETAIL DRAWINGS AND STEEL WORK ON TUBES TO BE 700 MIN. CLEARANCE BETWEEN DISSIMILAR PHASES TO BE 1600MM
 7. UNLESS SPECIFIED OTHERWISE
 8. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
 9. ARRANGEMENTS NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH
 10. MINIMUM POLE LENGTH TO BE 12m

POLE LENGTH	DIM. X
13.0m TO 16.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

TO BE READ IN CONJUNCTION WITH SHEET 3 OF THIS DRAWING.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details	Scale	66kV SINGLE CIRCUIT OVERHEAD LINES	
Sheet No.	Scale	TERMINAL SUPPORT WITH SURGE ARRESTORS	
Drawn By	Grid Reference	NEW CONSTRUCTION 2900MM POLE CENTRES	
Checked By	Revision	OVERHEAD	
Revised	Ref No.	C102496	
26/08/10	Notes	POLES	
12/10/00	History	Dwg No. 1091231173	