

1 No POST INSULATOR 0487/18

8 No M20 x 60 XOX WITH TAPER WASHER TO 0183/2


TIE RODS TO 439603/2

0652/1 2 OFF


70mm HD PVC FOR EARTHED STRUCTURE

TO 0146/2


SCALE 1:20

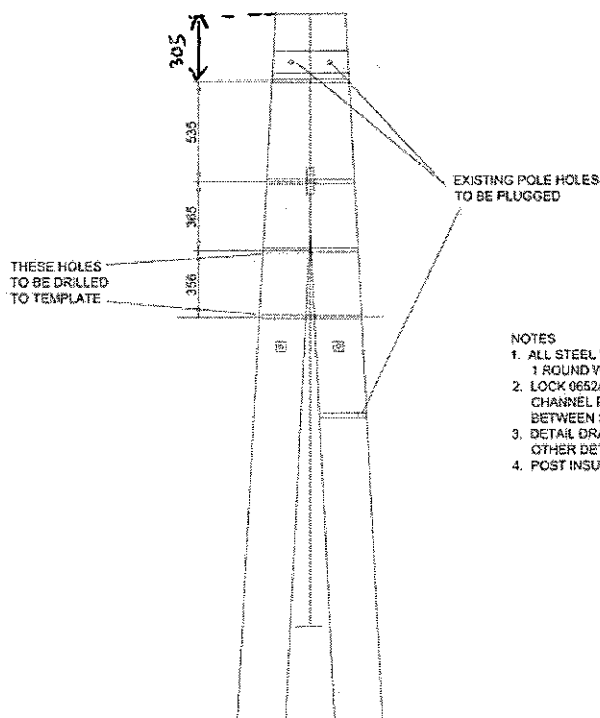


SCALE 1:20

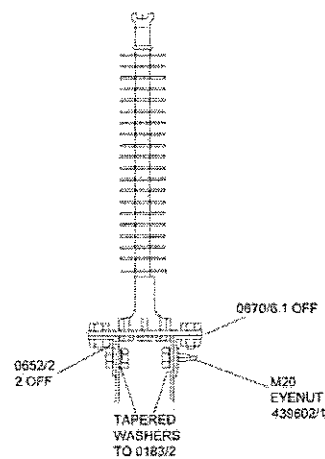

DETAIL 'A'
SCALE 1:20



DETAIL 'B'
SCALE 1:10

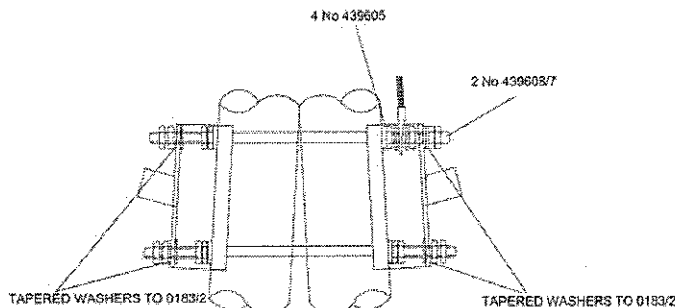

DETAIL 'C'
SCALE 1:10

NOTES

1. ALL STEEL WORK BOLTS TO BE COMPLETED WITH ONE ROUND WASHER UNDER NUT
1 ROUND WASHER UNDER BOLT HEAD EXCEPT WHERE SPECIFIED OTHERWISE.
2. LOCK 0652/7 ROTATED / FITTED TO LOCK TIE ROD BETWEEN CHANNEL SIDES WHILST MAINTAINING CHANNEL PLUMB AND CENTRAL ON POLE FACE. LOCK 0652/6 TO BE ROTATED FITTED TO LOCK TIE ROD BETWEEN 2 No M20 BOLTS WHILST PROVIDING LEVEL MOUNTING OF POLE ANGLES.
3. DETAIL DRAWINGS PREFIXED 43 REFER TO ESI DRAWINGS.
OTHER DETAIL DRAWINGS REFER TO 1.09.101. SERIES
4. POST INSULATOR FIXED WITH 4 No 5/8" x 1-1/2" UNC HIGH TENSILE BOLTS.

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		132KV OVERHEAD LINES 'A' POLE ARRANGEMENT OF INTERMEDIATE POLE STRUCTURE	
Sheet No. 3	Scale AS SHOWN	Type OVERHEAD	FILES
Prepared By J. R. R.	Checked By G. HAMMILL	Ref No. C102524	Historic Org. No. 1091380006
Revised 12/02/97	Date Issued 23/02/00	Revision 3	Notes