




NOTES

- ALL STEEL WORK BOLTS TO BE COMPLETED WITH ONE ROUND WASHER UNDER NUT
1 ROUND WASHER UNDER BOLT HEAD EXCEPT WHERE SPECIFIED OTHERWISE.
- LOCK 0652/7 ROTATED / FITTED TO LOCK TIE ROD BETWEEN CHANNEL SIDES WHILST MAINTAINING CHANNEL PLUMB AND CENTRAL ON POLE FACE. LOCK 0652/6 TO BE ROTATED FITTED TO LOCK TIE ROD BETWEEN 2 No M20 BOLTS WHILST PROVIDING LEVEL MOUNTING OF POLE ANGLES.
- DETAIL DRAWINGS PREFIXED 43 REFER TO ESI DRAWINGS.
OTHER DETAIL DRAWINGS REFER TO 1.09.101. SERIES
- POST INSULATOR FIXED WITH 4 No 5/8" x 1-1/2" UNC HIGH TENSILE BOLTS.

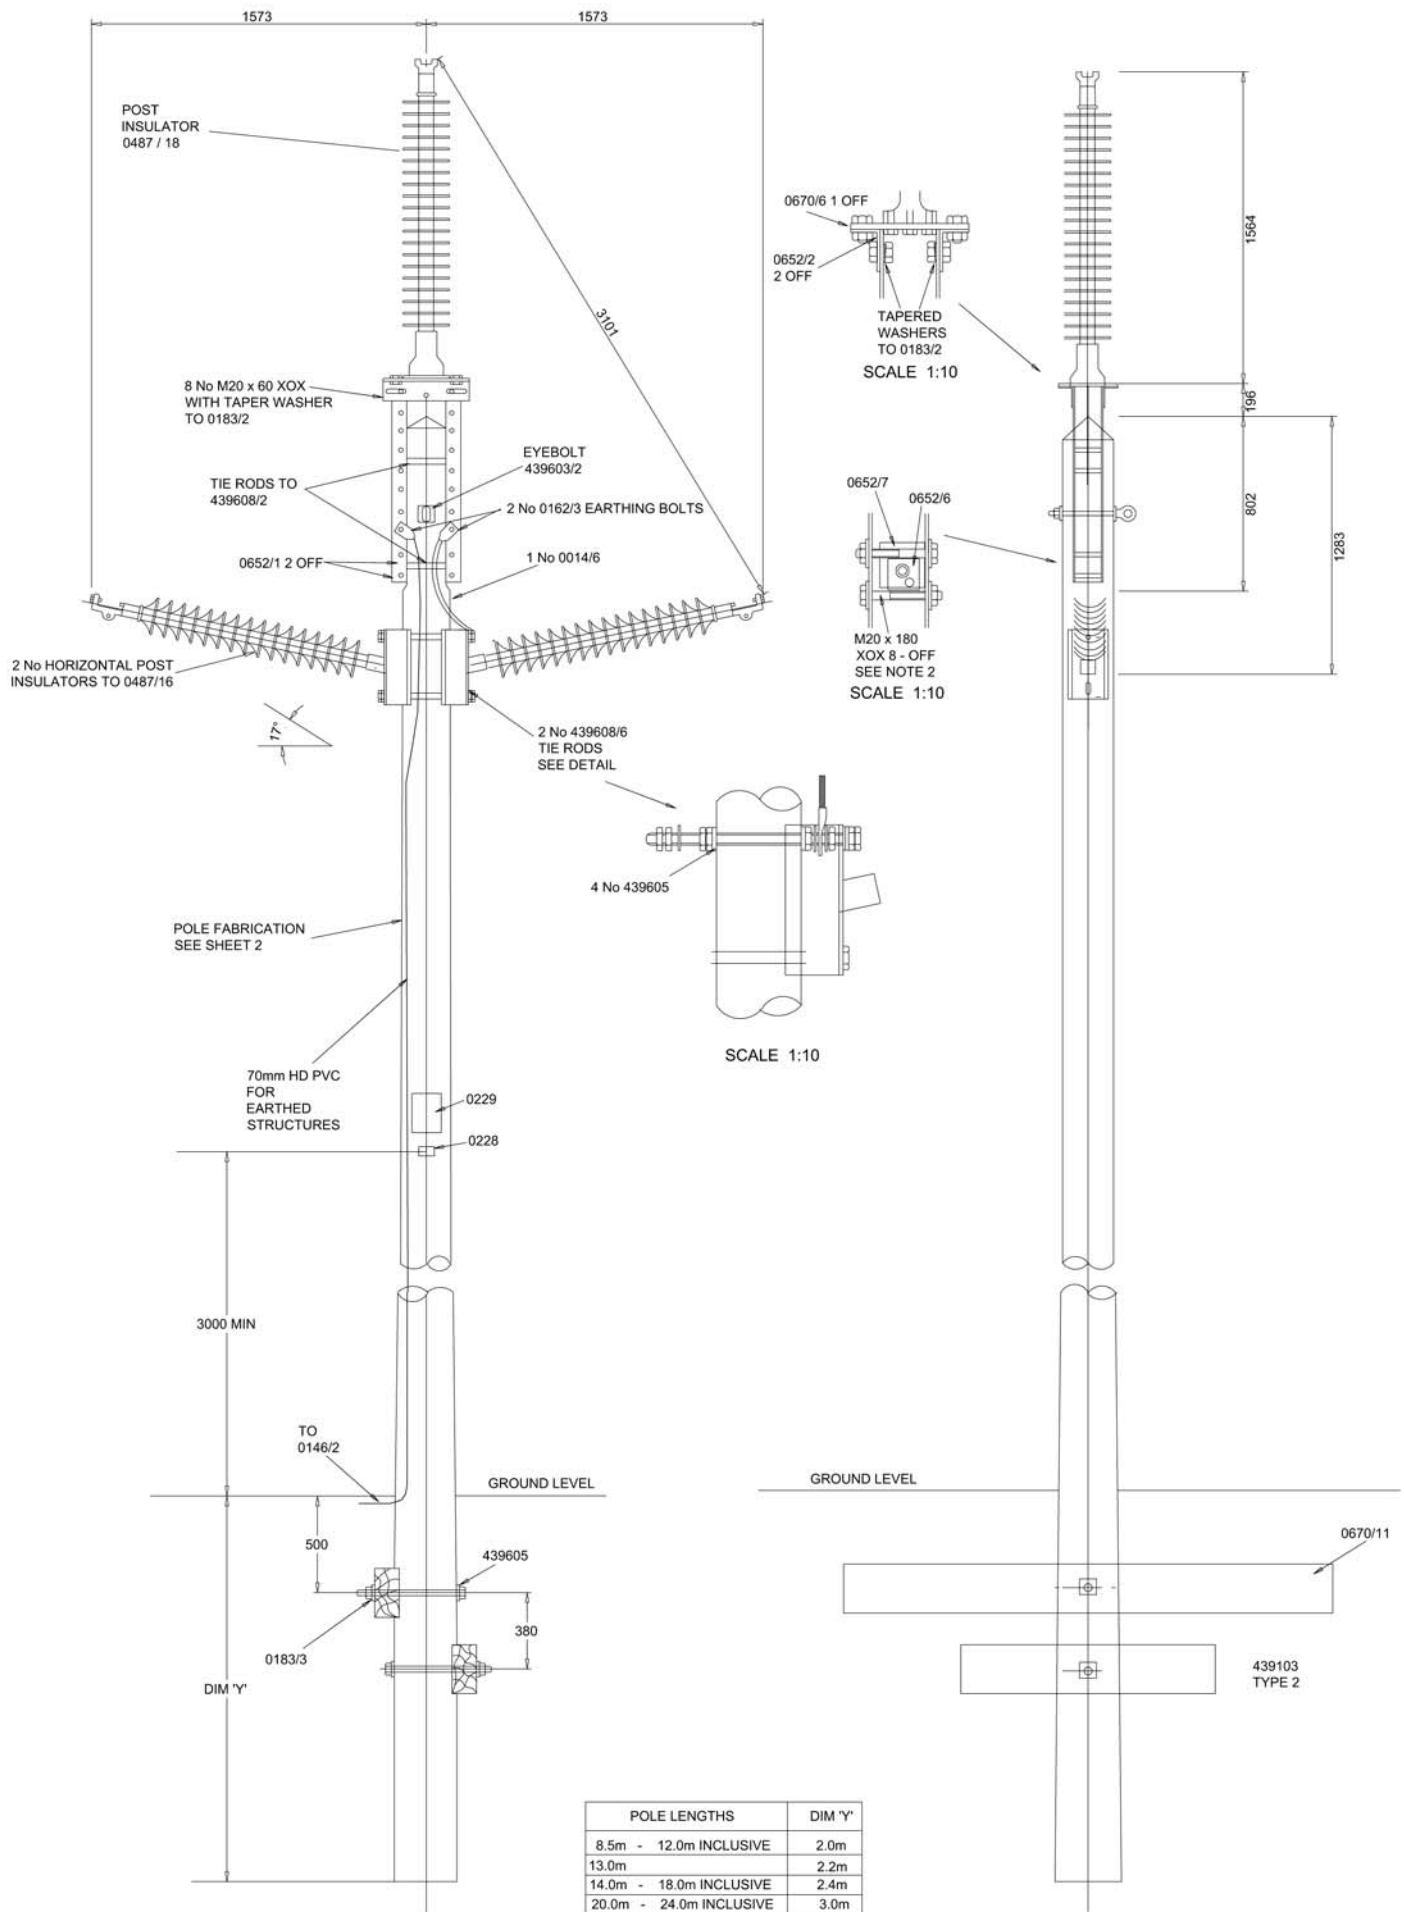

Manufacturer Details

Sheet No. 1 Scale 1:20

Prepared By Andrew Turnbull

Revised 21/11/08 Grid Reference

Date Issued 18/02/00 Checked By G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

132KV SINGLE CIRCUIT LINES

SINGLE POLE INTERMEDIATE STRUCTURE

Type OVERHEAD POLES

Ref No. C102522 Historic Drg. No. 1091380006

Revision C Notes