
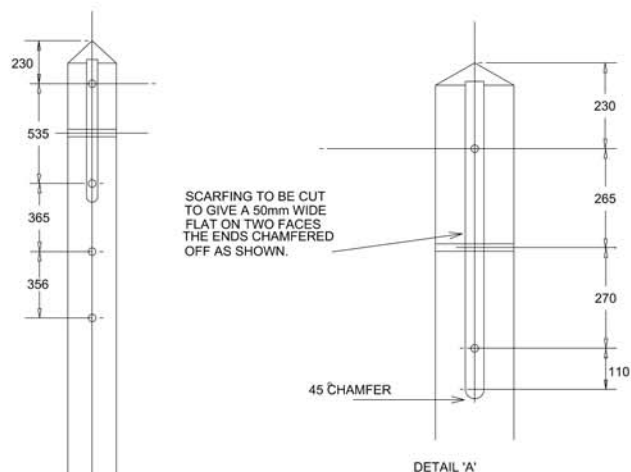


THESE HOLES TO BE DRILLED TO TEMPLATE FROM THIS SIDE OF POLE

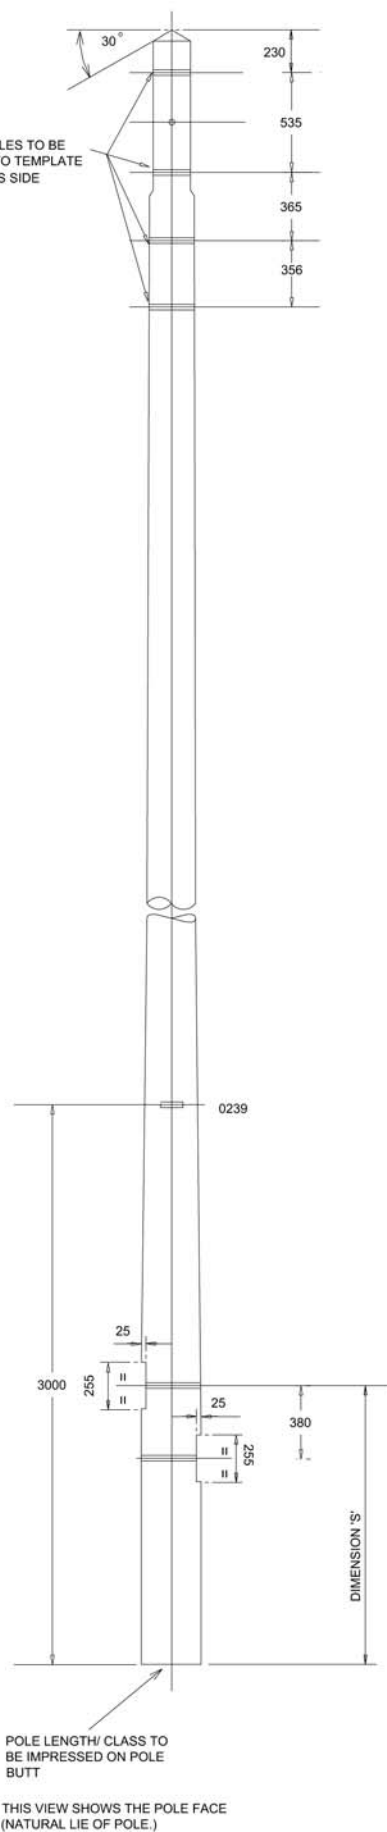

NOTES

1. CLASS OF POLE TO BE 'STOUT' OR EXTRA STOUT IN ACCORDANCE WITH 1.09.101.0238
2. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE
3. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING
4. POLE TO BE NOTCHED AND DRILLED FOR
1 x 250 x 125 x 2500 AND
1 x 250 x 125 x 1300 LONG BAULKS
5. EXTRA STOUT POLES TO BE NORMALLY FITTED WITH DOUBLE BAULKS. EXTRA STOUT POLES DESIGNED TO INCREASE WIND SPANS MAY BE UNSUITABLE FOR POOR GROUND CONDITIONS. SEE SPECIFICATION.

POLE LENGTH	DIM. 'S'
8.5m - 12m INCLUSIVE	1.5
13.0m	1.7
14.0m - 18.0m INCLUSIVE	1.9
20.0m - 24m INCLUSIVE	2.5

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

CE Electric UK	
Manufacturer Details	
Sheet No. 2	Scale 1:20
Prepared By Andrew Turnbull	
Revised 21/11/08	Grid Reference
Date Issued 08/11/99	Checked By M MOODY

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR SINGLE INTERMEDIATE POLE ARRANGEMENT	
Type OVERHEAD	POLES
Ref No. C102523	Historic Drg. No. 1091380006
Revision	Notes