


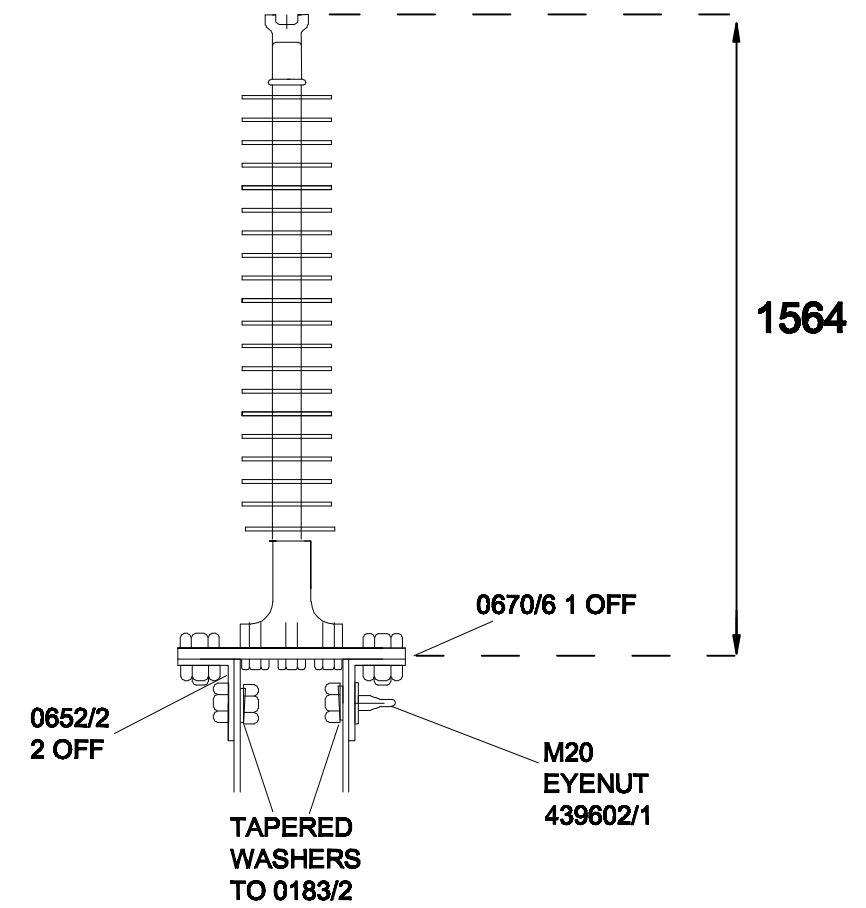
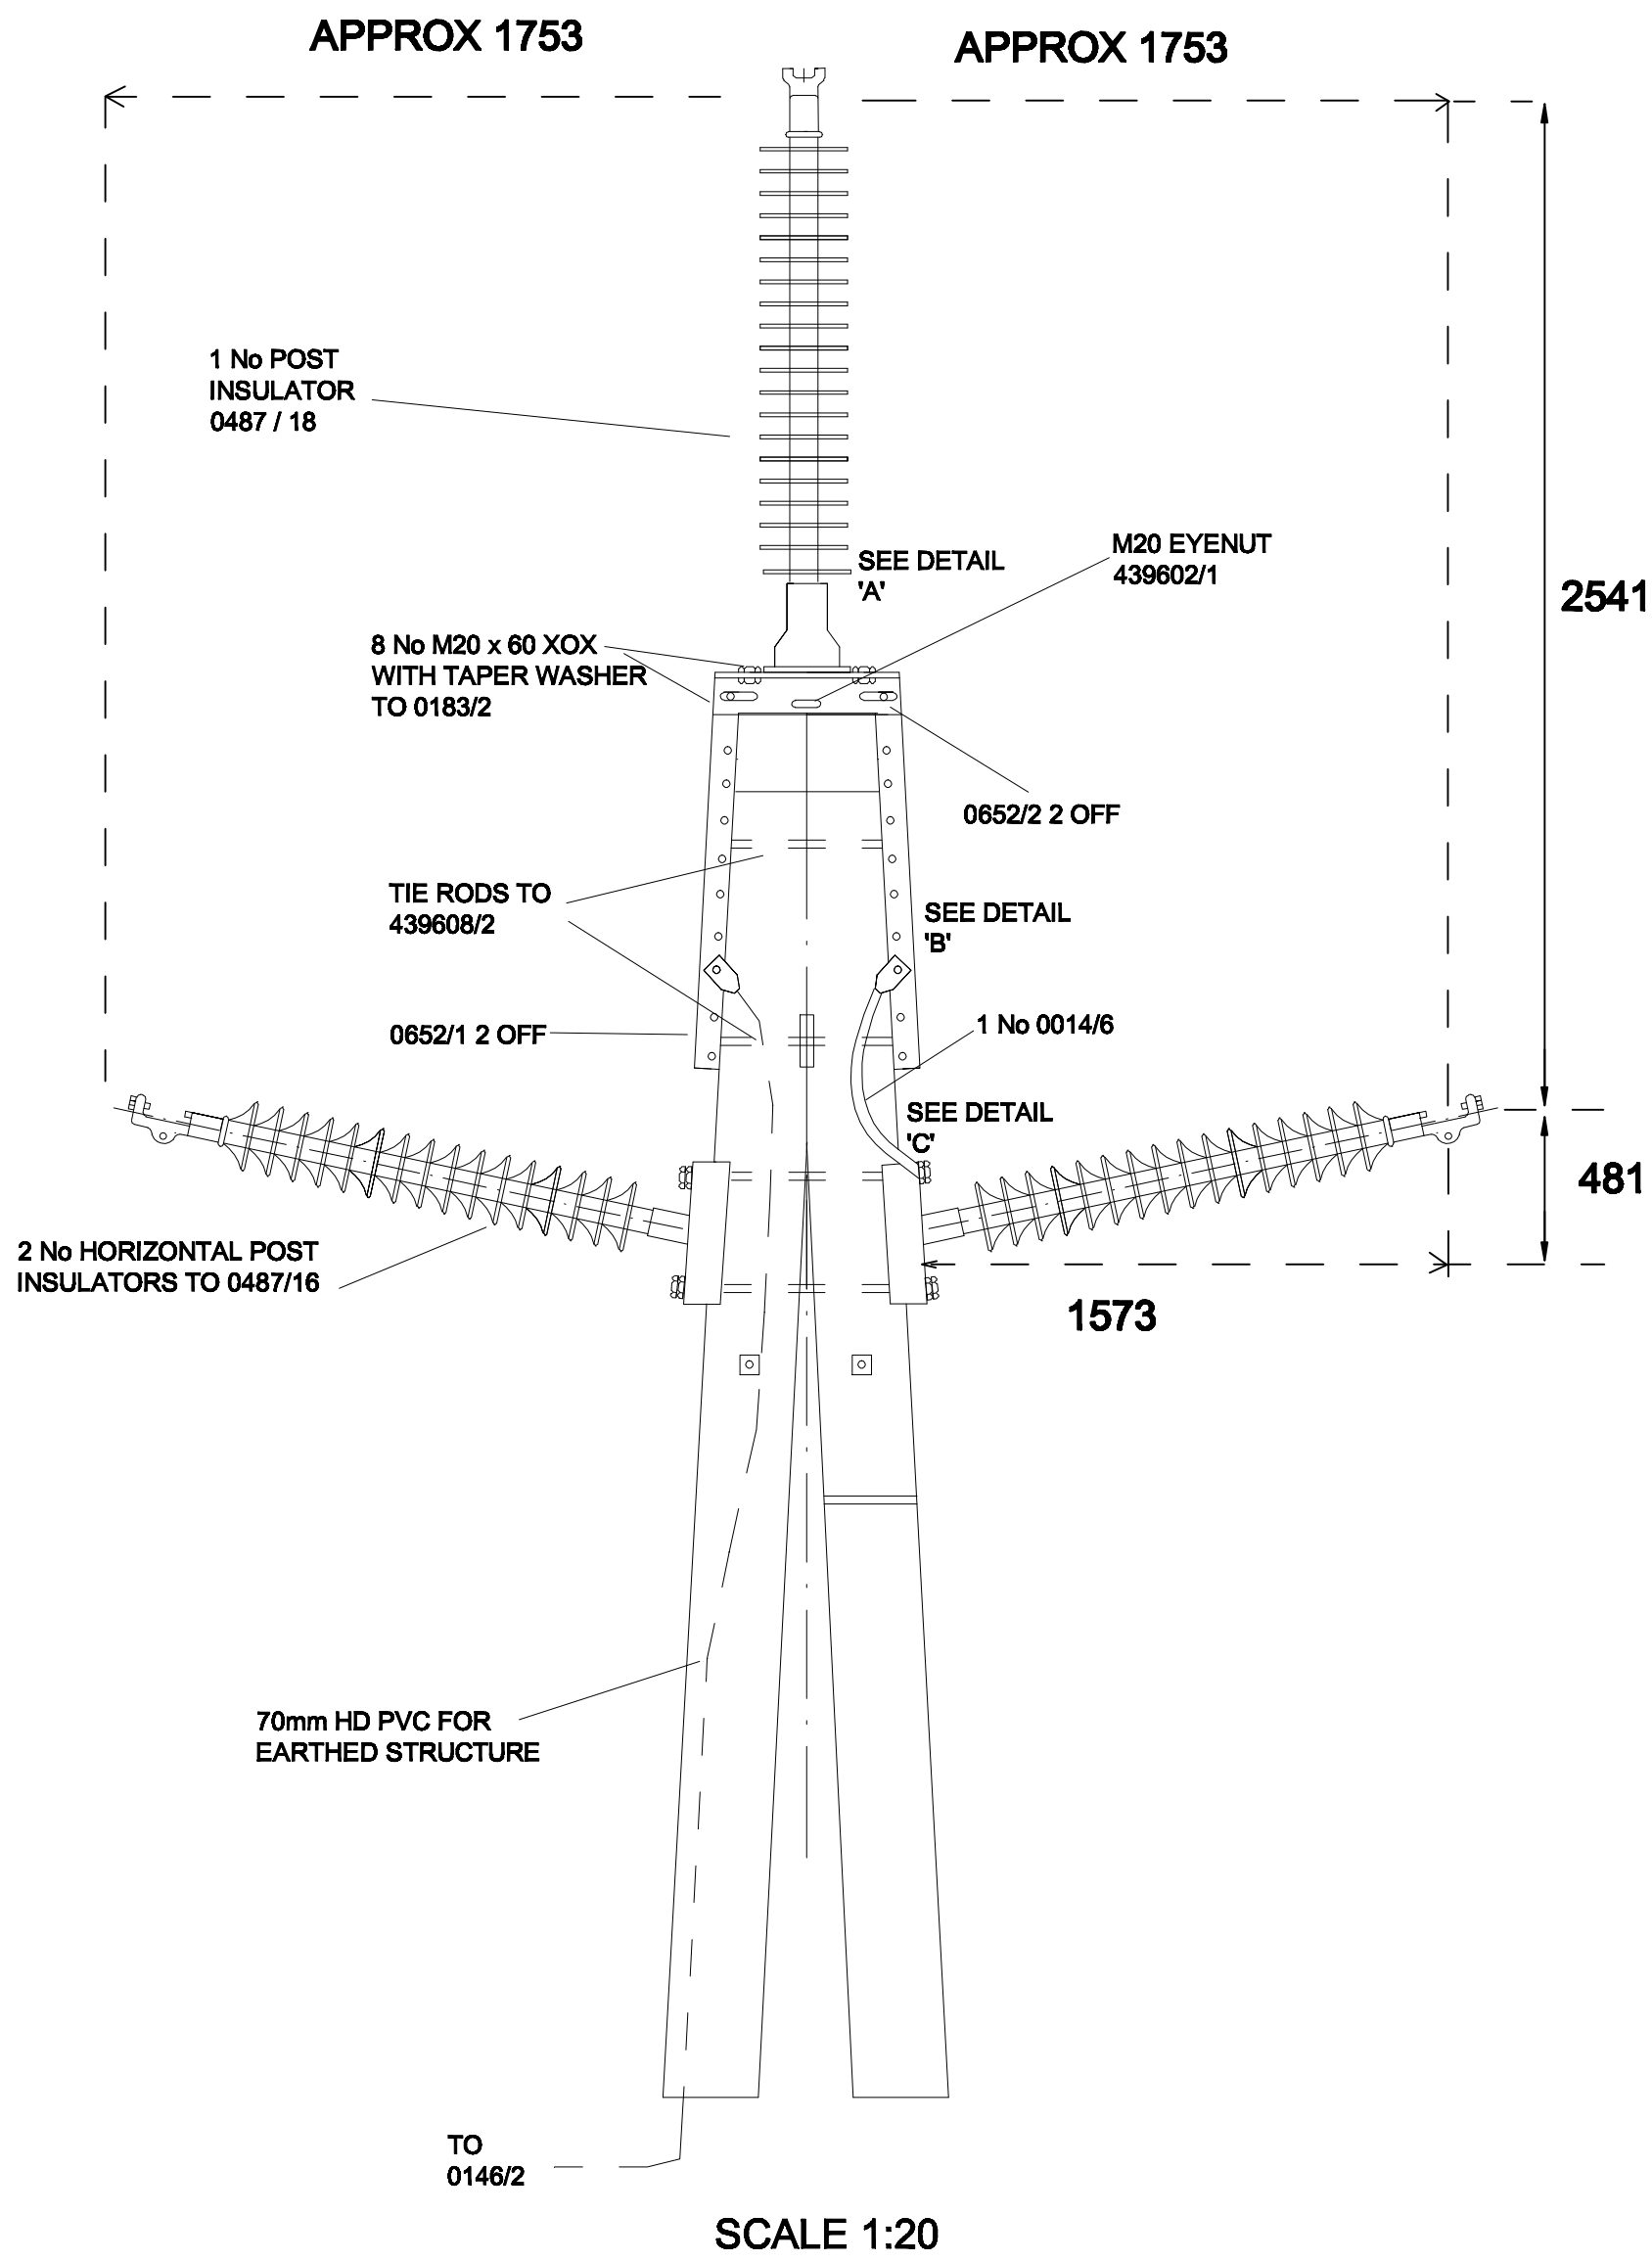


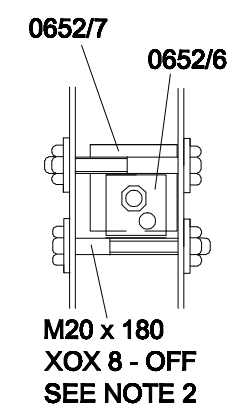

DETAIL 'A'
SCALE 1:20

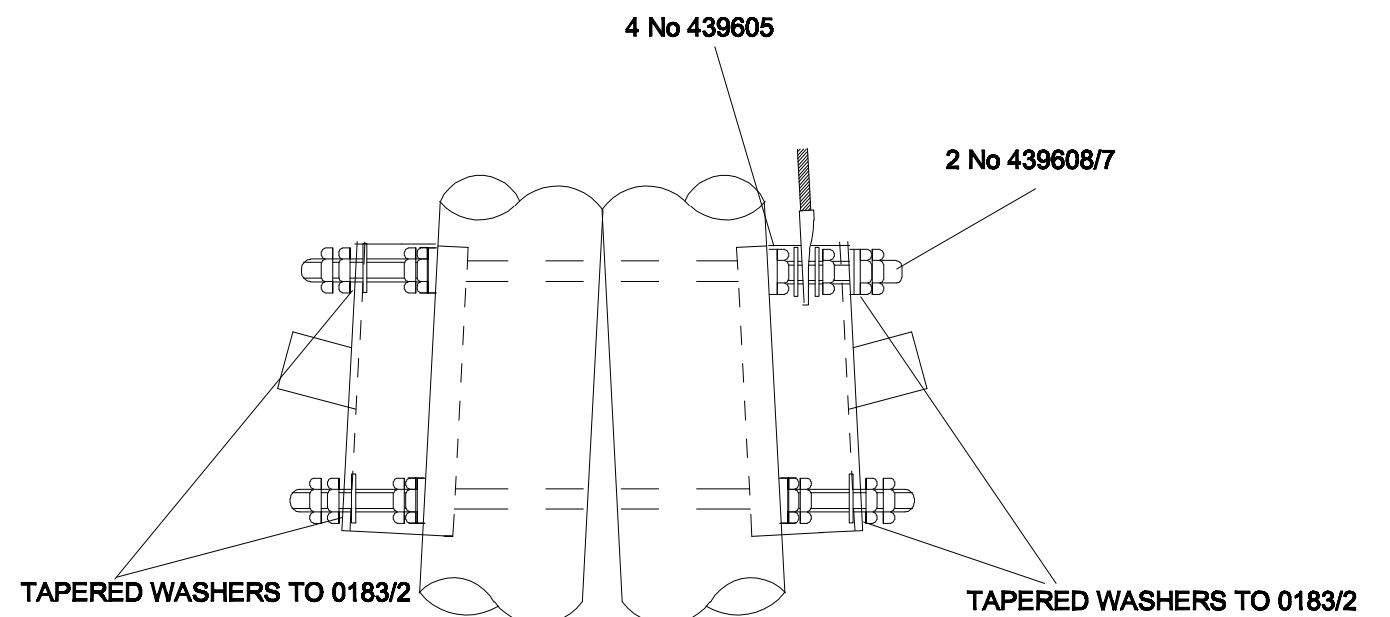

DETAIL 'B'
SCALE 1:10

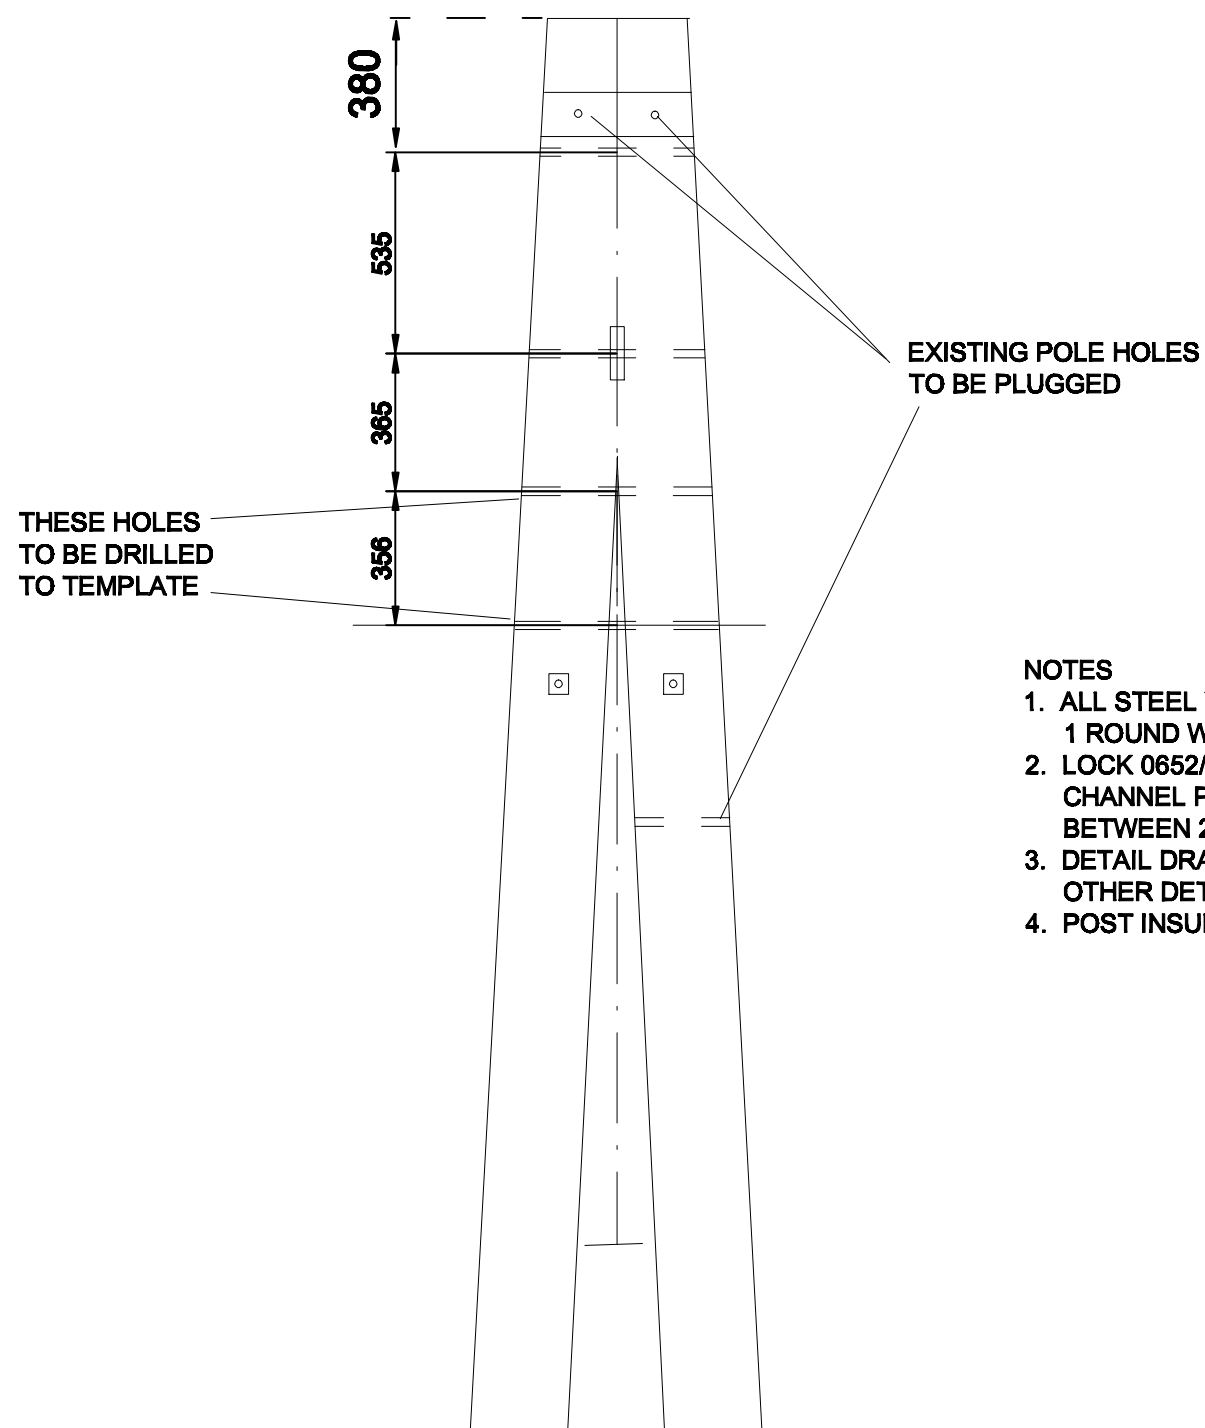

DETAIL 'C'
SCALE 1:10

NOTES

1. ALL STEEL WORK BOLTS TO BE COMPLETED WITH ONE ROUND WASHER UNDER NUT
1 ROUND WASHER UNDER BOLT HEAD EXCEPT WHERE SPECIFIED OTHERWISE.
2. LOCK 0652/7 ROTATED / FITTED TO LOCK TIE ROD BETWEEN CHANNEL SIDES WHILST MAINTAINING CHANNEL PLUMB AND CENTRAL ON POLE FACE. LOCK 0652/6 TO BE ROTATED FITTED TO LOCK TIE ROD BETWEEN 2 No M20 BOLTS WHILST PROVIDING LEVEL MOUNTING OF POLE ANGLES.
3. DETAIL DRAWINGS PREFIXED 43 REFER TO ESI DRAWINGS.
OTHER DETAIL DRAWINGS REFER TO 1.09.101. SERIES
4. POST INSULATOR FIXED WITH 4 No 5/8" x 1-1/2" UNC HIGH TENSILE BOLTS.

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132KV OVERHEAD LINES 'A' POLE ARRANGEMENT OF INTERMEDIATE POLE STRUCTURE	
Manufacturer Details		Type	POLES
Sheet No. 3	Scale AS SHOWN	Ref No.	C102524
Prepared By Pauline.Moore	Grid Reference	Historic Drg.No.	1091380006
Revised 06/05/10	Checked By G HAMMEL	Revision	C Notes
Date Issued 23/02/00			