


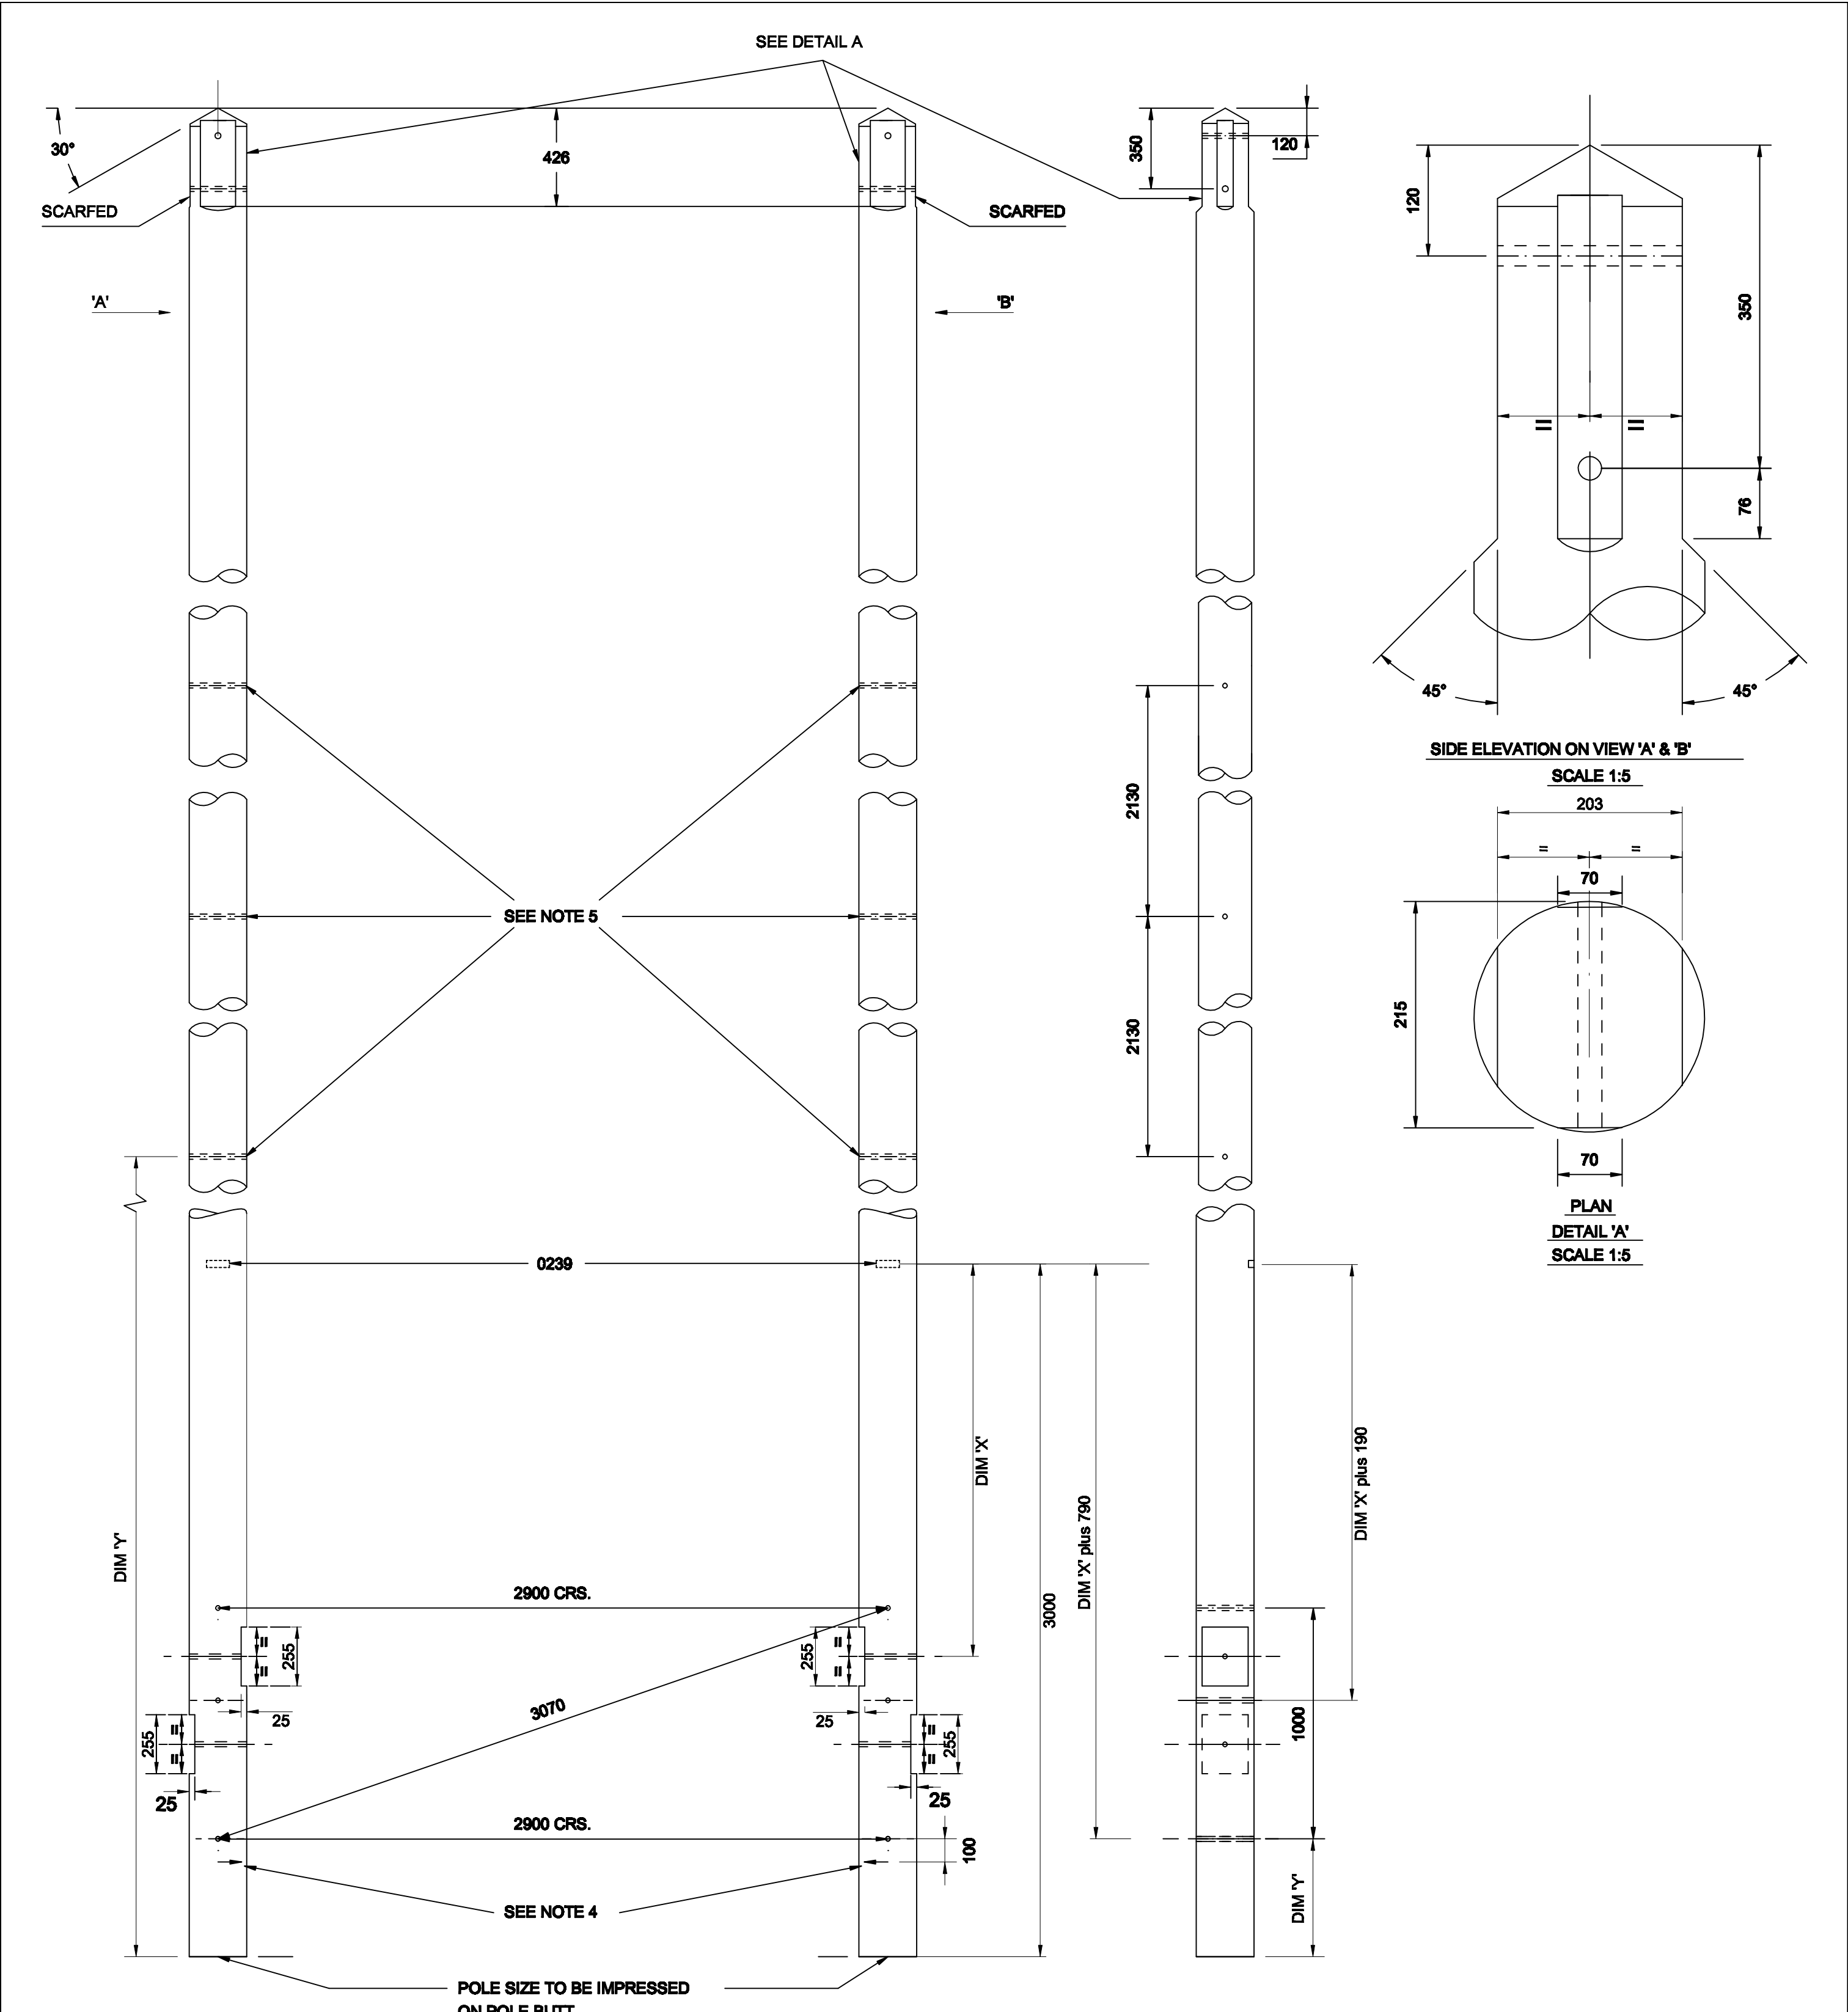

NOTES

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION E/STOUT – 250mm.
- HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE-LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
- POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
- 50x6x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.
- 'H' POLES 18.0m AND OVER TO BE SUPPLIED COMPLETE WITH A DOUBLE PANEL OF CROSSBRACING TO DRG.No. 1.09.101.0129.

All dimensions shown are in millimetres unless stated otherwise

POLE LENGTH. (m)	DIM. 'X' (mm)	DIM. 'Y' (mm)
9.0 - 11 INCLUSIVE.	1900	-
12.0	1700	-
13 - 15 INCLUSIVE.	1400	-
16 - 18 INCLUSIVE.	1100	7955
20	500	

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR LARGE ANGLE 'H' POLE STRUCTURE			
Sheet No. 2	Scale 1:20				
Prepared By Janis.Webb		Type OVERHEAD	STANDARDS		
Revised 14/08/07	Grid Reference	Ref No.	C949778	Historic Drg.No.	1091390018
Date Issued 03/07/07	Checked By G HAMMEL	Revision C	Notes		