
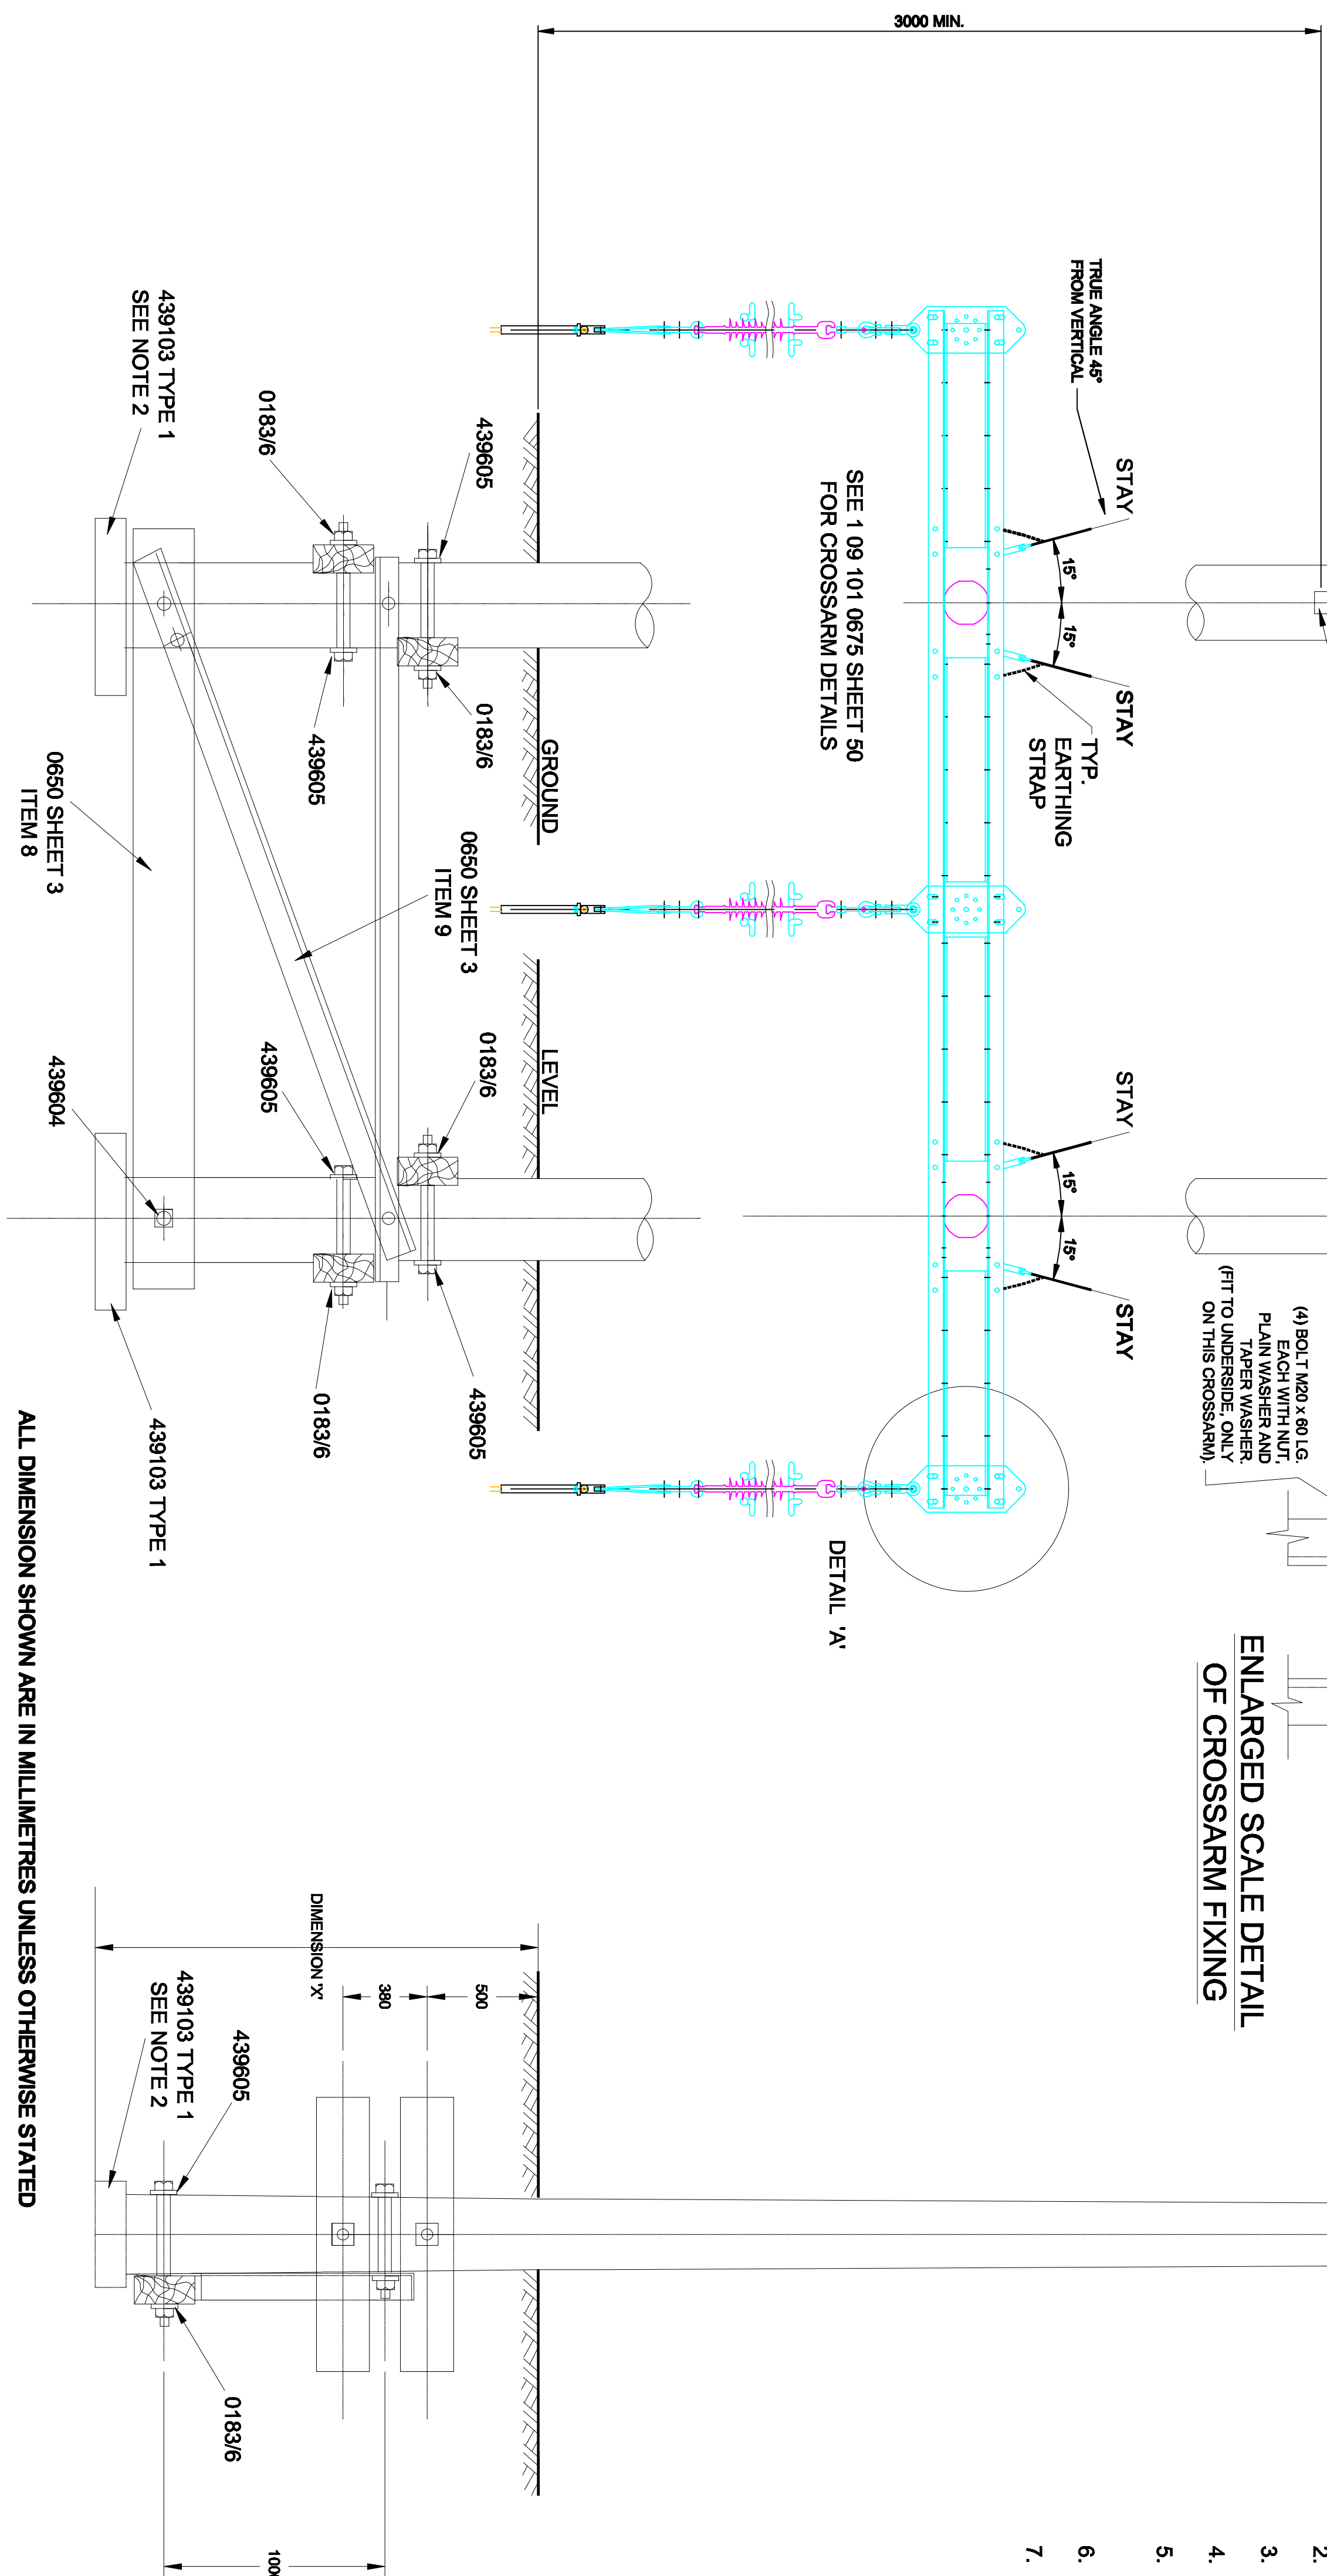


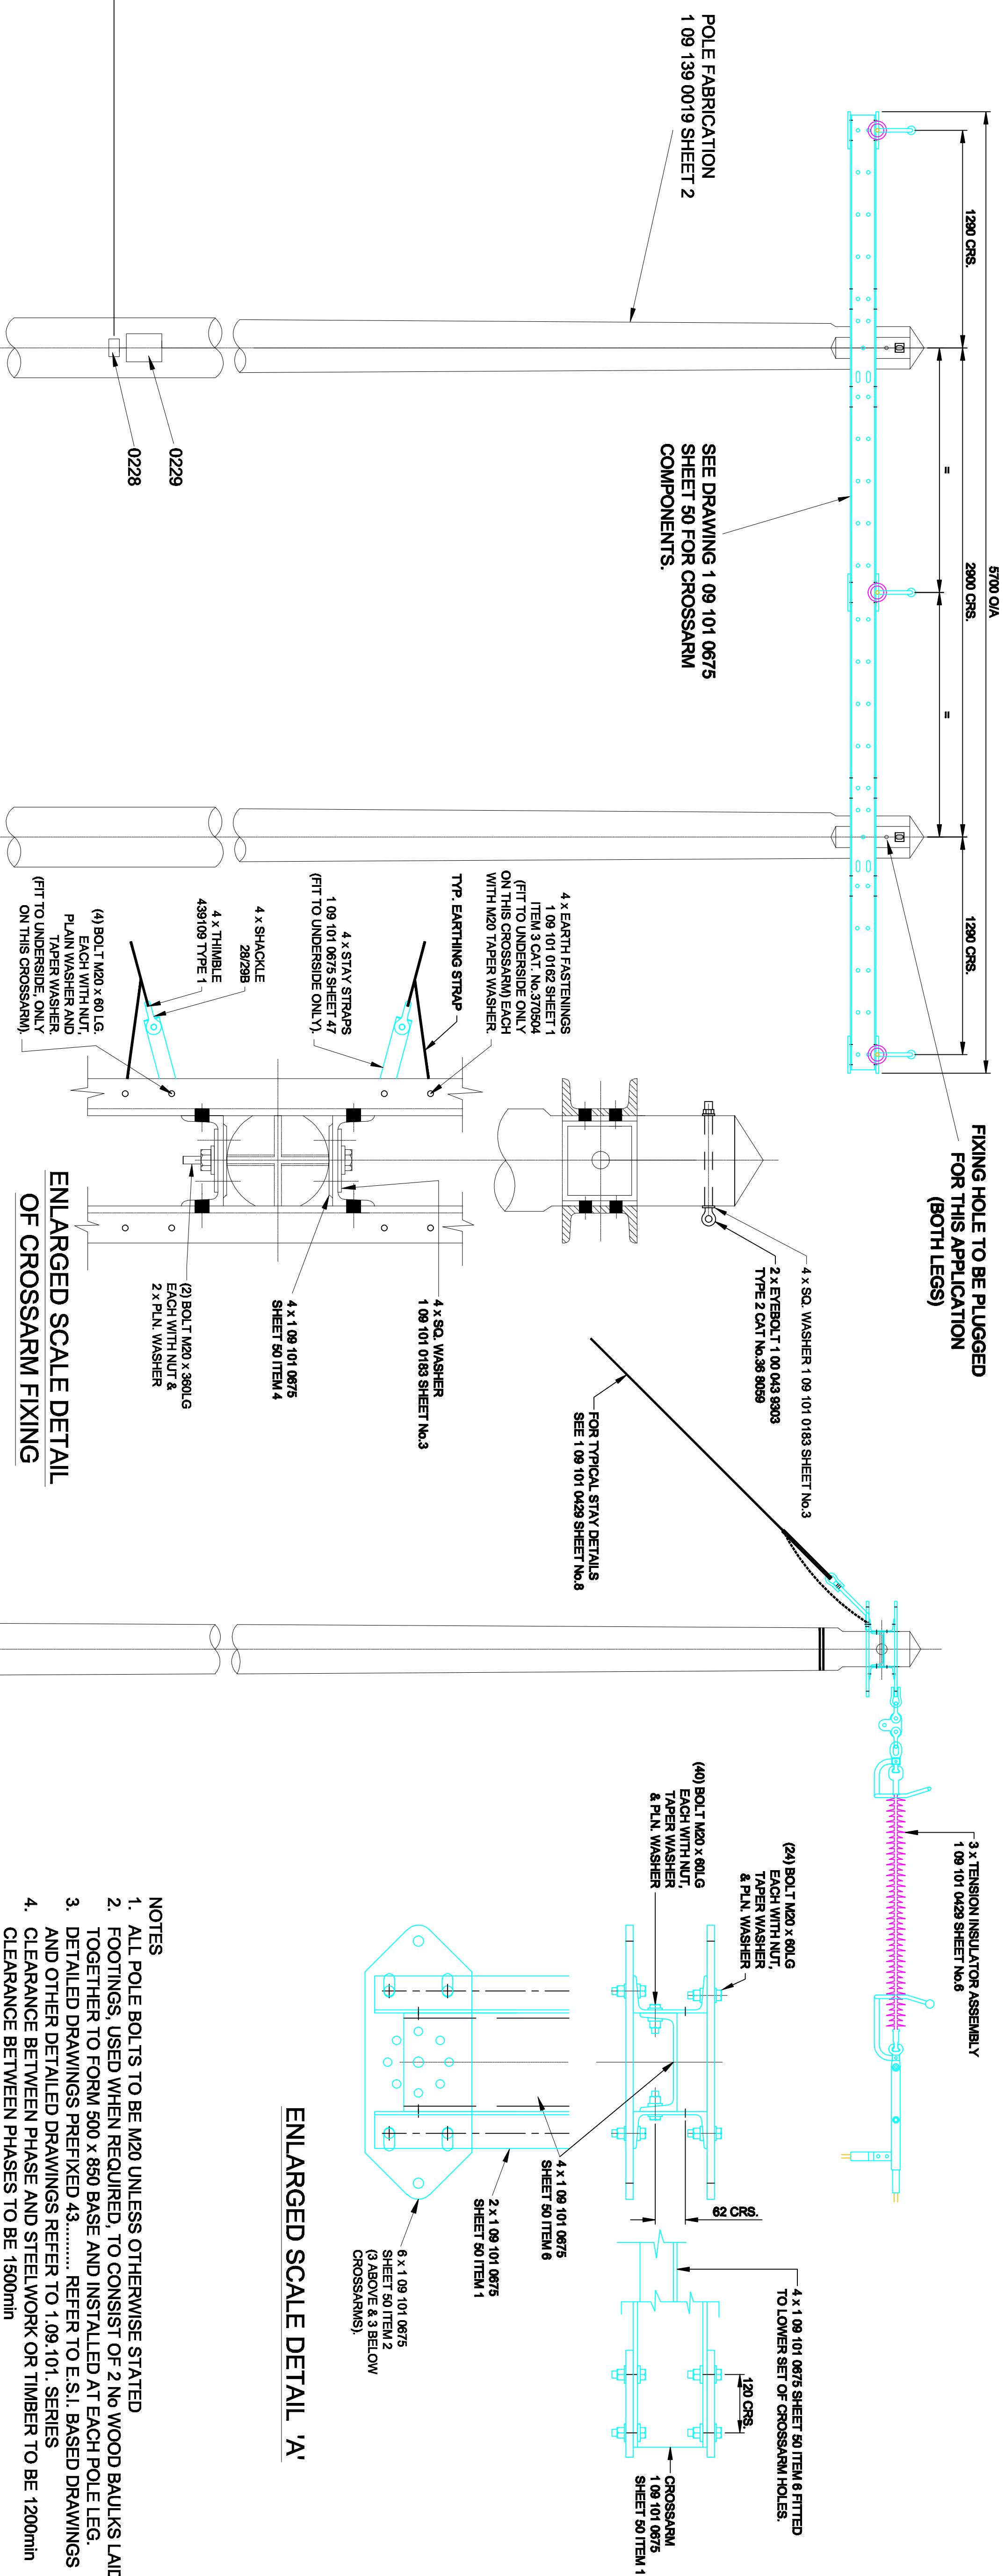

- NOTES**
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 NO WOOD BAULKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
 3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
 4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 1200mm
 5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No ROUND WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE
 6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
 7. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

WORK SPEC No 04/226

 CE Electric UK		Lloyd's Court, 76 Grey Street, Newcastle Upon Tyne, NE1 6AT 132KV SINGLE CIRCUIT OVERHEAD LINES TERMINAL STRUCTURE 2.9 METRE CENTRE	
Manufacturing Details			
Sheet No.	Scale		
Prepared By Barbara Simpson	N.T.S.		
Reviewed S.D.W./M	Grid Reference		
Drawn D.W./M	Checked By G HANVEL		
Revision			
Type OVERHEAD		Standards Historic Dwg. No. 1091390019	
Ref No. C948/779		Notes	