
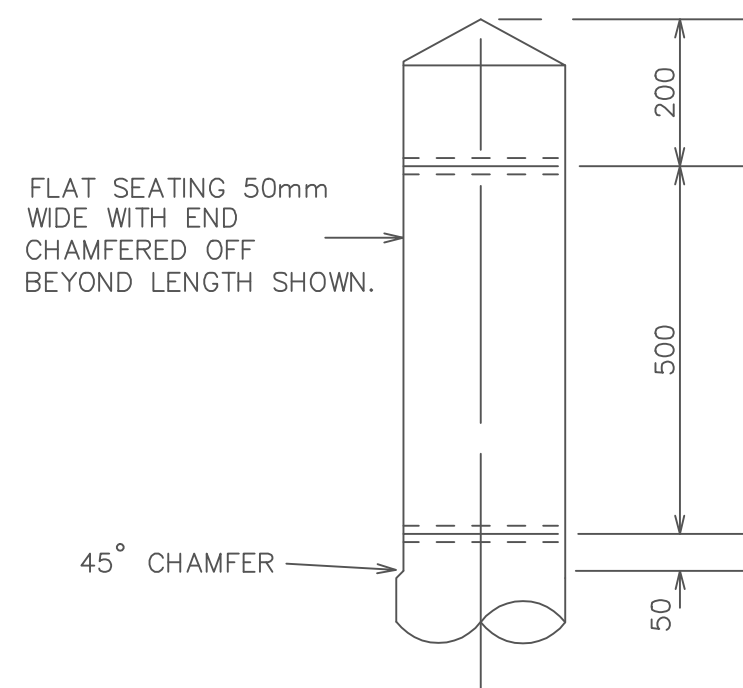
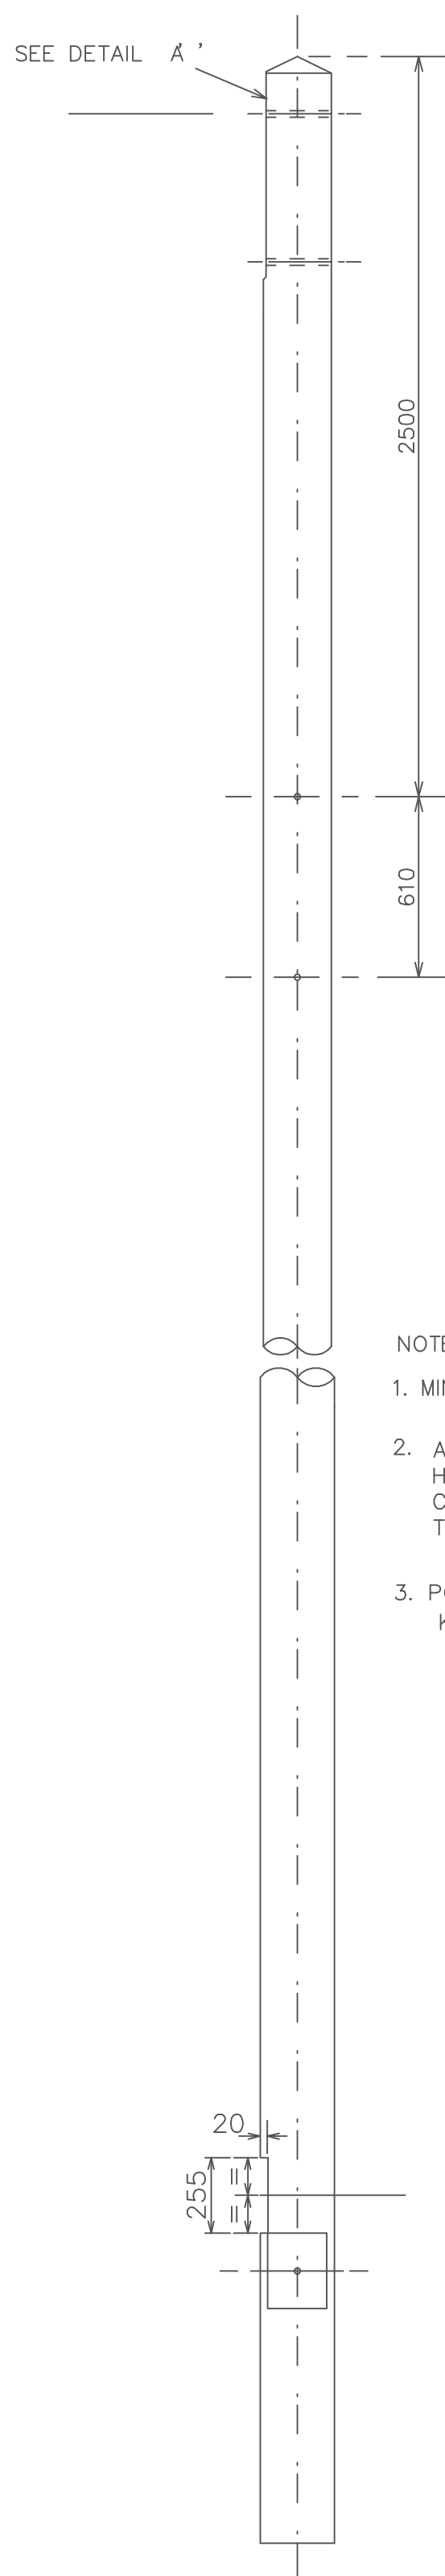


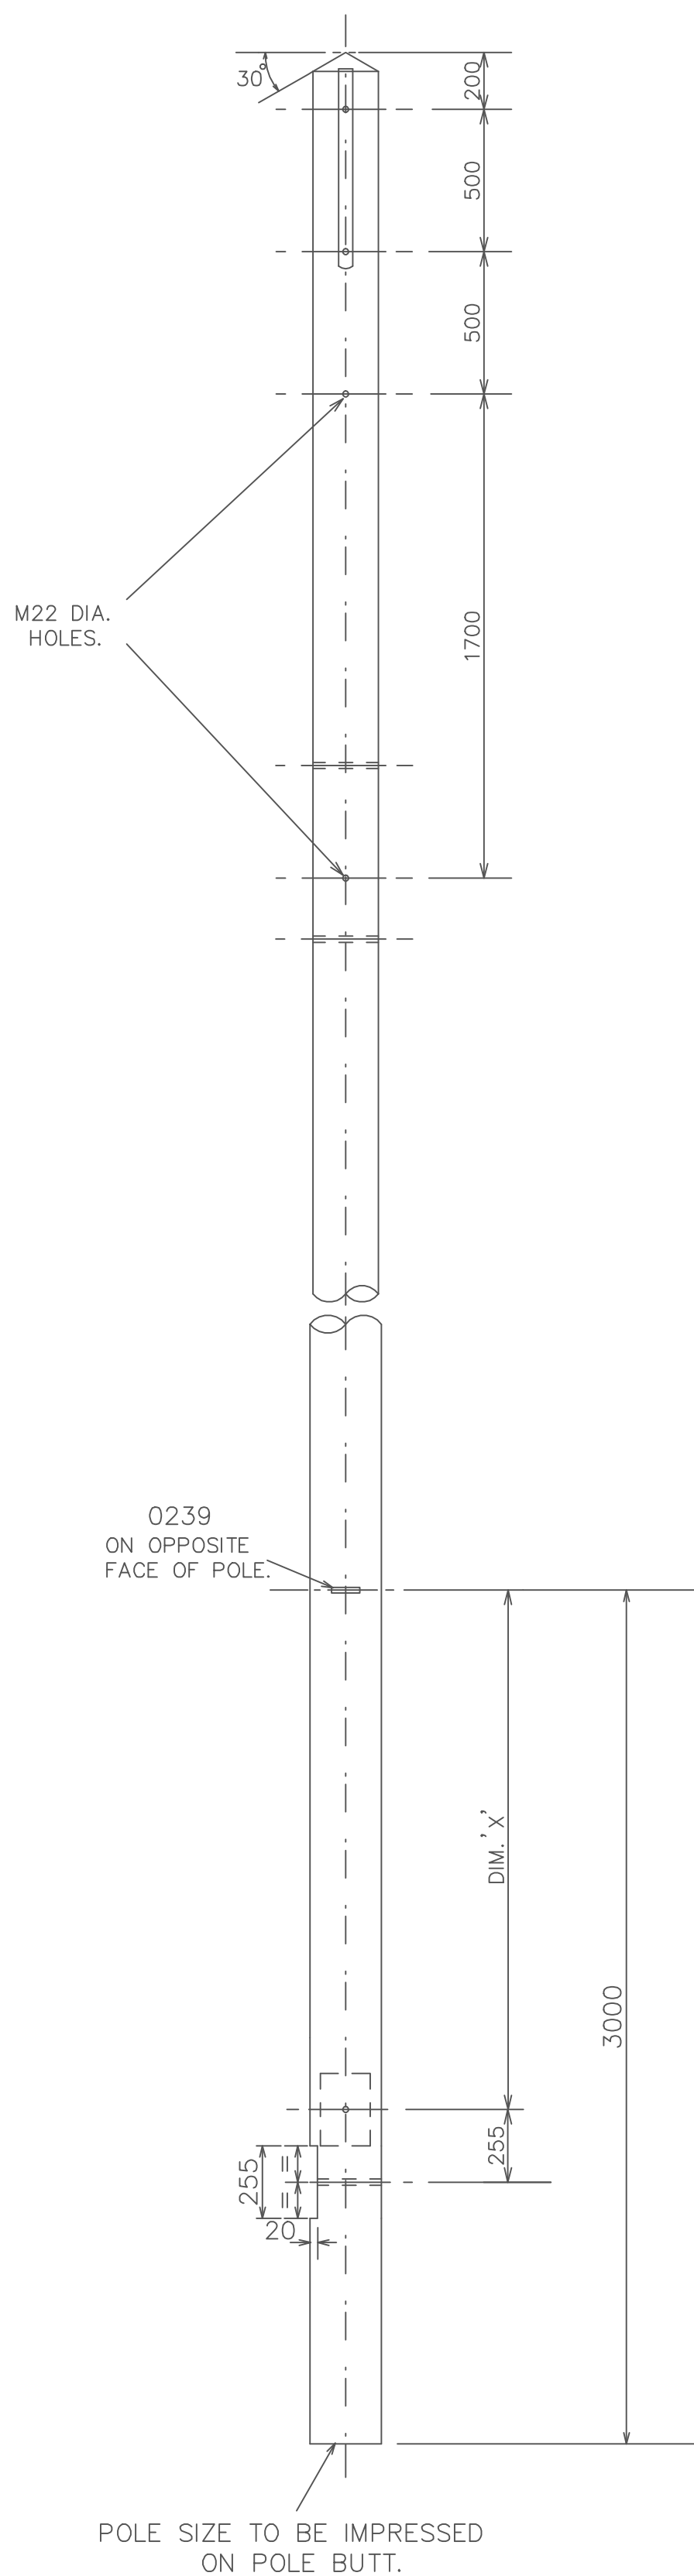

DETAIL A'
SCALE 1:10

NOTES:

1. MINIMUM POLE LENGTH 9.0m.
2. ALL HOLES TO BE M22 DIA. UNLESS OTHERWISE DETAILED. HOLES TO BE DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
3. POLE TO BE NOTCHED AND DRILLED FOR 2 - 250 X 125 KICKING BLOCKS.

POLE LENGTH. (m)	DIM. 'X' (mm)
9.0 - 11.0 INCLUSIVE.	1900
11.5 - 12.0 INCLUSIVE.	1700

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

		Lloyds Court, 78, Grey Street, Newcastle upon Tyne NE1 6AF									
		11kV AND 20kV OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR ARRANGEMENT OF CABLE LAYPOLE (1.00.043.4009 SHEET 5)									
Prepared by J.B.	Drg.No.	1 00 043 4009								Sheet No. 6	
Checked M.W.	Date issued OCT '92									Revised 15.3.2005	
		Mods.	A	B						Scale 1:20 & 1:10	