


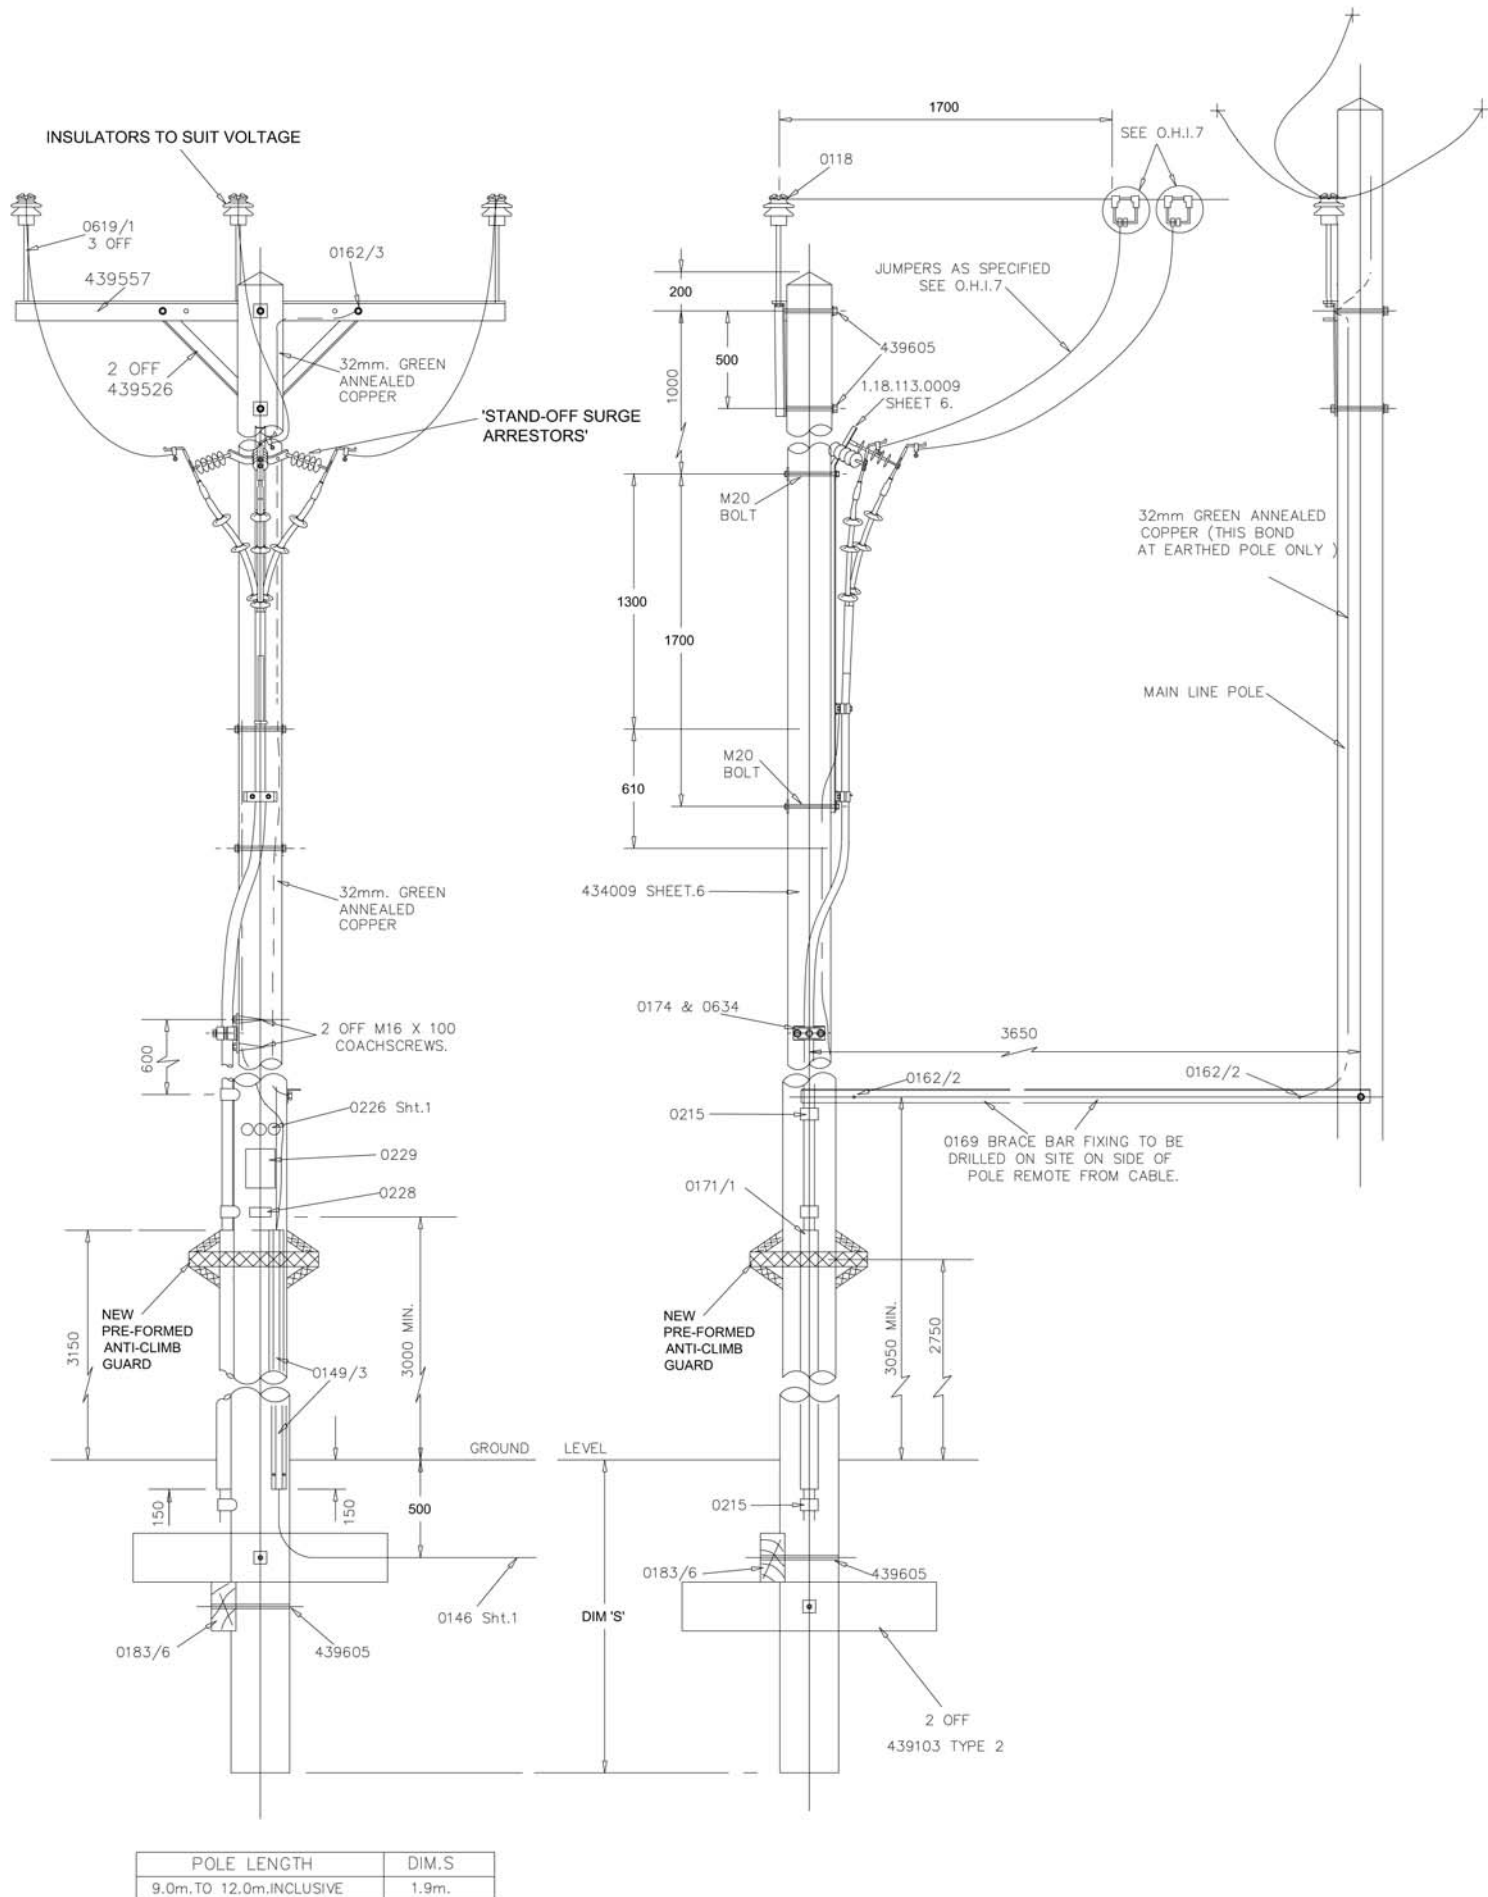

NOTES

1. ALL POLE BOLTS TO BE M20 DIA. UNLESS OTHERWISE DETAILED.
2. FOR EARTHING ARRANGEMENTS SEE CODE OF PRACTICE FOR EARTHING. P.I. 2500.
3. MINIMUM POLE LENGTH 9.0m.
4. DETAIL DRGS. PREFIXED 43... REFER TO E.S.I. STANDARD DRGS. OTHER DETAIL DRGS. REFER TO 1.09.101. SERIES.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. NO. 04/162.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11KV AND 20KV OVERHEAD LINES ARRANGEMENT OF CABLE LAYPOLE (WITH OR WITHOUT VERTICAL ARRESTORS)	
Sheet No. 5	Scale 1:20	Type ESI	
Prepared By Barbara Simpson		Ref No. C147678	Historic Drg. No. 1000434009
Revised 07/03/06	Grid Reference	Revision D	Notes
Date Issued 24/02/05	Checked By S SALKELD		