

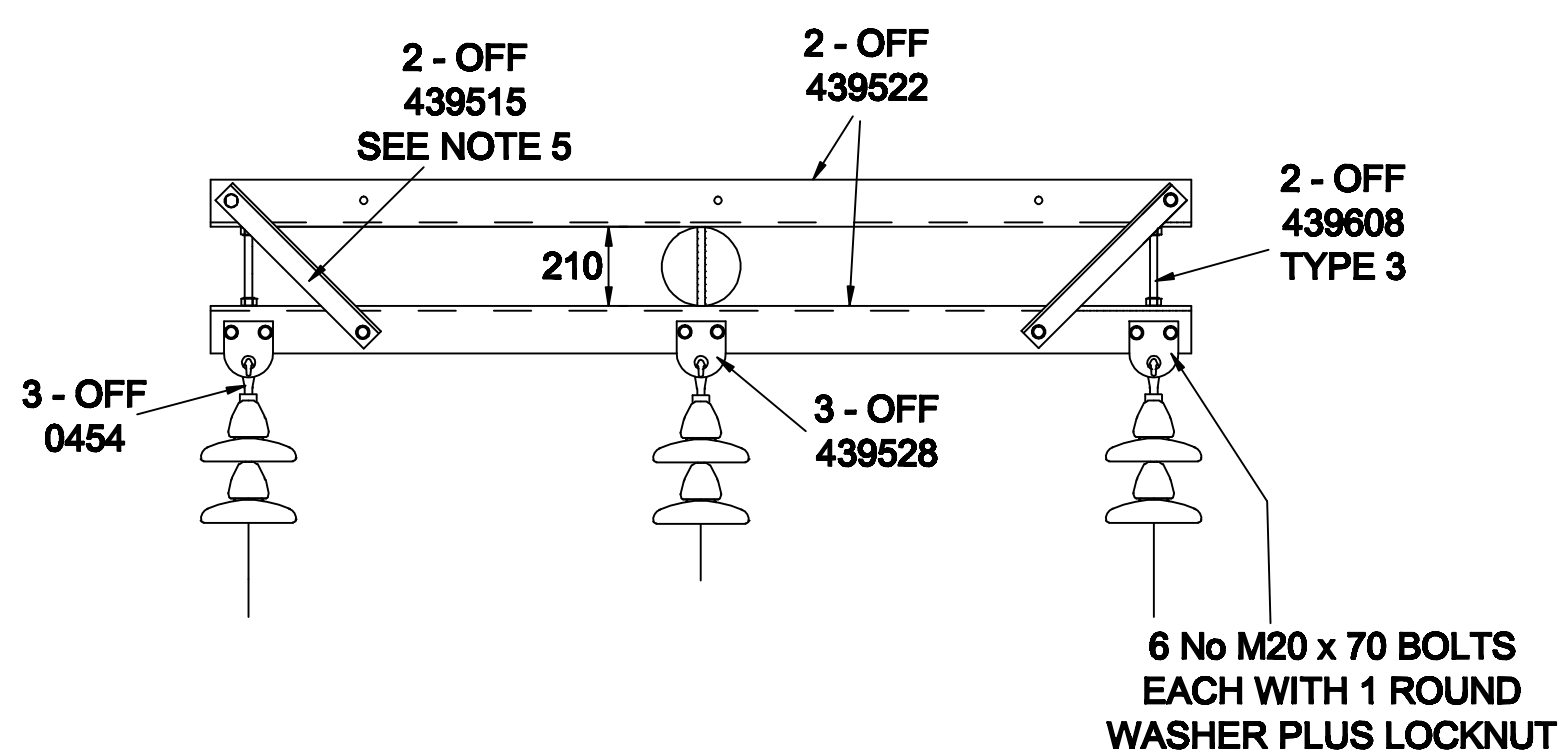


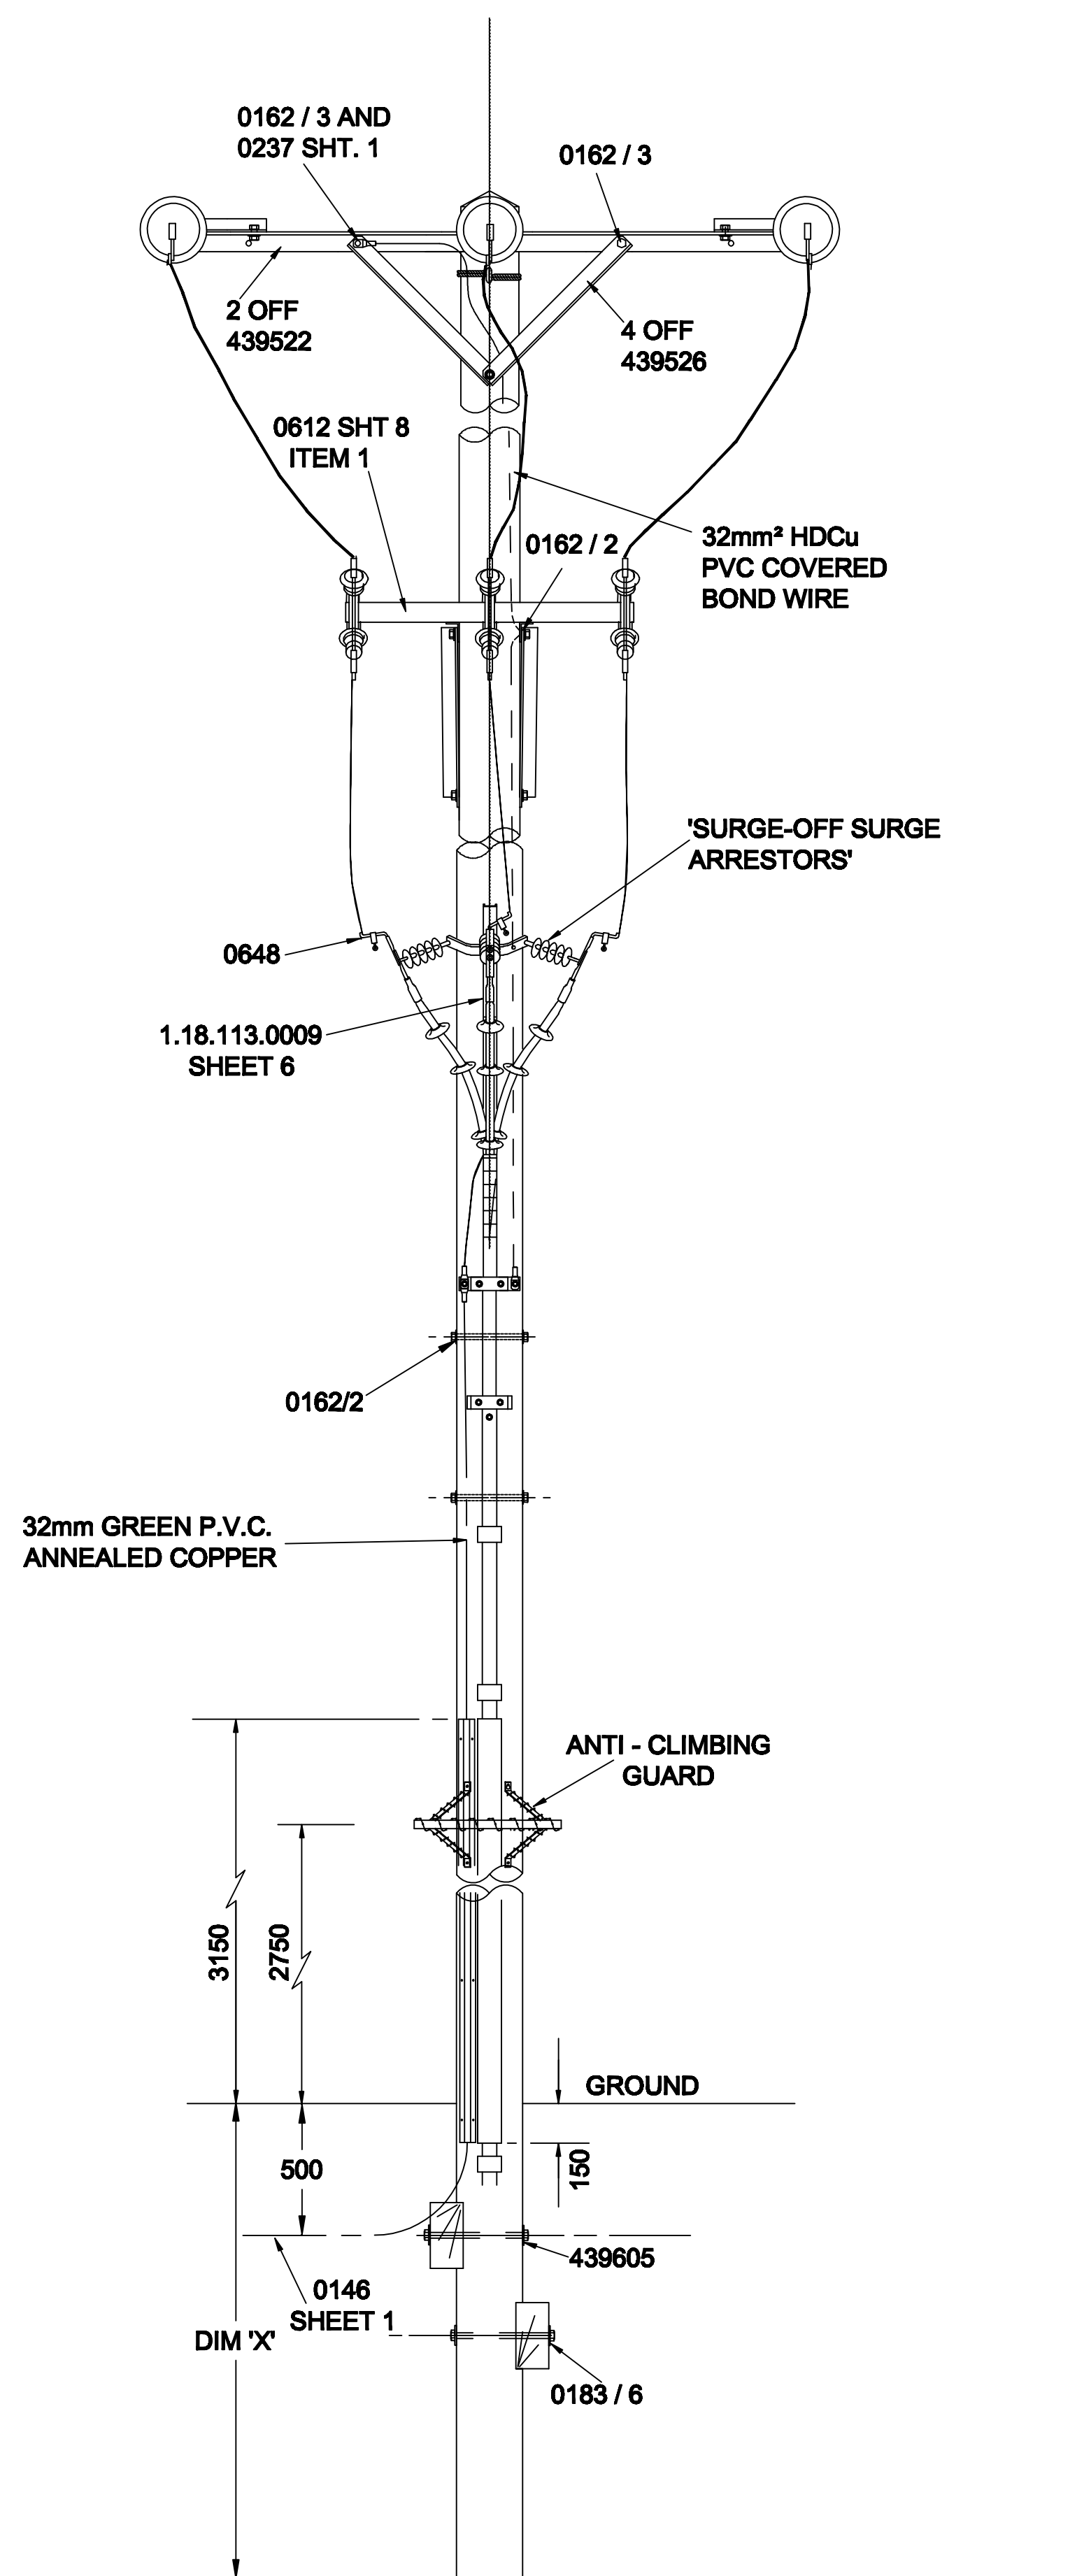

SEE NOTE 1 x

POLE LENGTH	DIM. 'S'
11.0m	1.9m
12.0m	1.9m
13.0m - 14.0m INCL	2.1m
15.0m - 18.0m INCL	2.4m

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

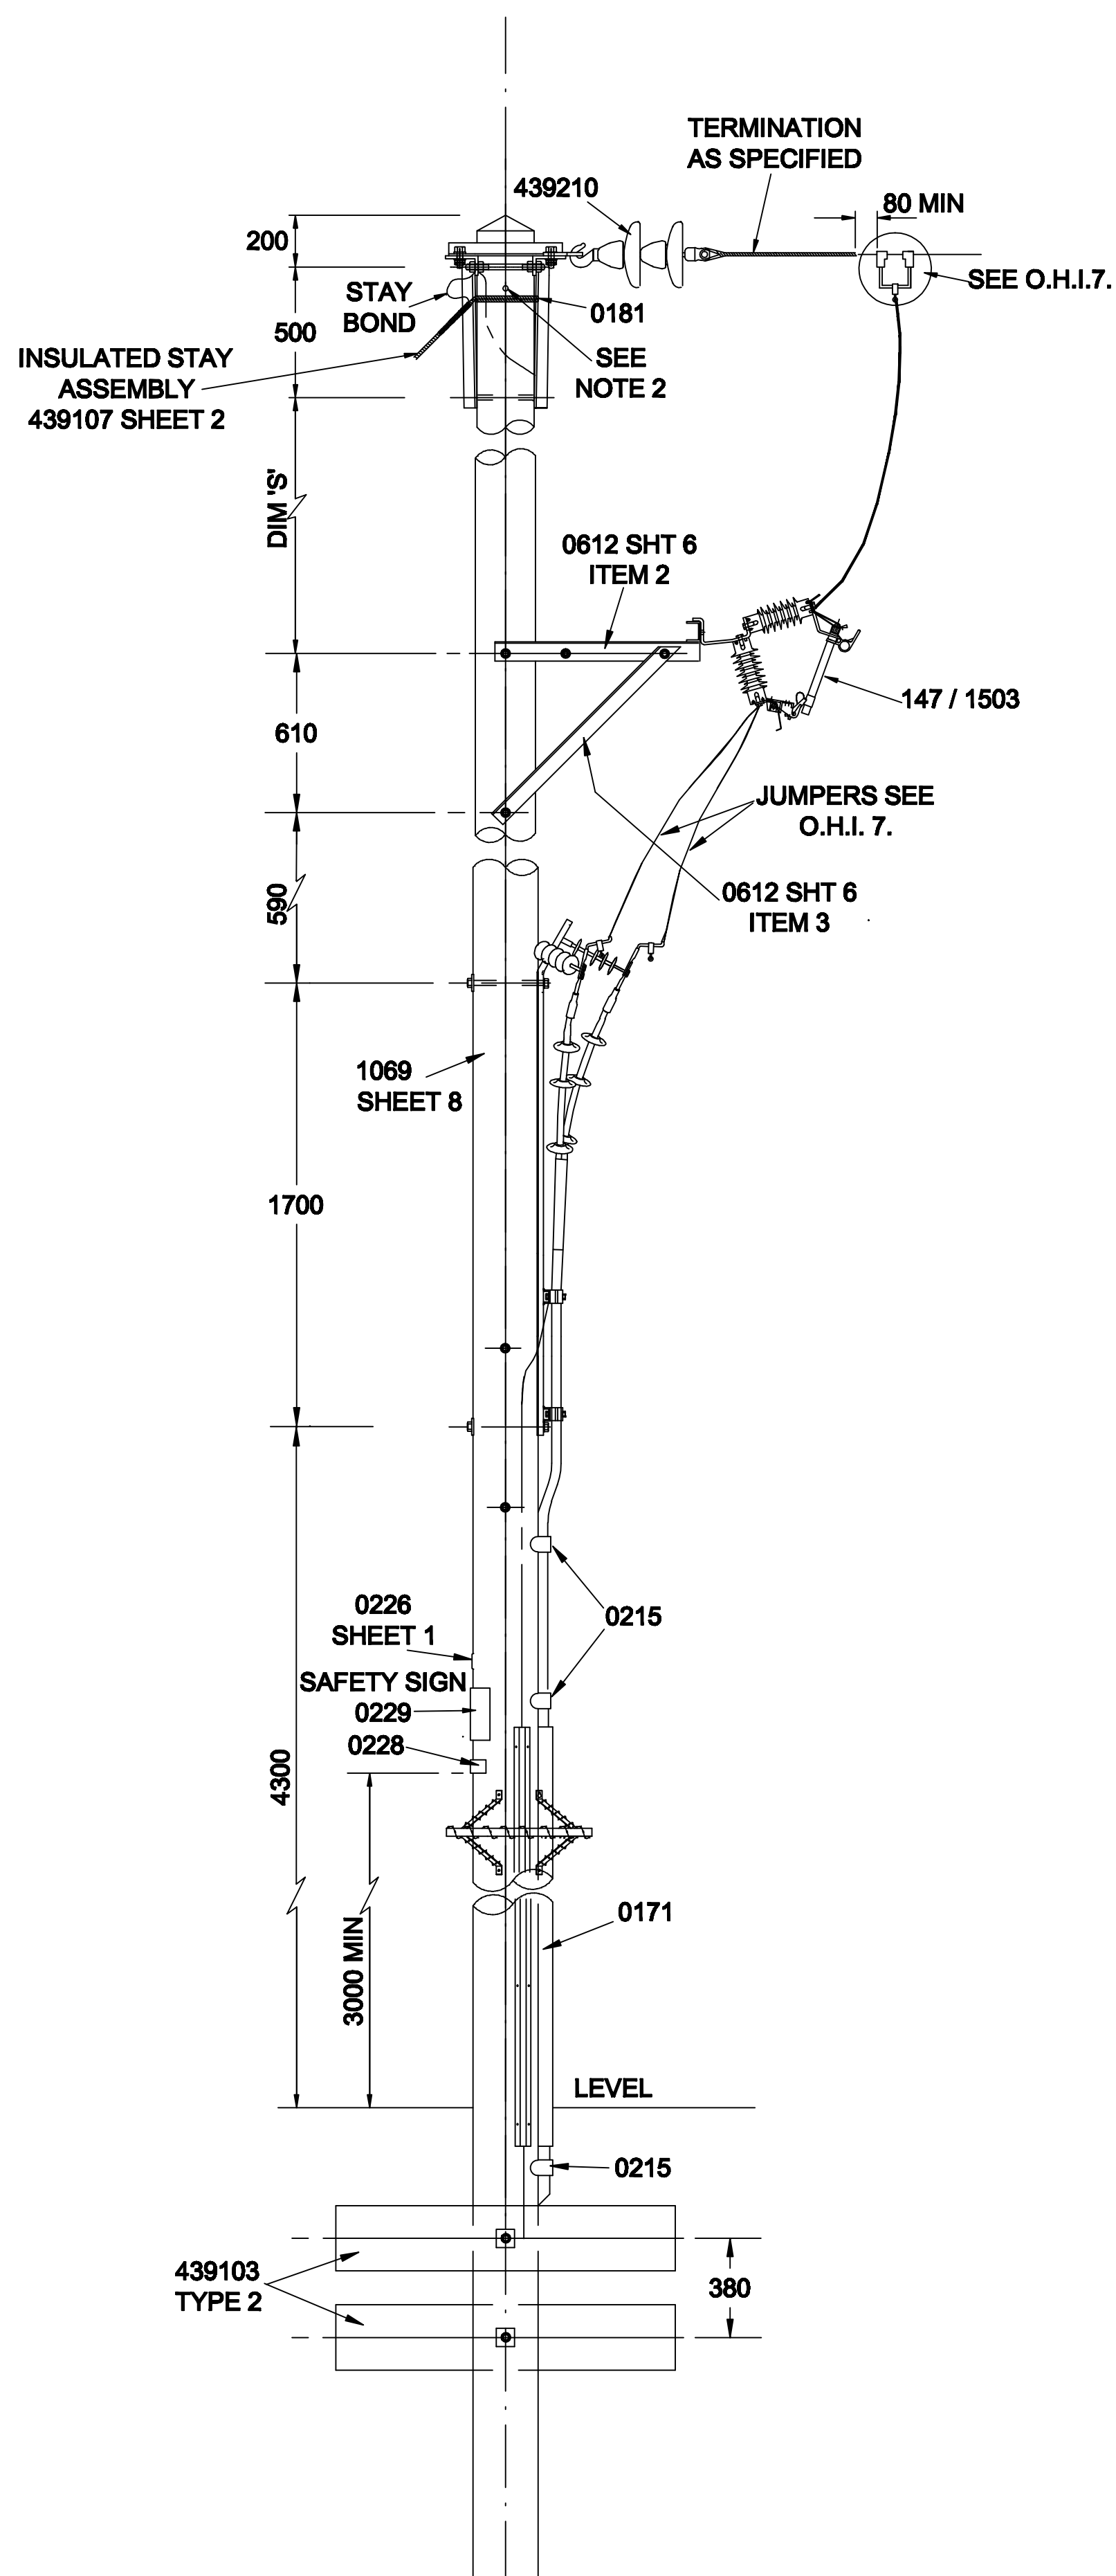

NOTES:-

- STANDARD POLE LENGTH 11.0m
- FIT 2 M20 POLE BOLTS WITH 2 WASHERS TO 439605 AT POLE TOP
- ALL POLE BOLTS TO BE M20 DIA UNLESS OTHERWISE DETAILED
- FOR EARTHING ARRANGEMENTS SEE CODE OF PRACTICE FOR EARTHING P.I.P2500
- WHERE THIS ARRANGEMENT IS USED WITH CONDUCTOR C.S.A. OF LESS THAN OR EQUAL TO 50mm² OMIT 2 OFF BRACING 439515
- DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS, OTHER DETAIL DRAWINGS REFER TO 1.09.101.....SERIES
- ALL UNUSED BOLT HOLES SHALL BE PLUGGED

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No 04 / 141

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF		
Manufacturer Details		11KV AND 20KV HV OVERHEAD LINES TERMINAL POLE WITH HV CABLE CONTROLLED BY FUSE UNITS (SUPPLY OVERHEAD AND UNDERGROUND)		
Sheet No. 10	Scale 1:20	Type ESI	ESI	
Prepared By Janis Webb	Grid Reference	Ref No. C928847	Historic Drg.No.	1000434010
Revised 18/04/06	Checked By G HAMMEL	Revision	Notes	
Date Issued 05/04/06				