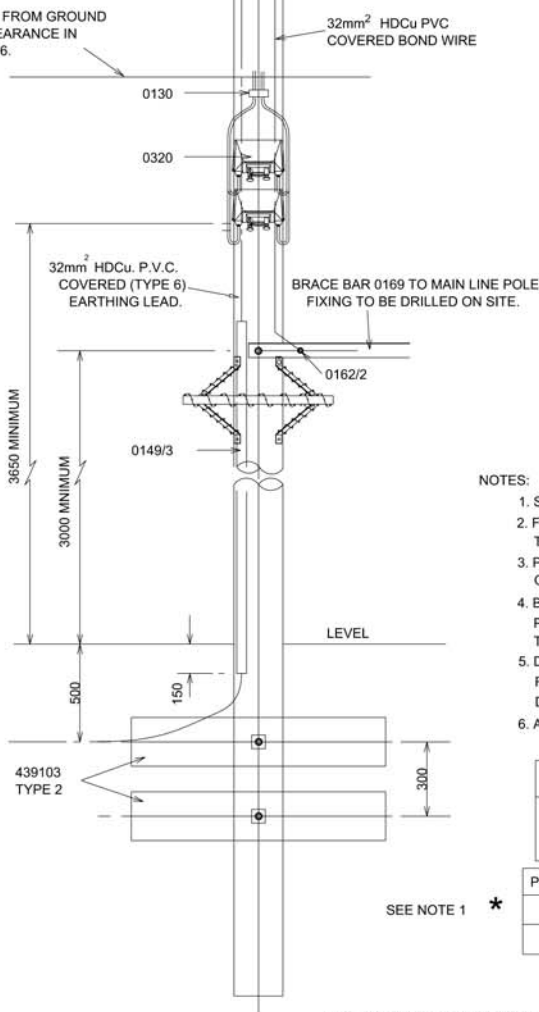
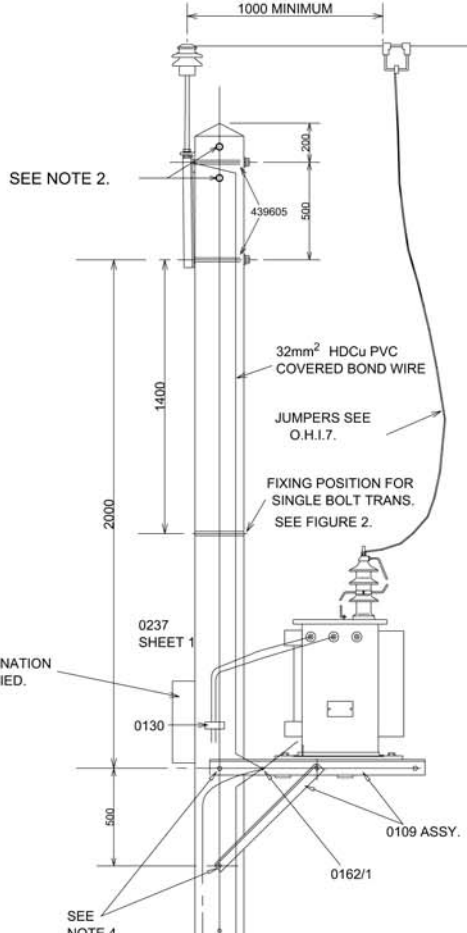
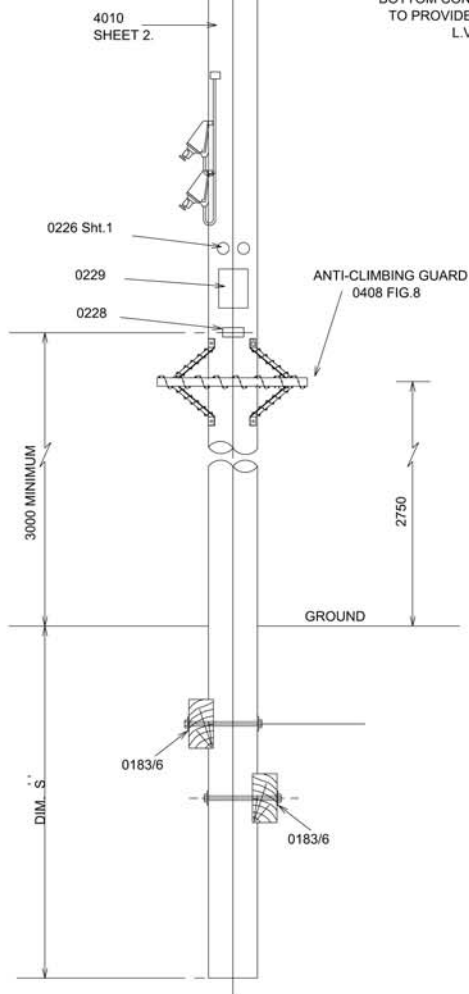
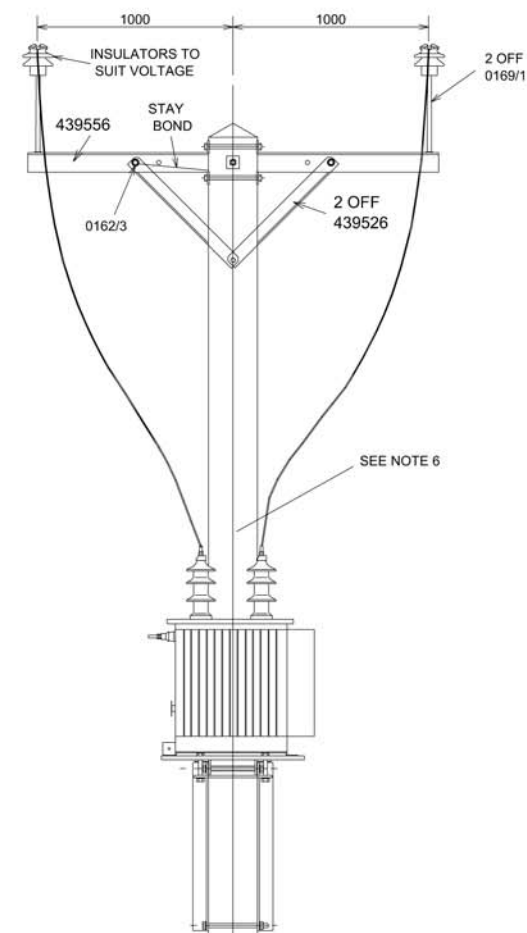


FIG. 2
POSITION OF SINGLE BOLT
FIXING TRANSFORMER WHEN SPECIFIED

NOTES:

1. STANDARD POLE LENGTH 11.0m.
2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS TO 439605 AT POLE TOP.
3. POLE BOLTS TO BE M20 EXCEPT WHERE OTHERWISE STATED.
4. BOLTS OF SUFFICIENT LENGTH TO ALLOW PLATFORM TO BE COLLAPSED WHEN LIFTING TRANSFORMER.
5. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. DRGS. AND OTHER DETAIL DRGS. REFER TO 1.09.101. SERIES
6. ALL UNUSED BOLT HOLES SHALL BE PLUGGED.

TRANSFORMER MOUNT	
11 / 20kV	
UP TO 50kVA	- SINGLE BOLT FIXING
UP TO 100kVA	- PLATFORM MOUNT
POLE LENGTH (m)	DIM S (m)
11.0	1.9
12.0 - 14.0	2.1

SEE NOTE 1 *

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04/083

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

CE Electric UK

Manufacturer Details	
Sheet No. 1	Scale 1:20
Prepared By Barbara Gordon	Type OVERHEAD
Revised 16/06/09	Grid Reference
Date Issued 17/04/97	Checked By G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

11KV AND 20KV OVERHEAD LINES LAYPOPLE SINGLE PHASE SUBSTATION WITH POLE MOUNTED TRANSFORMER	
Ref No. C101701	Historic Drg. No. 1091070811
Revision G	Notes