
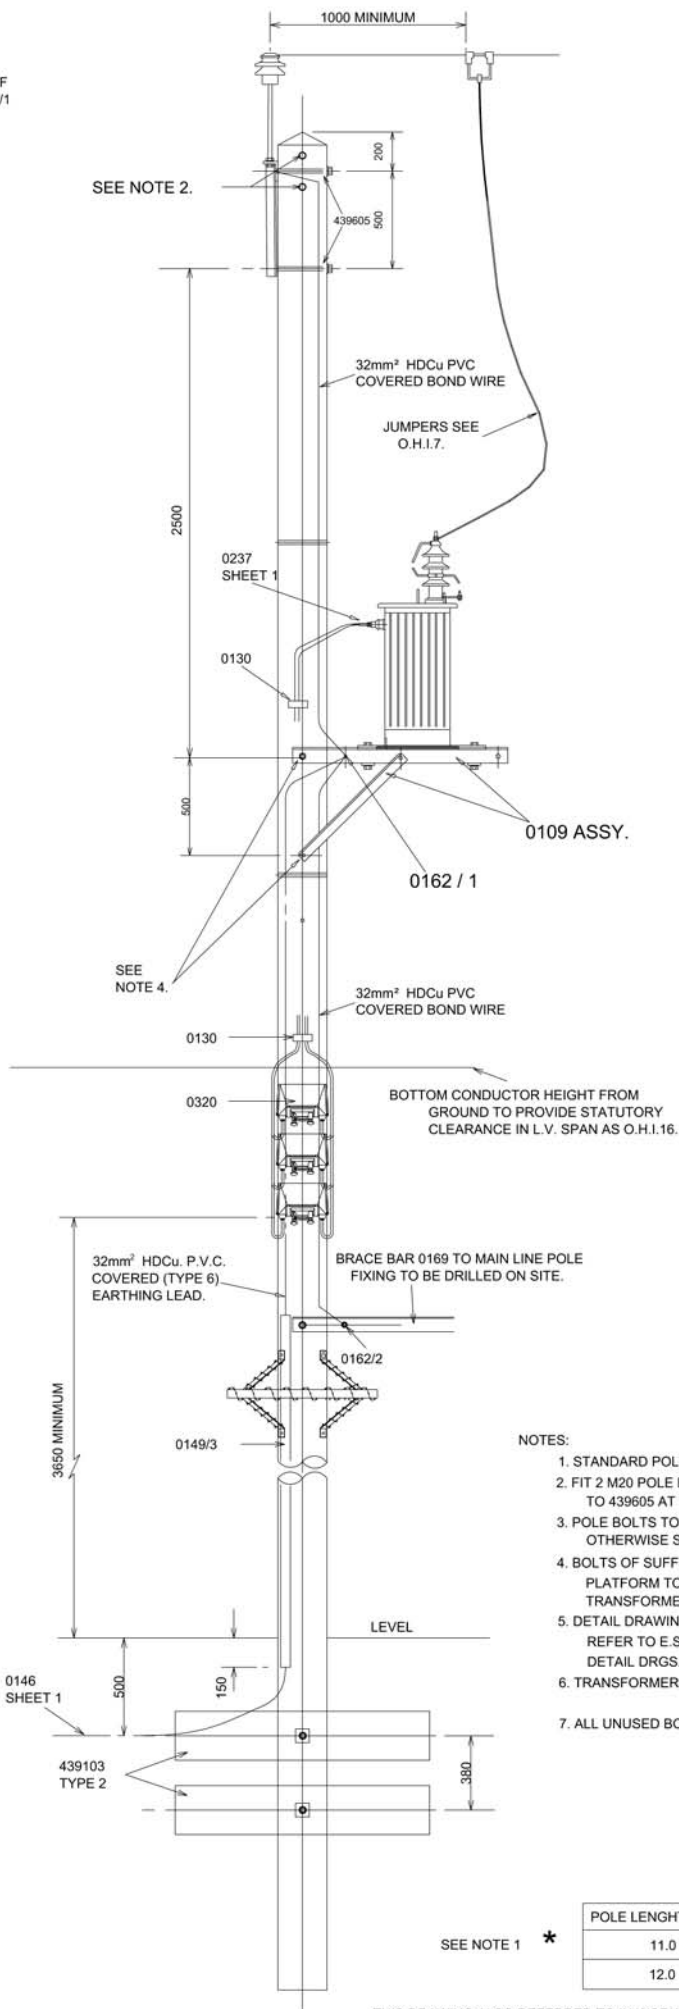


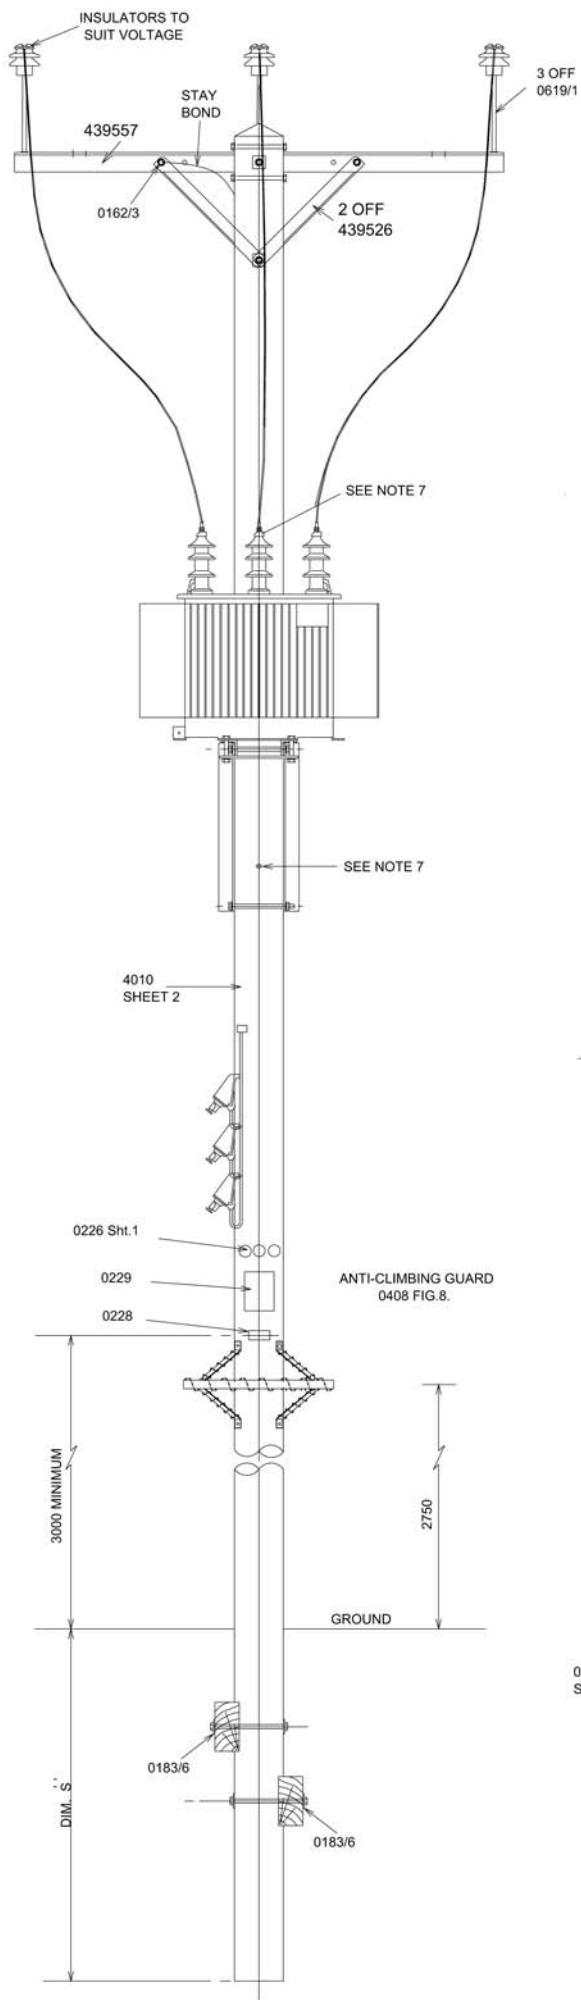

NOTES:

1. STANDARD POLE LENGTH 11.0m.
2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS TO 439605 AT POLE TOP.
3. POLE BOLTS TO BE M20 EXCEPT WHERE OTHERWISE STATED.
4. BOLTS OF SUFFICIENT LENGTH TO ALLOW PLATFORM TO BE COLLAPSED WHEN LIFTING TRANSFORMER.
5. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. DRGS. AND OTHER DETAIL DRGS. REFER TO 1.09.101. SERIES
6. TRANSFORMER SIZE 11kV UP TO 200 kVA
20kV UP TO 100 kVA
7. ALL UNUSED BOLT HOLES SHALL BE PLUGGED.

SEE NOTE 1 *

POLE LENGTH (m)	DIM S (m)
11.0	1.9
12.0 - 14.0	2.1

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04/083



Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF
11KV AND 20KV OVERHEAD LINES LAYPOLE THREE PHASE
SUBSTATION WITH POLE MOUNTED TRANSFORMER

Manufacturer Details	
Sheet No. 2	Scale
Prepared By Janis Webb	Type OVERHEAD
Revised 05/04/06	Grid Reference
Date Issued 21/05/97	Checked By J WEBB

Ref No. C101702	Revision G
-----------------	------------

Historic Drg. No. 1091070811	Notes
------------------------------	-------

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.