
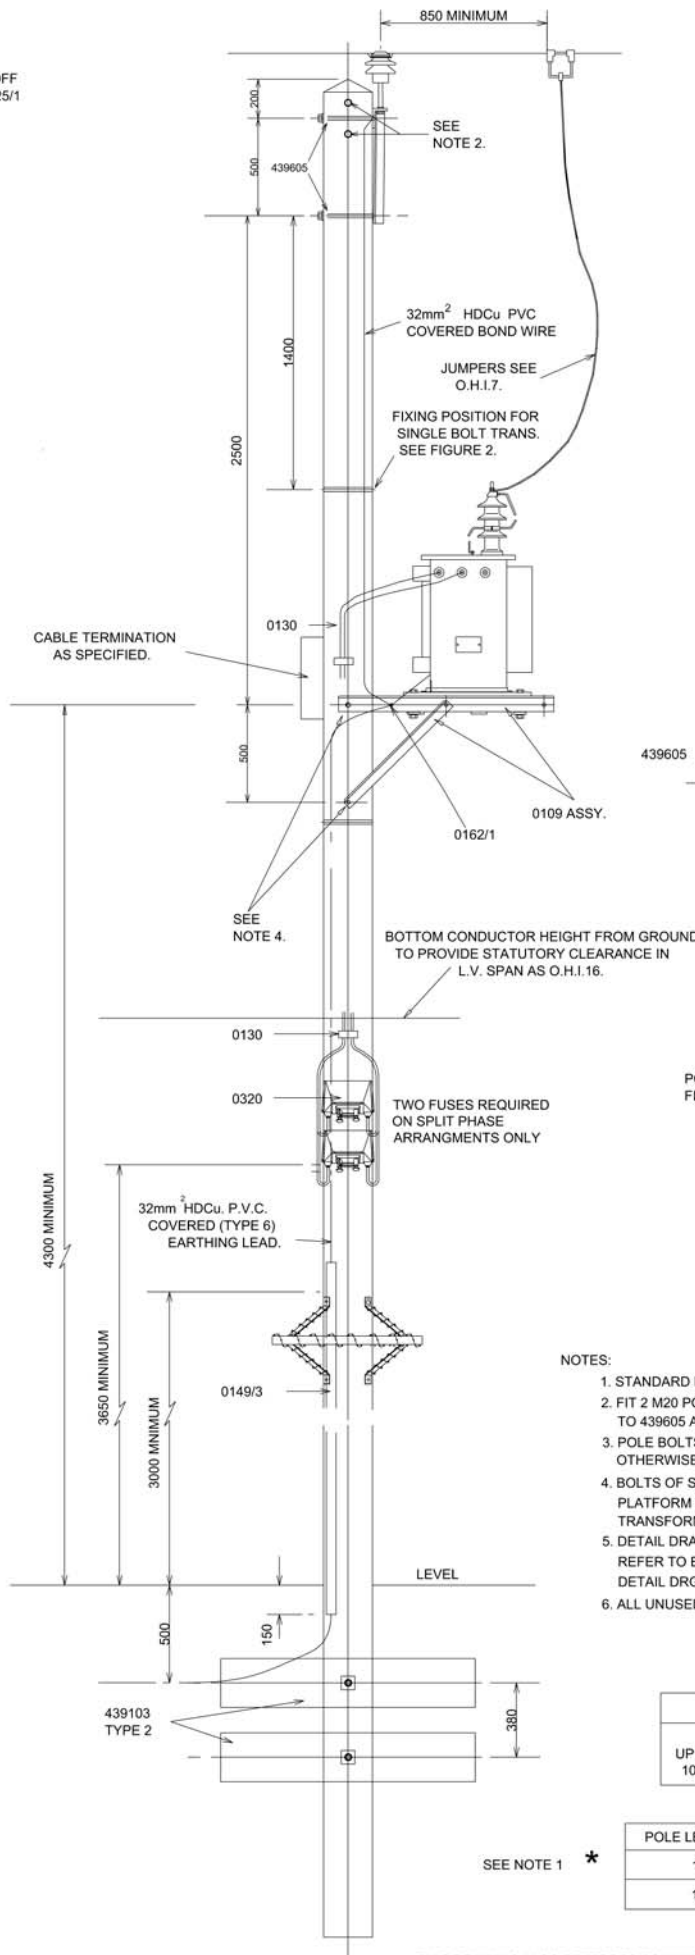


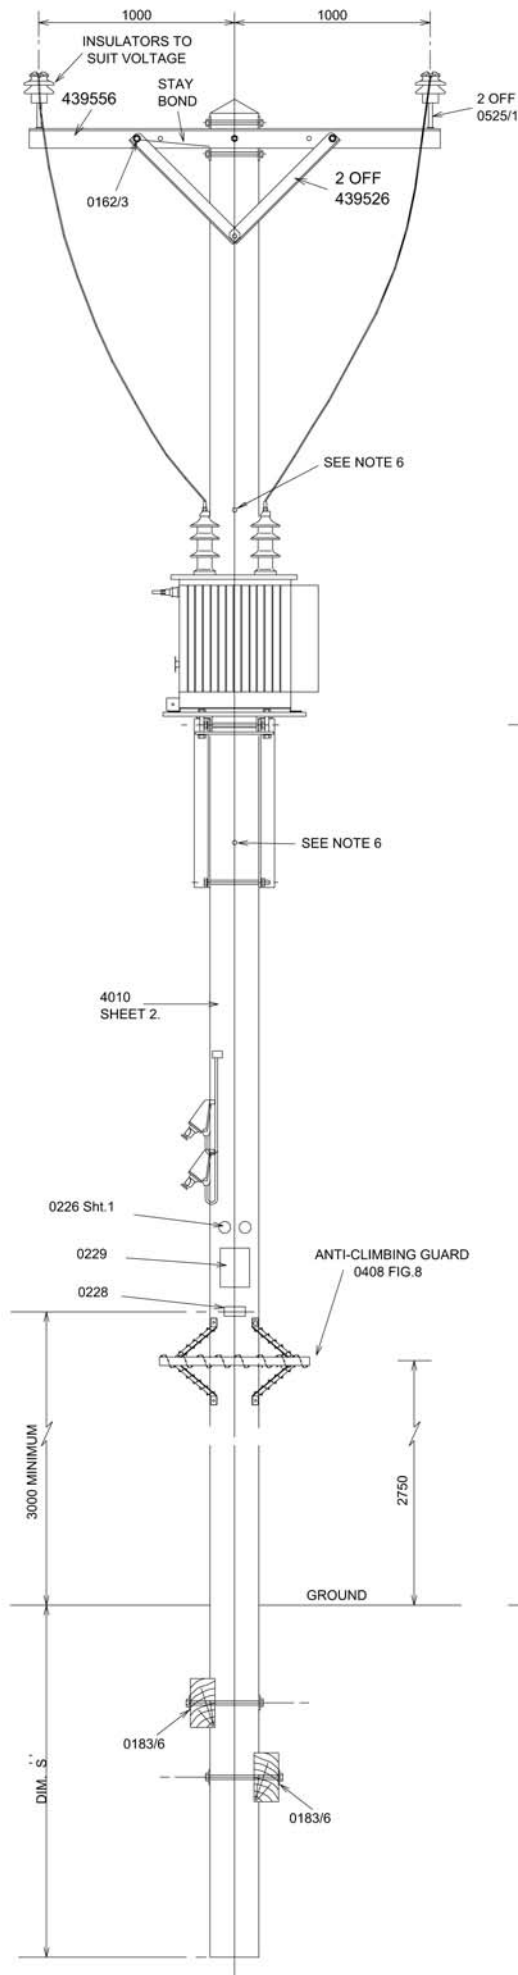

NOTES:

1. STANDARD POLE LENGTH 11.0m.
2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS TO 439605 AT POLE TOP.
3. POLE BOLTS TO BE M20 EXCEPT WHERE OTHERWISE STATED.
4. BOLTS OF SUFFICIENT LENGTH TO ALLOW PLATFORM TO BE COLLAPSED WHEN LIFTING TRANSFORMER.
5. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. DRGS. AND OTHER DETAIL DRGS. REFER TO 1.09.101. SERIES
6. ALL UNUSED BOLT HOLES SHALL BE PLUGGED.

TRANSFORMER MOUNT	
11 / 20kV	
UP TO 50kVA	SINGLE BOLT FIX
100kVA	PLATFORM MOUNT

POLE LENGTH (m)	DIM S (m)
11.0	1.9
12.0 - 14.0	2.1

SEE NOTE 1 *

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04/084

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.



Manufacturer Details

Sheet No. 1 Scale

Prepared By Barbara Gordon

Revised 15/06/09 Grid Reference

Date Issued 15/08/99 Checked By J WEBB

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

11KV & 20KV OVERHEAD LINES
LIGHT CONSTRUCTION SINGLE PHASE
STRAIGHT LINE P.M. SUBSTATION
WITH PLATFORM MOUNTED TRANSFORMER

Type OVERHEAD

Ref No. C101703

Revision J Notes

Historic Drg. No. 1091070814