
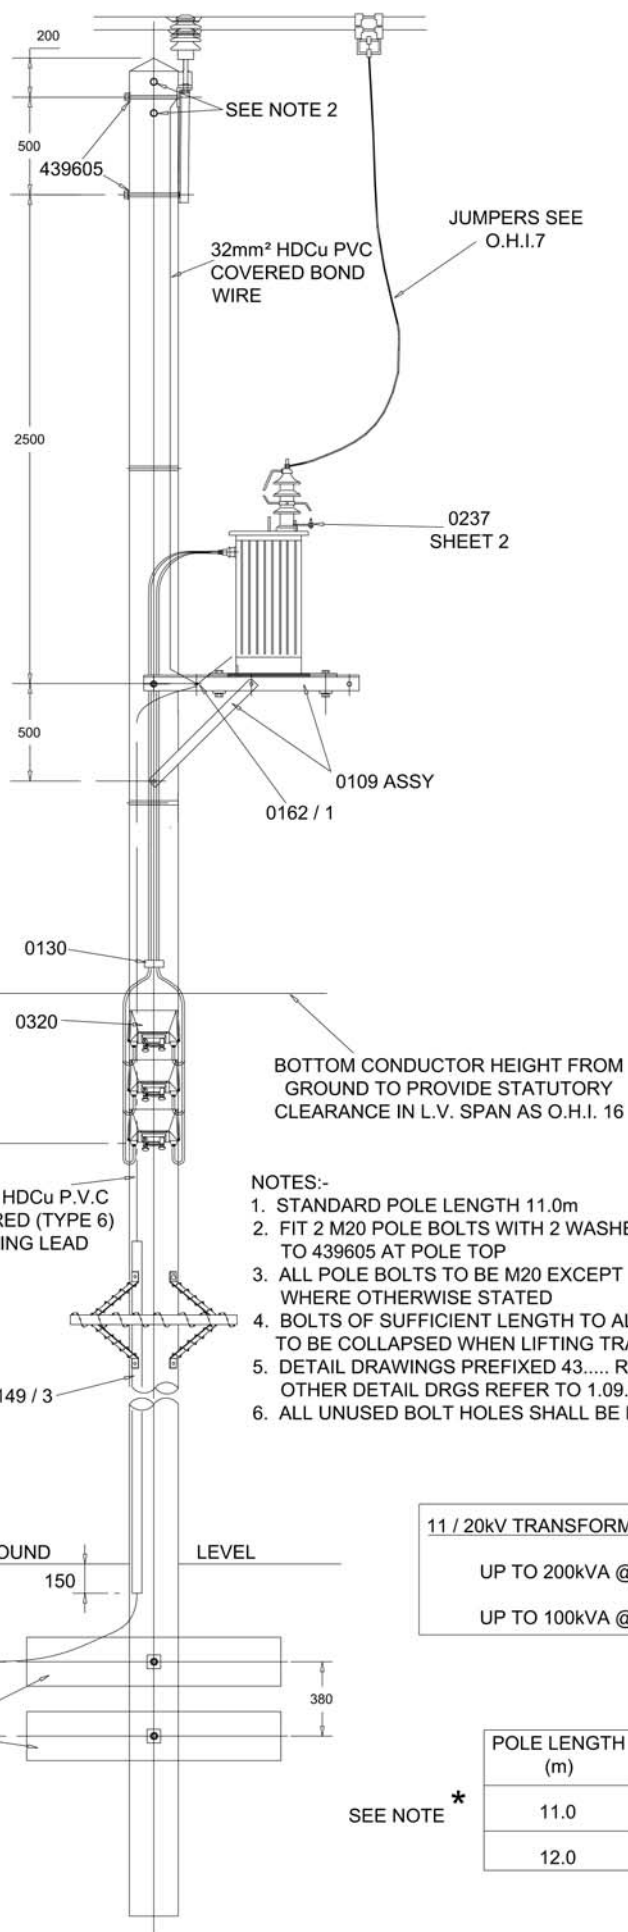


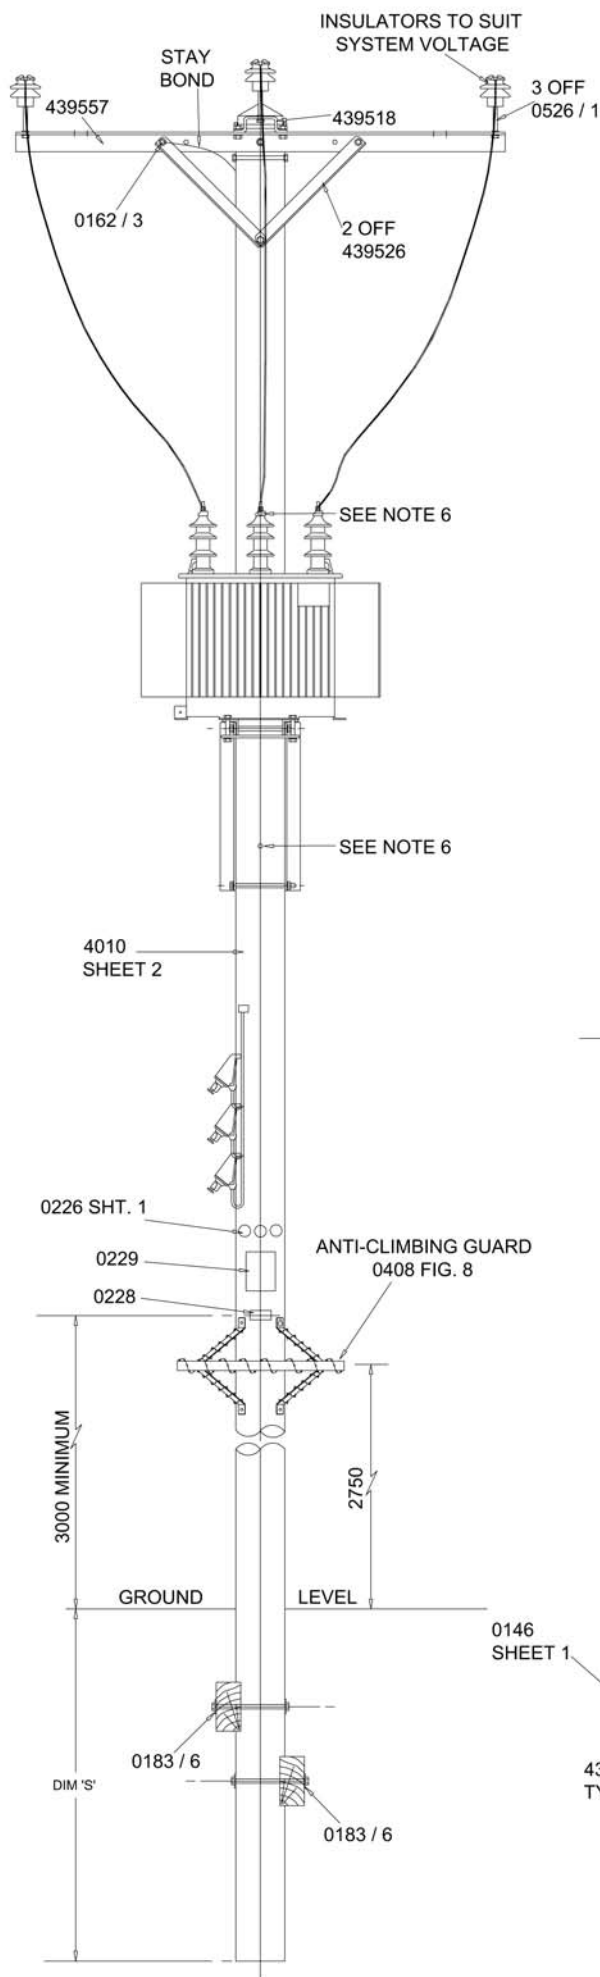

NOTES:-

1. STANDARD POLE LENGTH 11.0m
2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS TO 439605 AT POLE TOP
3. ALL POLE BOLTS TO BE M20 EXCEPT WHERE OTHERWISE STATED
4. BOLTS OF SUFFICIENT LENGTH TO ALLOW PLATFORM TO BE COLLAPSED WHEN LIFTING TRANSFORMER
5. DETAIL DRAWINGS PREFIXED 43..... REFER TO ESI DRGS OTHER DETAIL DRGS REFER TO 1.09.101..... SERIES
6. ALL UNUSED BOLT HOLES SHALL BE PLUGGED

11 / 20kV TRANSFORMER MOUNT

UP TO 200kVA @ 11kV

UP TO 100kVA @ 20kV

POLE LENGTH (m)	DIM 'S' (m)
11.0	1.9
12.0	2.1

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04 / 084

CE Electric UK

Manufacturer Details

Sheet No. 2

Scale 1:20

Prepared By Barbara Gordon

Revised 15/06/09

Date Issued 26/07/99

Grid Reference

Checked By G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

11kV & 20kV OVERHEAD LINES
STRAIGHT LINE THREE PHASE SUBSTATION
WITH POLE MOUNTED TRANSFORMER

Type OVERHEAD

LINES

Ref No. C101704

Historic Drg.No.

1091070814

Revision J

Notes

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED