

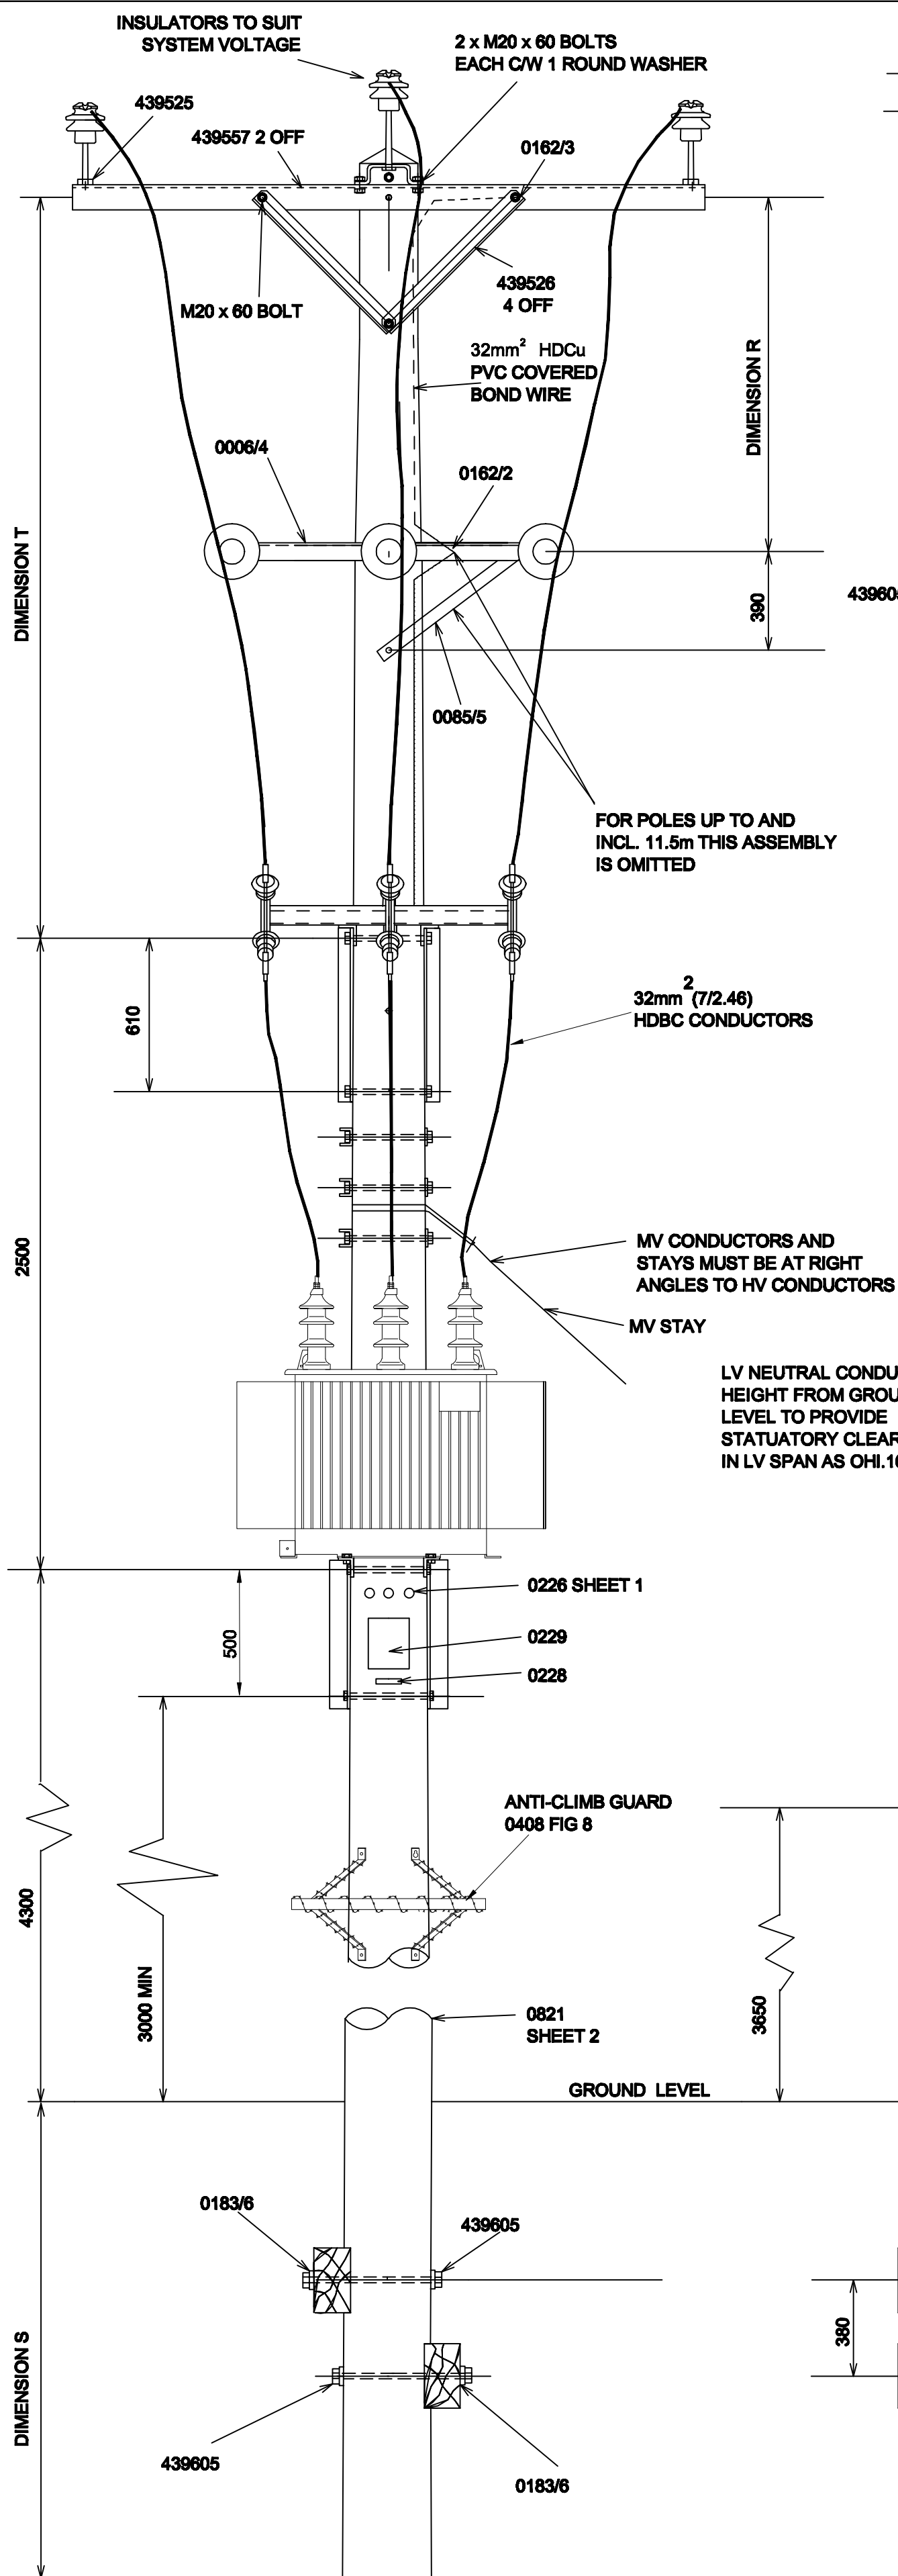


FIG 1 PLATFORM MOUNTED TRANSFORMER IN LINE ARRANGEMENT

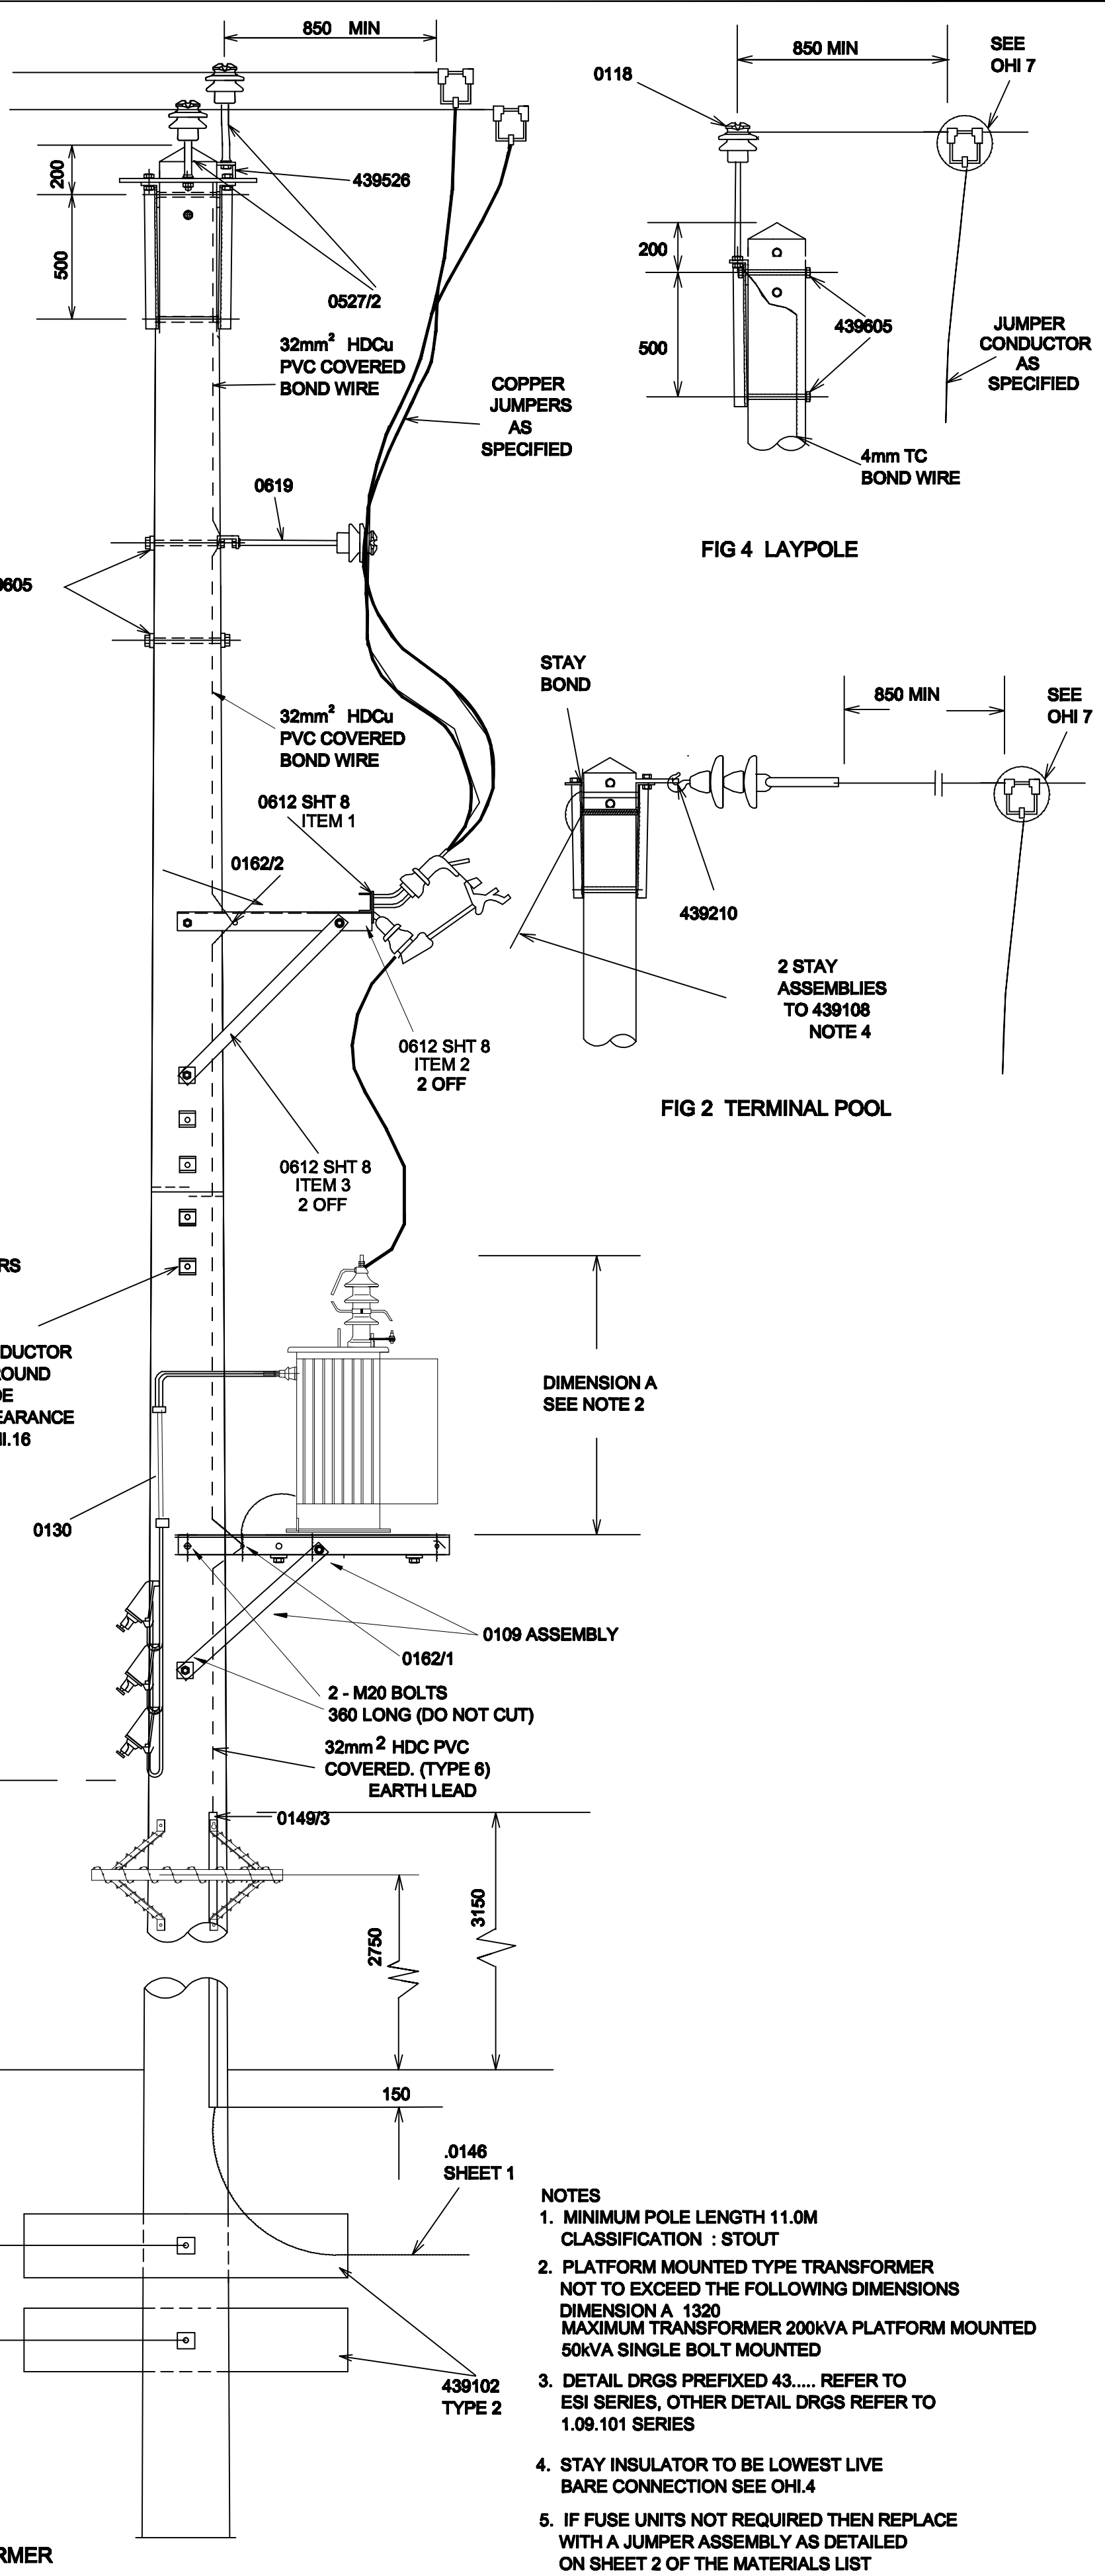


FIG 4 LAYPOLE

FIG 2 TERMINAL POOL

- NOTES**
1. MINIMUM POLE LENGTH 11.0M
CLASSIFICATION : STOUT
 2. PLATFORM MOUNTED TYPE TRANSFORMER
NOT TO EXCEED THE FOLLOWING DIMENSIONS
DIMENSION A 1320
MAXIMUM TRANSFORMER 200kVA PLATFORM MOUNTED
50kVA SINGLE BOLT MOUNTED
 3. DETAIL DRGS PREFIXED 43..... REFER TO
ESI SERIES, OTHER DETAIL DRGS REFER TO
1.09.101 SERIES
 4. STAY INSULATOR TO BE LOWEST LIVE
BARE CONNECTION SEE OHI.4
 5. IF FUSE UNITS NOT REQUIRED THEN REPLACE
WITH A JUMPER ASSEMBLY AS DETAILED
ON SHEET 2 OF THE MATERIALS LIST

POLE LENGTH	DIMENSION S	DIMENSION R	DIMENSION T
11.0m	1.9m	-	1.95m
12.0m	2.1m	1.4m	2.95m
13.0m	2.1m	1.4m	3.65m
14.0m	2.1m	1.4m	3.65m

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11KV OVERHEAD LINES TERMINAL, IN LINE AND LAYPOLE THREE PHASE SUBSTATION WITH FUSE UNITS	
Sheet No. 1	Scale 1:20	Type OVERHEAD	
Prepared By Pauline Moore		Ref No.	C101708
Revised 20/08/09	Grid Reference	Historic Drg.No.	1091080821
Date Issued 17/02/06	Checked By G HAMMEL	Revision	Notes