



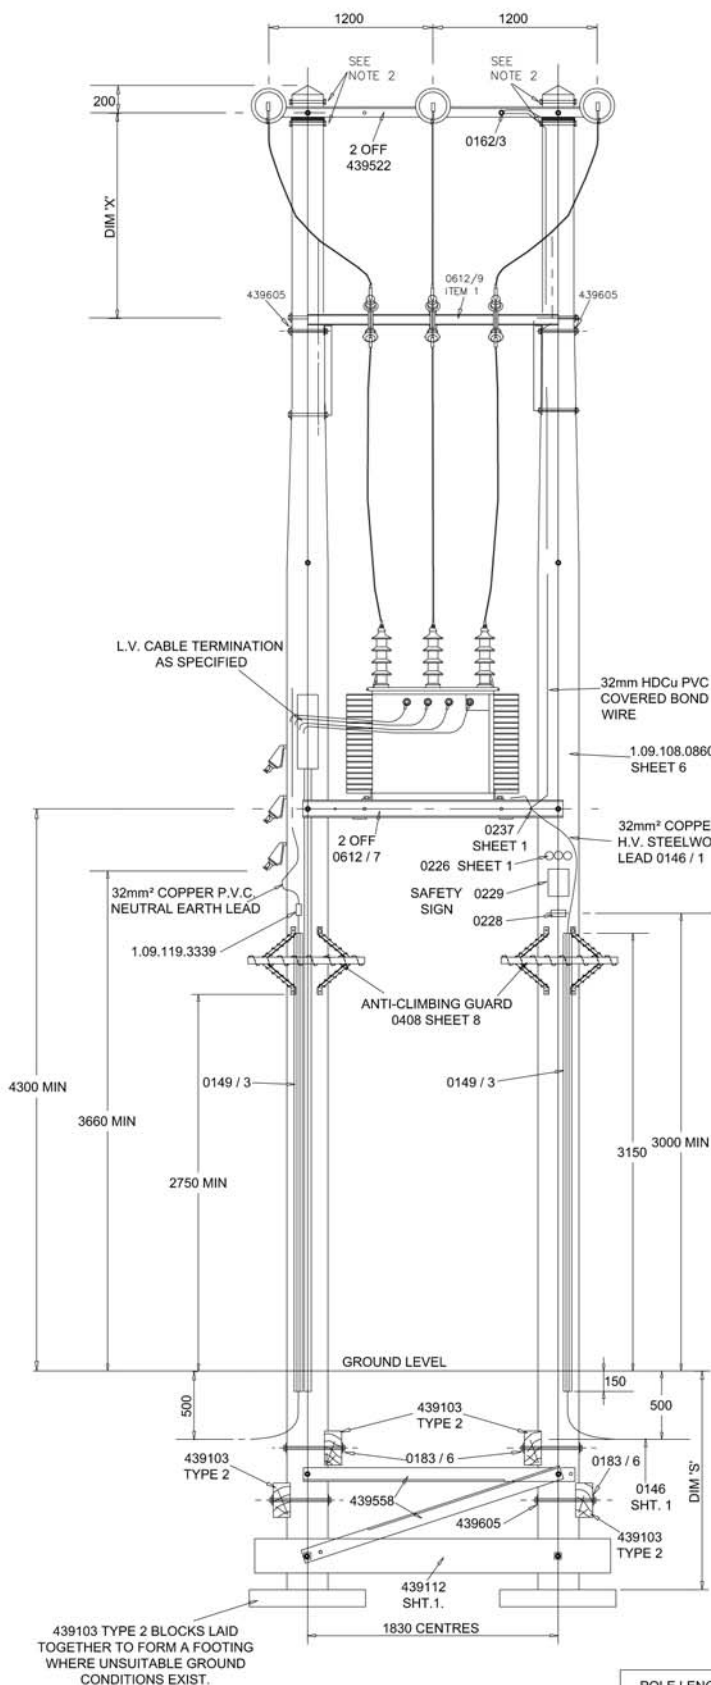

NOTE:  
STAY INSULATOR TO BE MOUNTED IN STAY TO CLEAR THE H.V. JUMPERS

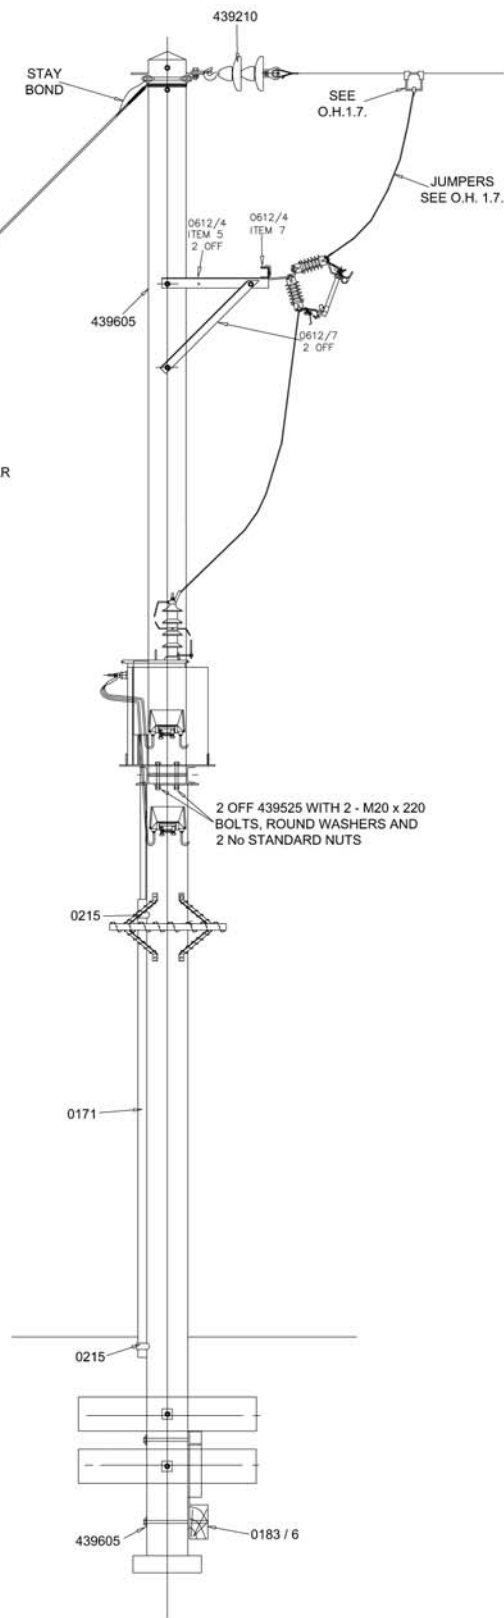

TRANSFORMER MAXIMUM SIZES

11kV = 315 kVA  
20kV = 200 kVA

- NOTES:
1. POLE BOLTS TO BE M20
  2. FIT M20 BOLTS WITH 2 WASHERS, 439605 AT POLE TOP
  3. MINIMUM POLE LENGTH 11.0m
  4. DETAIL DRAWINGS PREFIXED 43 ..... REFER TO E.S.I. BASED DRAWINGS  
OTHER DETAIL DRAWINGS REFER TO 1.09.101..... SERIES
  5. SEE CODE OF PRACTICE FOR EARTHING - PI 2500
  6. MAXIMUM HEIGHT OF TRANSFORMER TO BE 1500

| POLE LENGTH (m) | DIM. S (m) | DIM. X (m) |
|-----------------|------------|------------|
| 11.0            | 1.9        | 1.5        |
| 12.0            | 1.9        | 1.7        |
| 13.0 - 14.0     | 2.1        | 2.2        |

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF No 04 / 095

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

|                            |                       |                                                                                                                    |                             |
|----------------------------|-----------------------|--------------------------------------------------------------------------------------------------------------------|-----------------------------|
| <b>CE Electric UK</b>      |                       | Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF                                                         |                             |
| Manufacturer Details       |                       | 11/20KV OVERHEAD LINES                                                                                             |                             |
| Sheet No. 5                | Scale 1:20            | THREE PHASE P.M. S/S (1.8M CENTRES) SUITABLE FOR SINGLE TRANSFORMER WITH J & P FUSE ISOLATORS TERMINAL ARRANGEMENT |                             |
| Prepared By Barbara Gordon | Grid Reference        | Type OVERHEAD                                                                                                      | Lines                       |
| Revised 13/02/08           | Checked By G. HAMMILL | Ref No C101713                                                                                                     | Historic Drg No. 1091080860 |
| Date Issued 17/07/99       | Revision D            | Notes                                                                                                              |                             |