


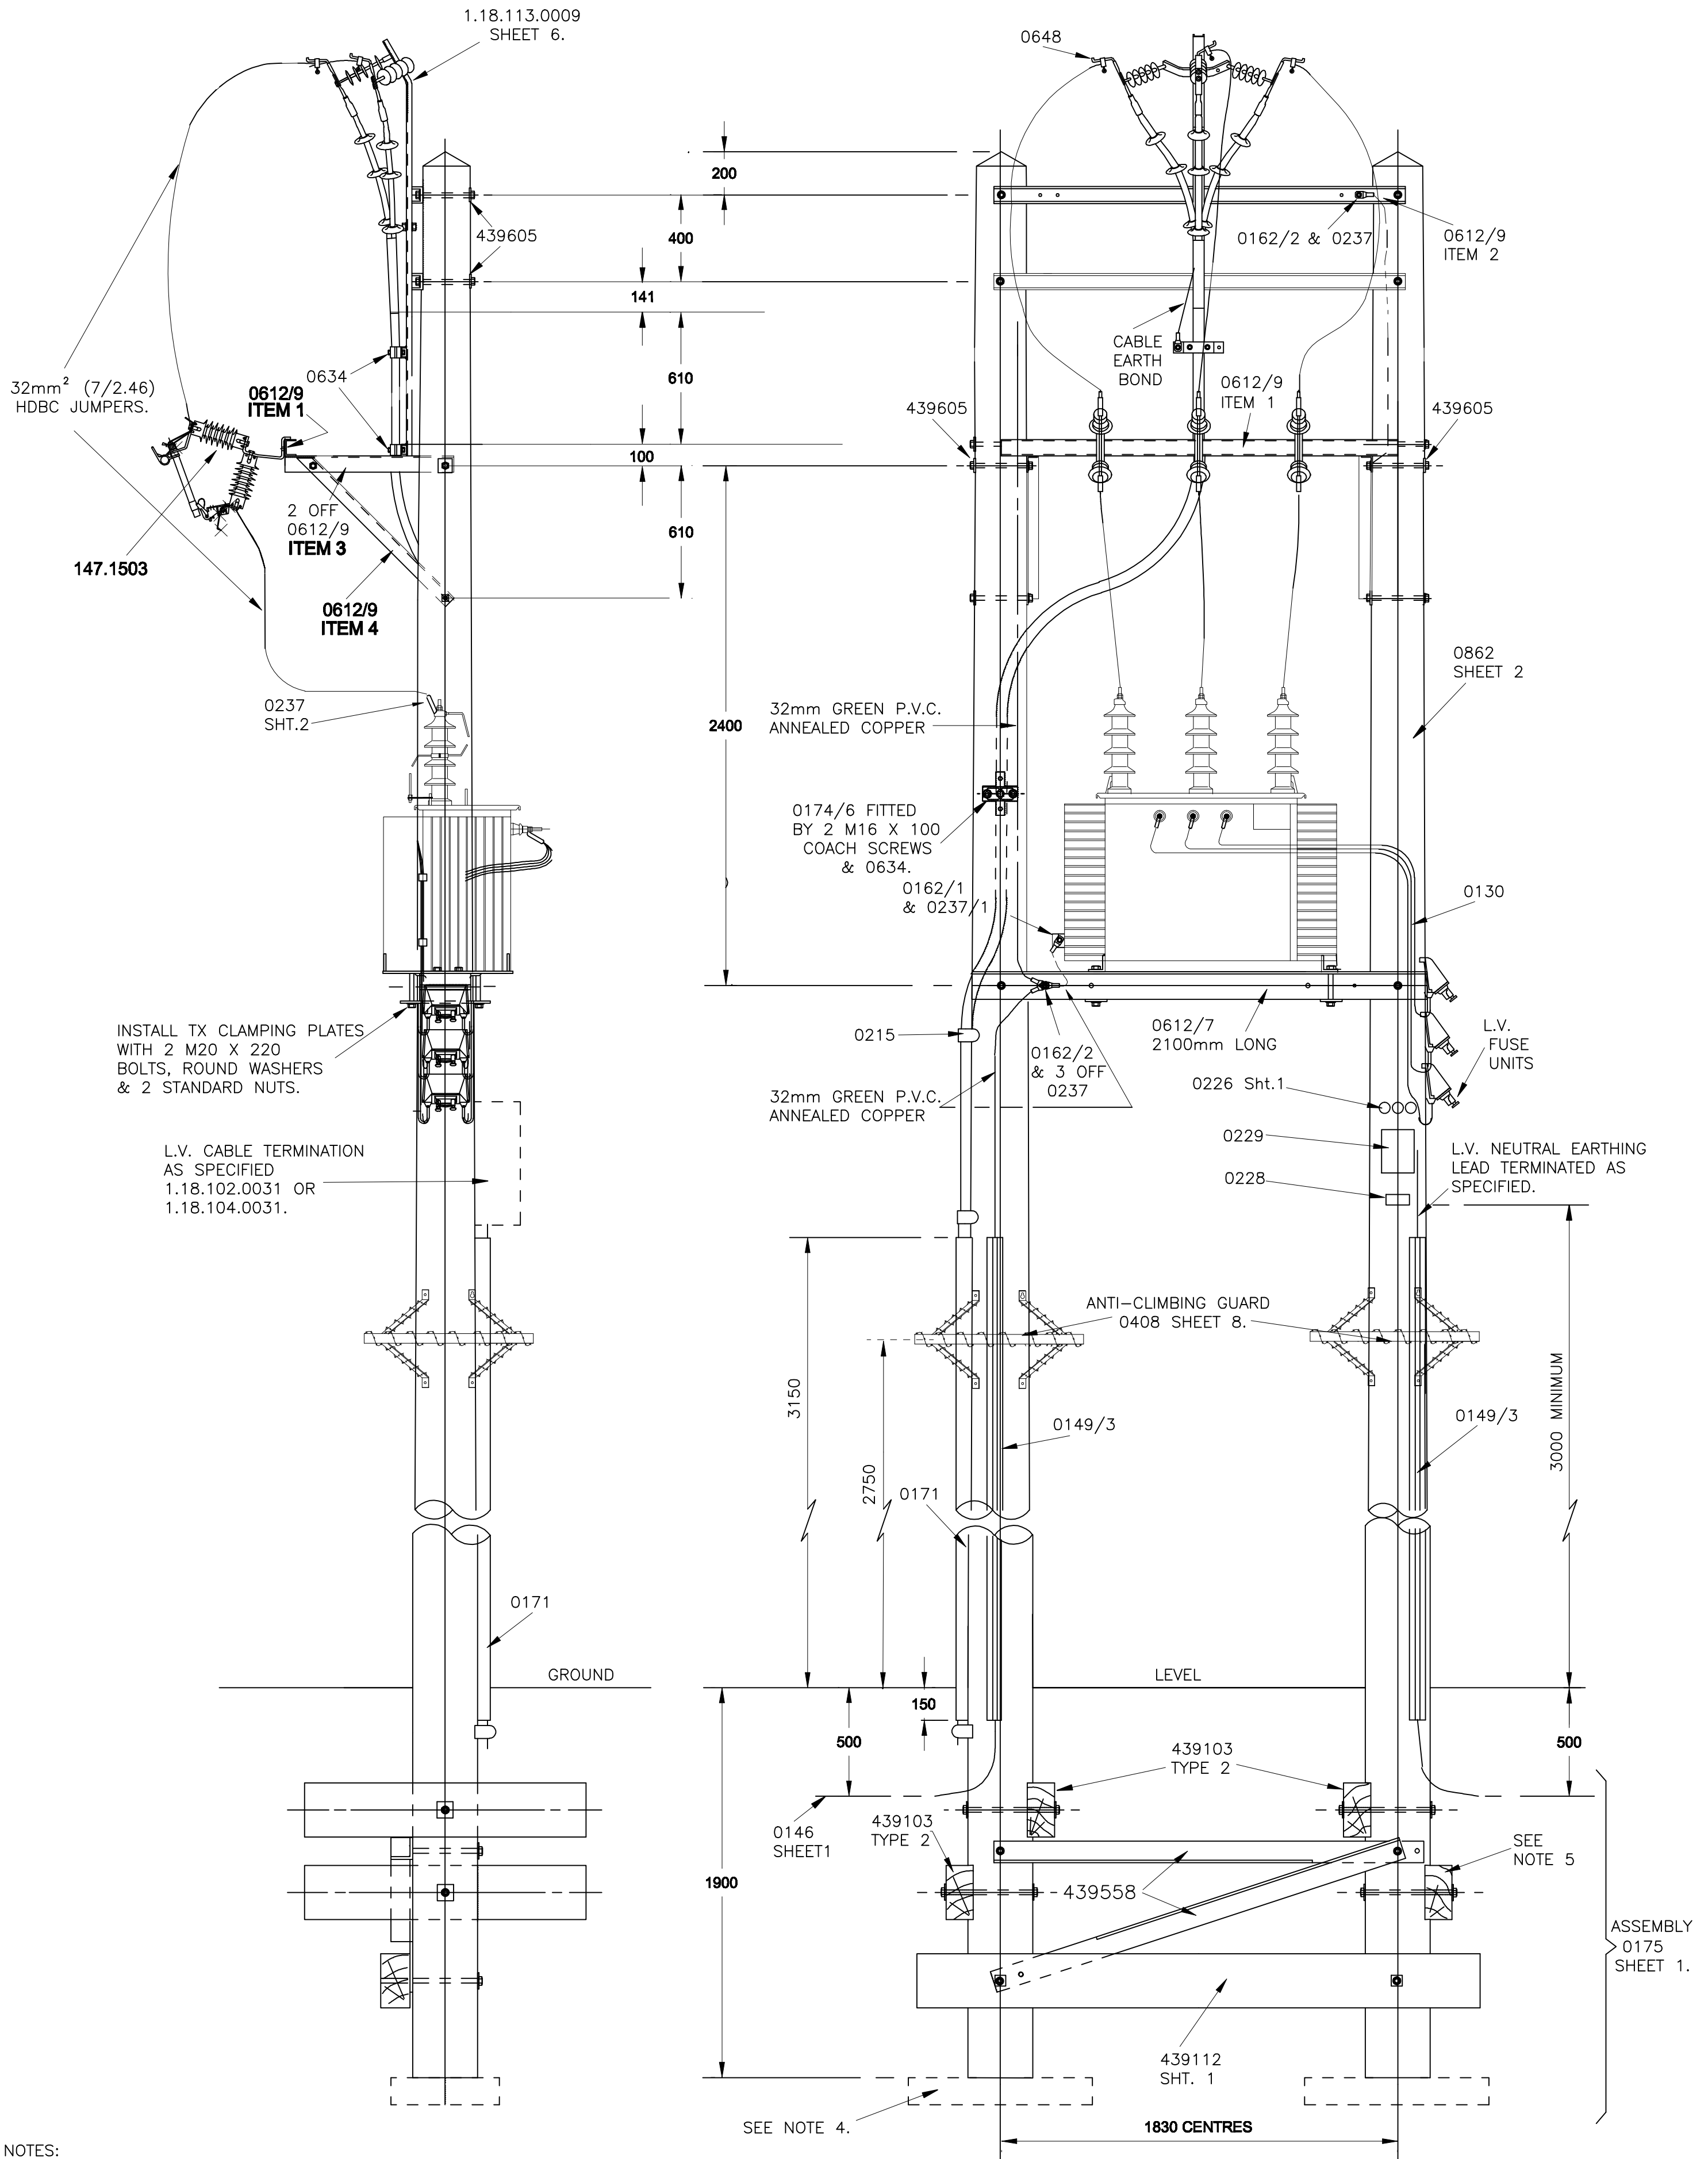

NOTES:

1. STANDARD POLE LENGTH 11.0m.
2. FOR GENERAL SUBSTATION EARTHING SEE POWER INSTRUCTION FOR EARTHING P2500.
3. DETAIL DRGS. PREFIXED 43.... REFER TO E.S.I. BASED DRGS. OTHER DETAIL DRGS. REFER TO 1.09.101.SERIES.
4. 439103 TYPE 2 BLOCKS LAID TOGETHER TO FORM A FOOTING WHERE UNSUITABLE GROUND CONDITIONS EXIST.
5. LOWER BLOCKS MAY BE OMITTED WHERE GOOD GROUND CONDITIONS EXIST.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04/091.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11KV 20KV OVERHEAD LINES THREE PHASE TOTEM 'H' POLE MOUNTED S S WITH HV FUSE AND CABLE TERMINATION	
Sheet No. 3	Scale 1:20	Type OVERHEAD	
Prepared By Barbara Simpson		Ref No. C101716	Historic Drg.No. 1091080862
Revised 12/04/06	Grid Reference	Revision F Notes	
Date Issued 21/02/05	Checked By G HAMMEL		