


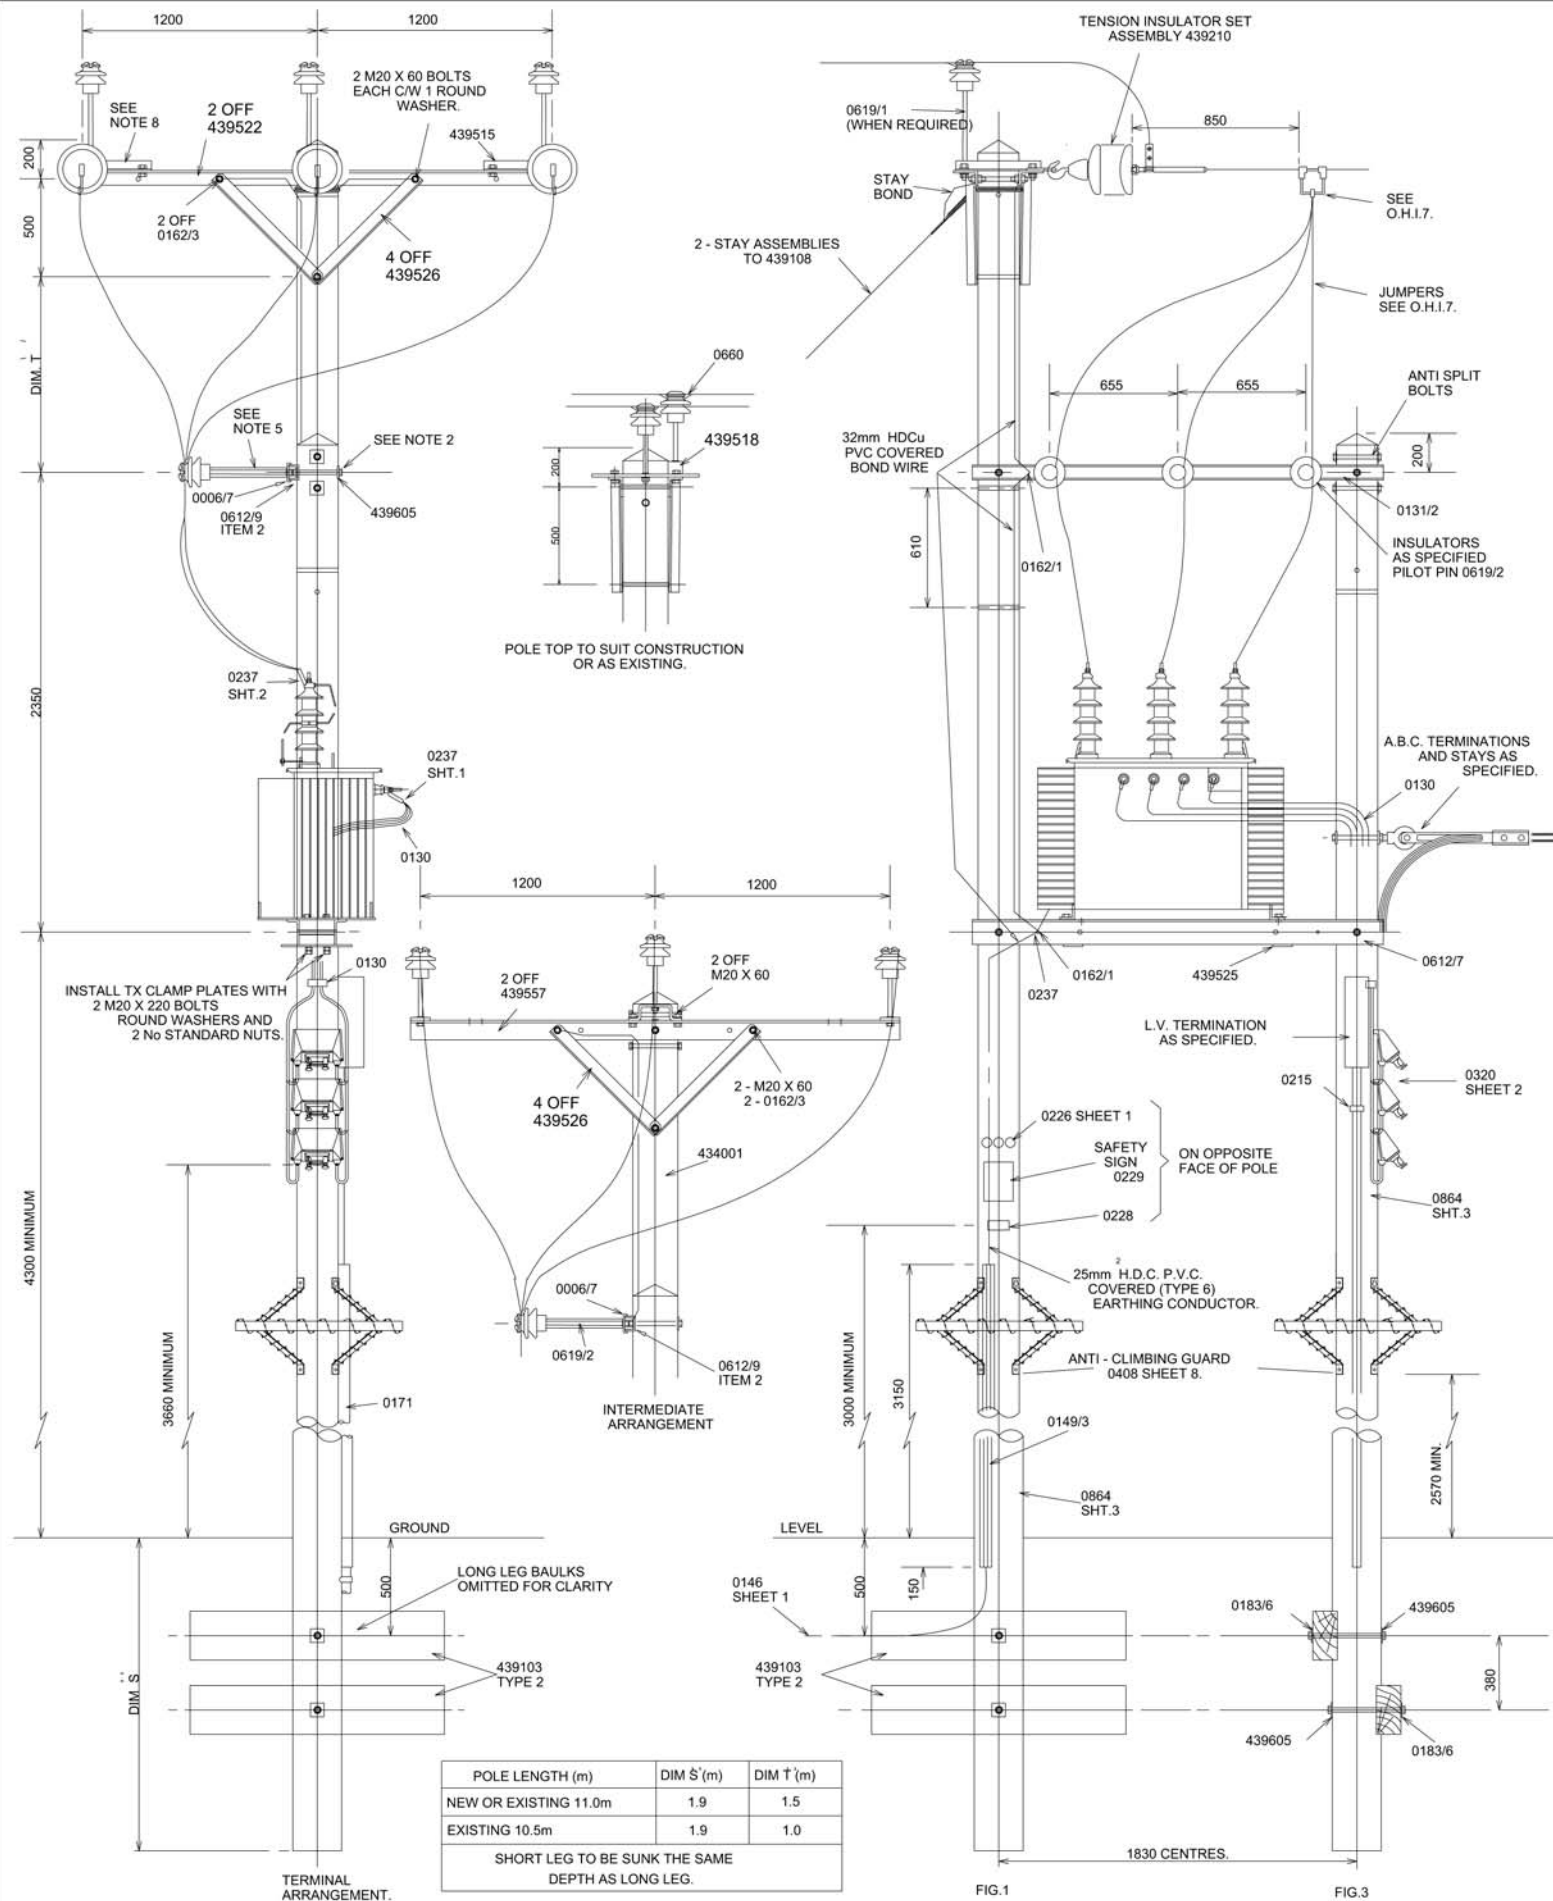

NOTES:

1. STANDARD POLE HEIGHTS FOR COMPLETE NEW ARRANGEMENTS 11.0m LONG LEG, 9.0m SHORT LEG.

2. WHERE J&P'S ARE REQUIRED THE POLE SHALL BE DRESSED AS SHOWN ON 0864 SHEET 2.

3. SEE CODE OF PRACTICE FOR EARTHING E 500.

4. DETAIL DRAWINGS PREFIXED 43... REFER TO E.S.I. DRAWINGS AND OTHER

DETAIL DRAWINGS REFER TO 1.09.101... SERIES.

5. TUBULAR BIRDCARDS TO BE FITTED TO 20kV EARTHED HOLES.

6. ALL UNUSED POLE BOLT HOLES TO BE PLUGGED.

7. ALL POLE BOLTS TO BE M20.

8. WHERE THIS ARRANGEMENT IS USED WITH CONDUCTOR C.S.A. OF 50mm AAAC

OR LESS, THE CROSSARM BRACE (439515) MAY BE OMITTED.

9. MAX TRANSFORMER SIZE 315KVA @ 11kV

200KVA @ 20kV

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04/094.

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
11kV AND 20kV OVERHEAD LINES GENERAL ASSEMBLY OF 'H' POLE WITH THREE PHASE IN LINE POLE MOUNTED TRANSFORMER			
Manufacturer Details		Type OVERHEAD	
Sheet No. 1	Scale 1:20		
Prepared By Barbara Simpson			
Revised 12/04/06	Grid Reference		
Date Issued 19/07/99	Checked By G HAMMEL		
Ref No. C101717		Historic Drg. No. 1091080864	
Revision H		Notes	