


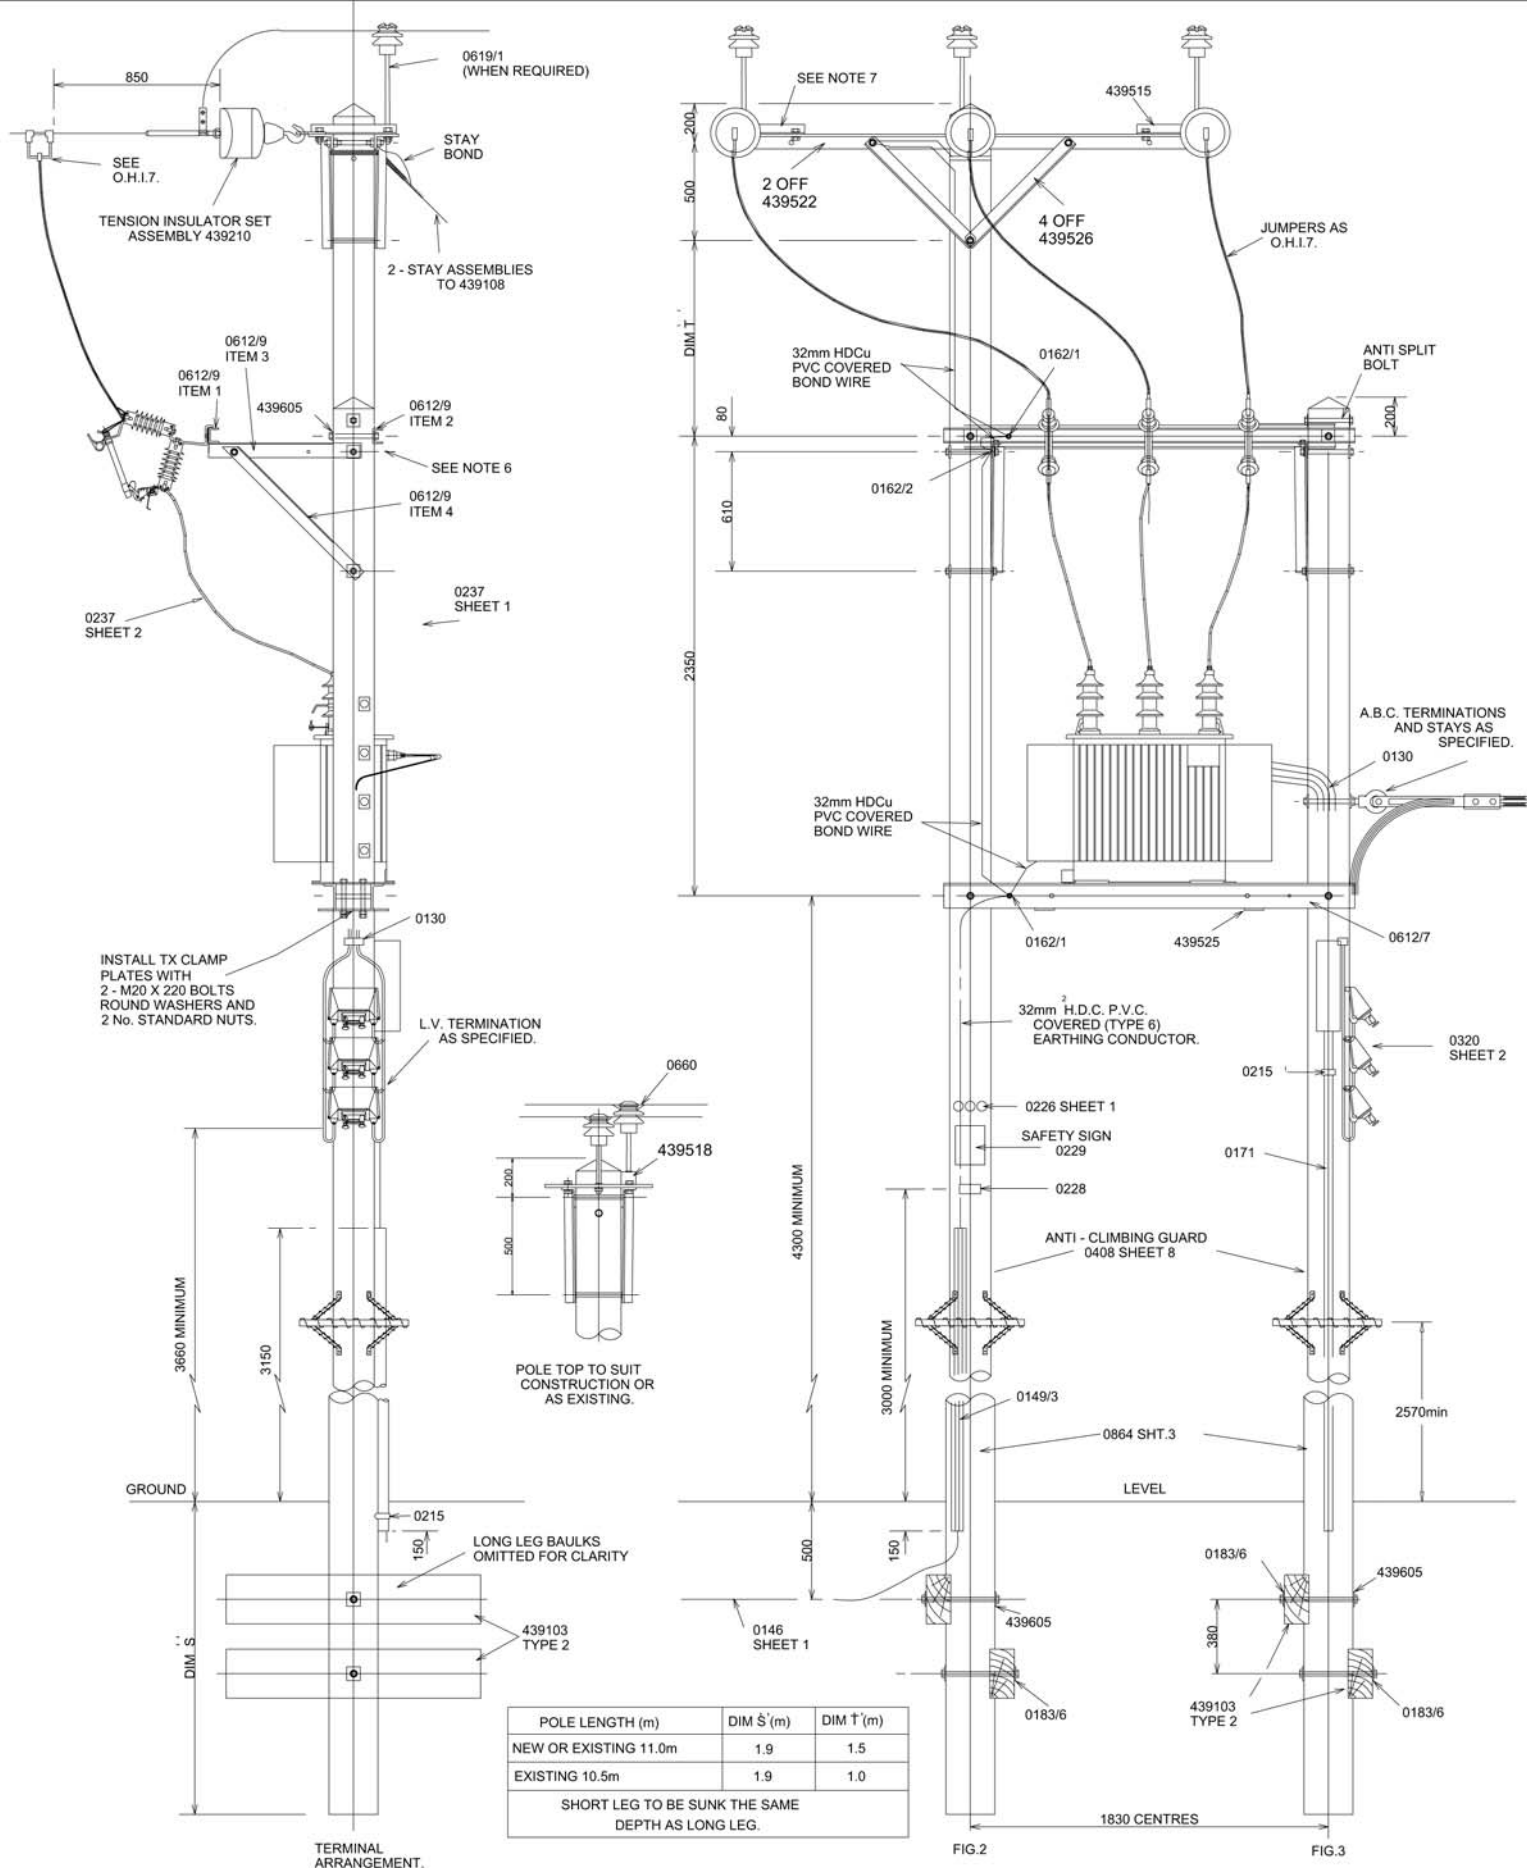

NOTES:

- STANDARD POLE HEIGHTS FOR COMPLETE NEW ARRANGEMENTS, 11.0m LONG LEG, 9.0m SHORT LEG.
- EXISTING MEDIUM GRADE LONG LEGS MAY BE UTILISED BUT ALL NEW LEGS WILL BE STOUT.
- POLE BOLTS TO BE M20.
- DETAIL DRAWINGS PREFIXED 43... REFER TO E.S.I. BASED DRAWINGS. OTHER DETAIL DRAWINGS REFER TO 1.09.101. SERIES.
- ALL UNUSED POLE BOLT HOLES TO BE PLUGGED.
- WHERE FUSES ARE NOT REQUIRED, POLE SHALL BE DRESSED AS INDICATED ON 0864 SHEET 1.
- WHERE THIS ARRANGEMENT IS USED WITH CONDUCTOR C.S.A. OF 50mm AAAC OR LESS, THE CROSSARM BRACE (439515) MAY BE OMITTED.
- MAXIMUM TRANSFORMER SIZE 315kVA @ 11kV
200kVA @ 20kV

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No. 04/094

CE Electric UK Manufacturer Details		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Sheet No. 2 Prepared By Jonis Webb	Scale 1:20	11kV AND 20kV OVERHEAD LINES. TERMINAL OR INTERMEDIATE POLE ASSEMBLY OF 'H' POLE WITH 3 PHASE POLE MOUNTED TRANSFORMER ARRANGEMENT AT RIGHT ANGLES TO MAIN LINE	
Revised 18/04/06 Date Issued 20/07/99	Grid Reference Checked By G HAMMEL	Type OVERHEAD LINES Ref No. C101718	Historic Drg. No. 1091080864
Revision H		Notes	