



1.18.113.0009
SHEET 6

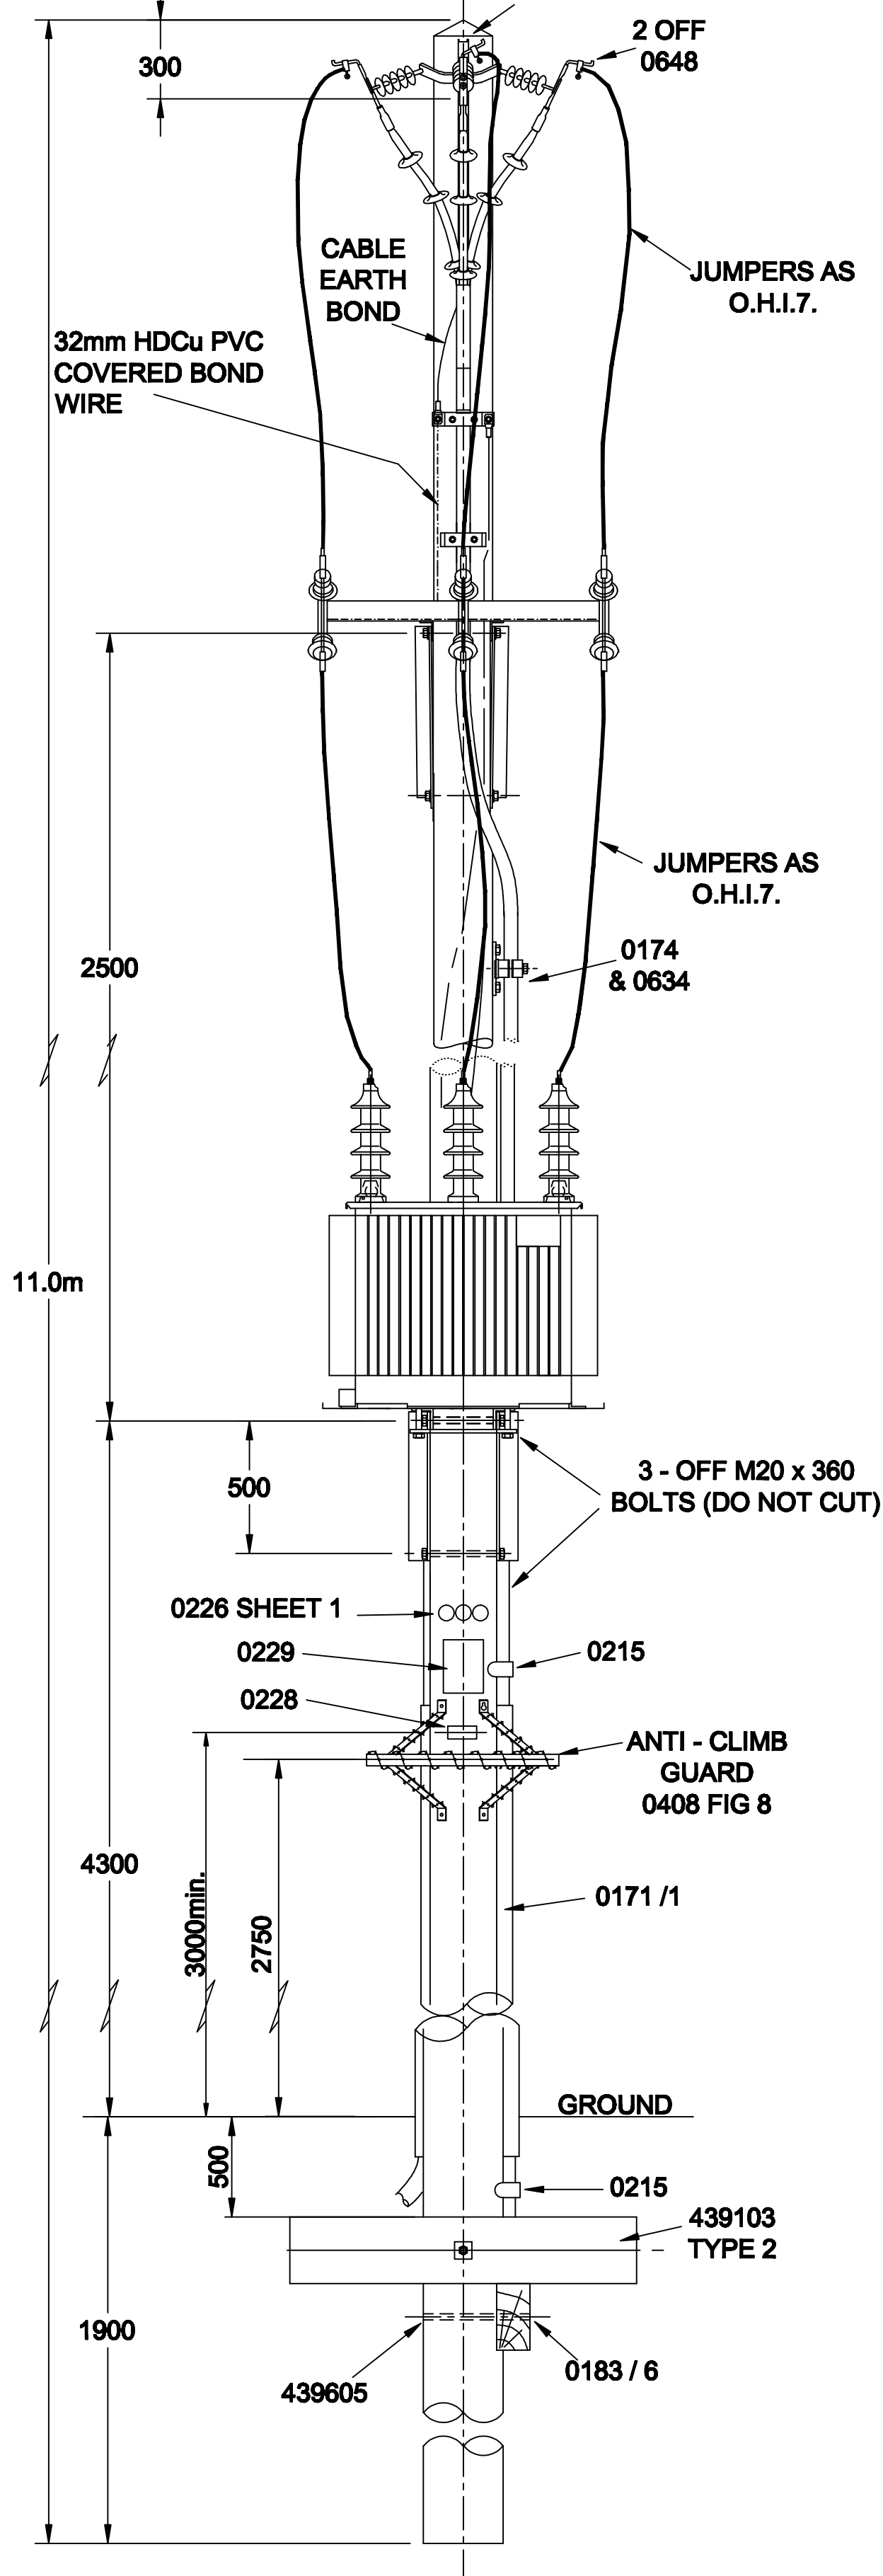

NOTES:-

1. POLE LENGTH TO BE 11.0m
2. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS. OTHER DETAIL DRAWINGS REFER TO 1.09.101 SERIES
3. TRANSFORMER CAPACITY 100kVA MAX (PLATFORM MOUNTED) (11kV)
TRANSFORMER CAPACITY 50kVA MAX (PLATFORM MOUNTED) (20kV)

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

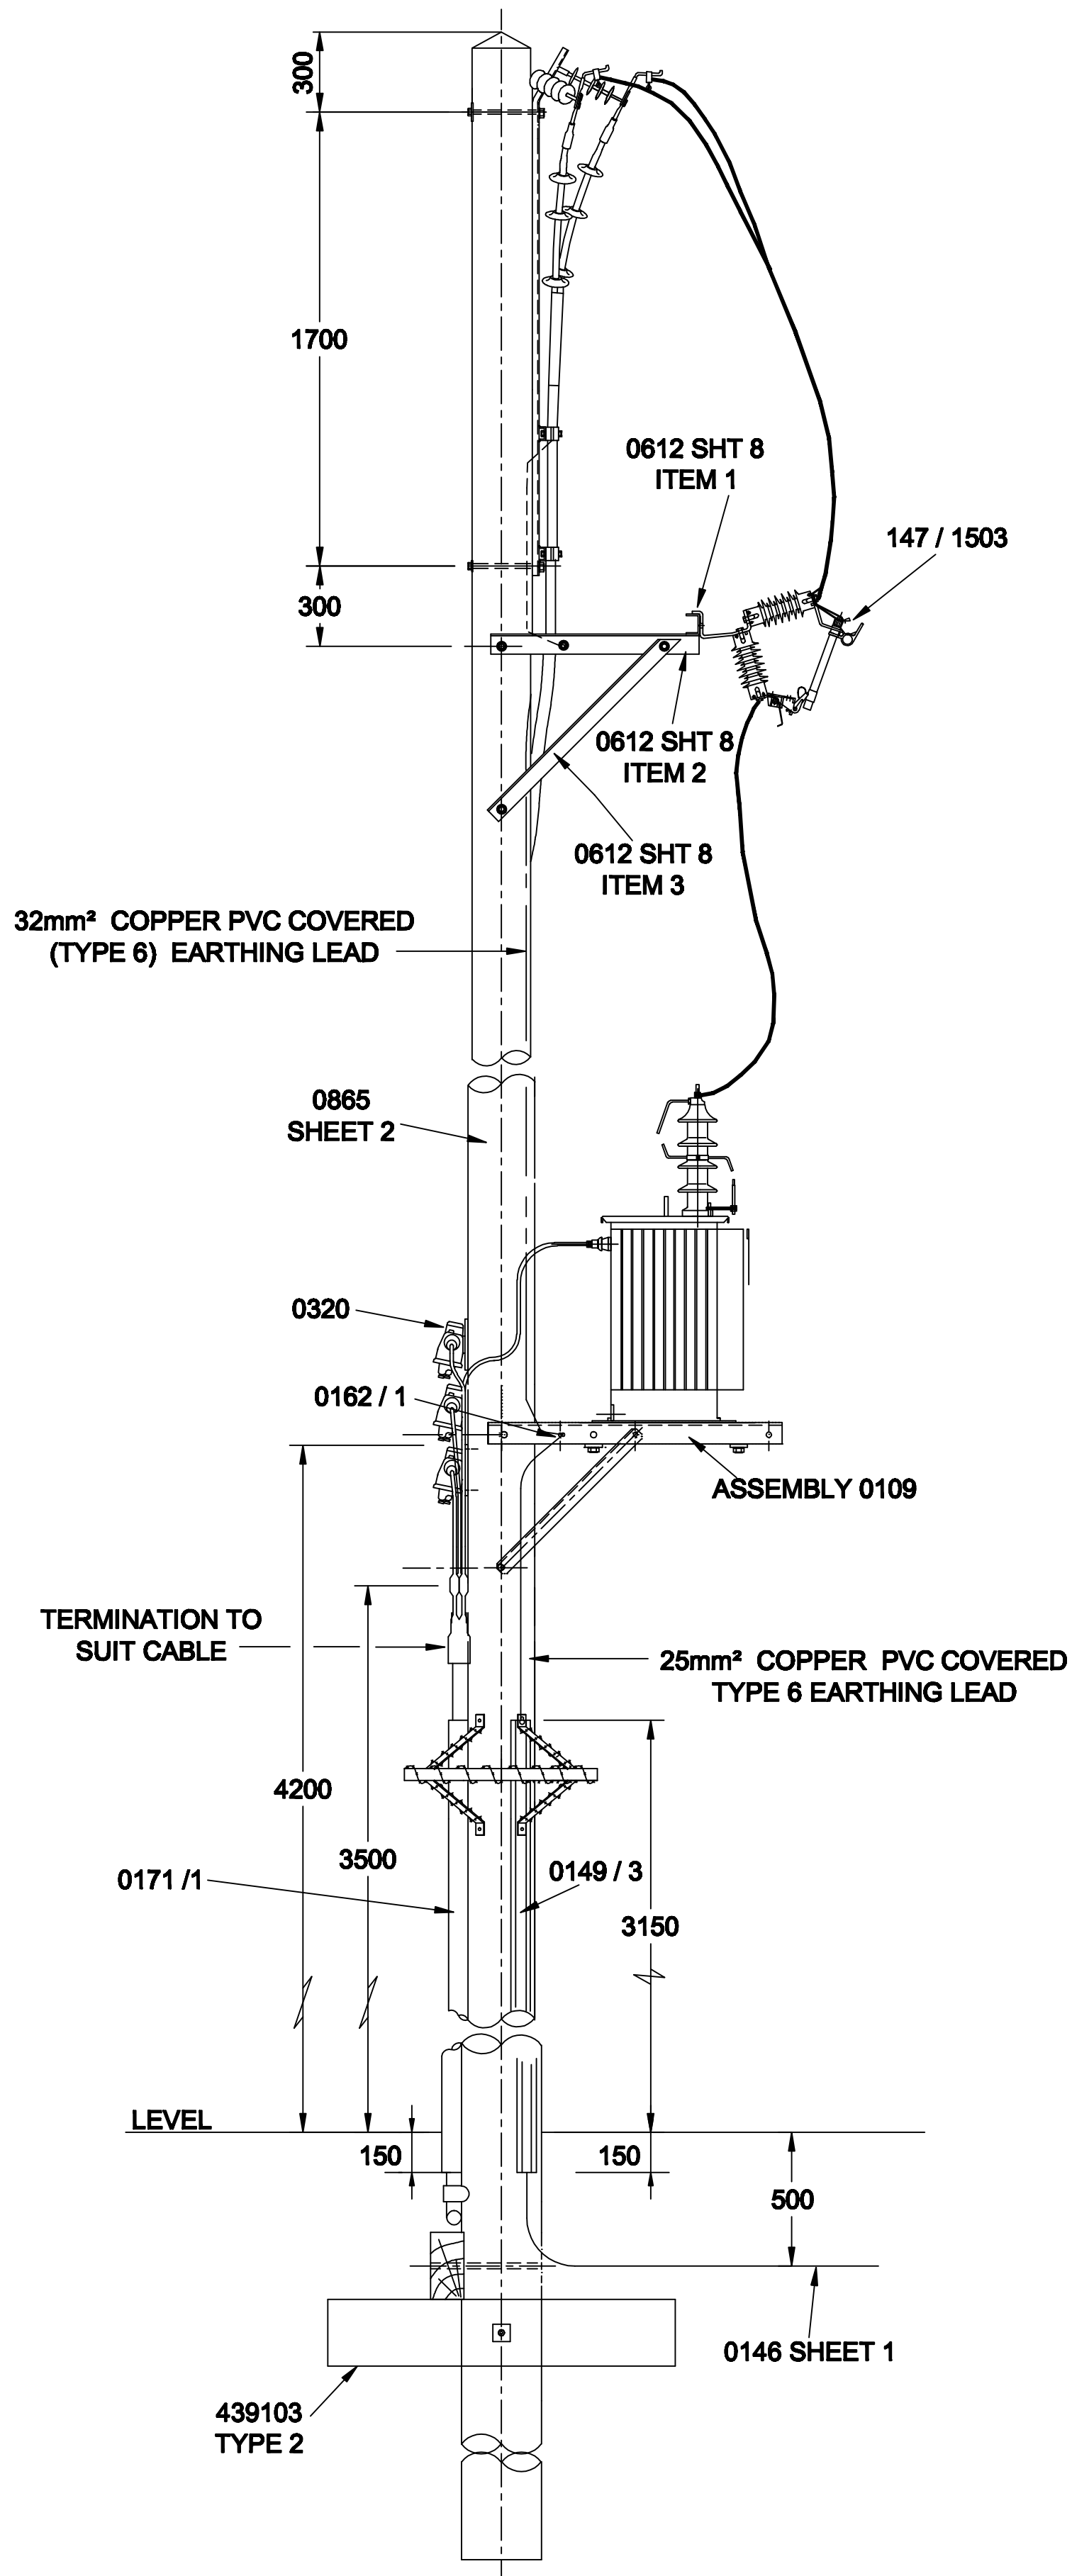

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC REF No 04 / 88

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11kV AND 20kV OVERHEAD LINES THREE PHASE TOTEM POLE SUBSTATION WITH WITH HV FUSE UNIT AND HV SUPPLY OFF U/G CABLE & U/G SUPPLY TO L.V. NETWORK	
Sheet No. 1	Scale 1:20	Type OVERHEAD	LINES
Prepared By Janis.Webb	Grid Reference	Ref No. C101720	Historic Drg.No. 1091080865
Revised 18/04/06	Checked By G HAMMEL	Revision D	Notes
Date Issued 13/05/98			