



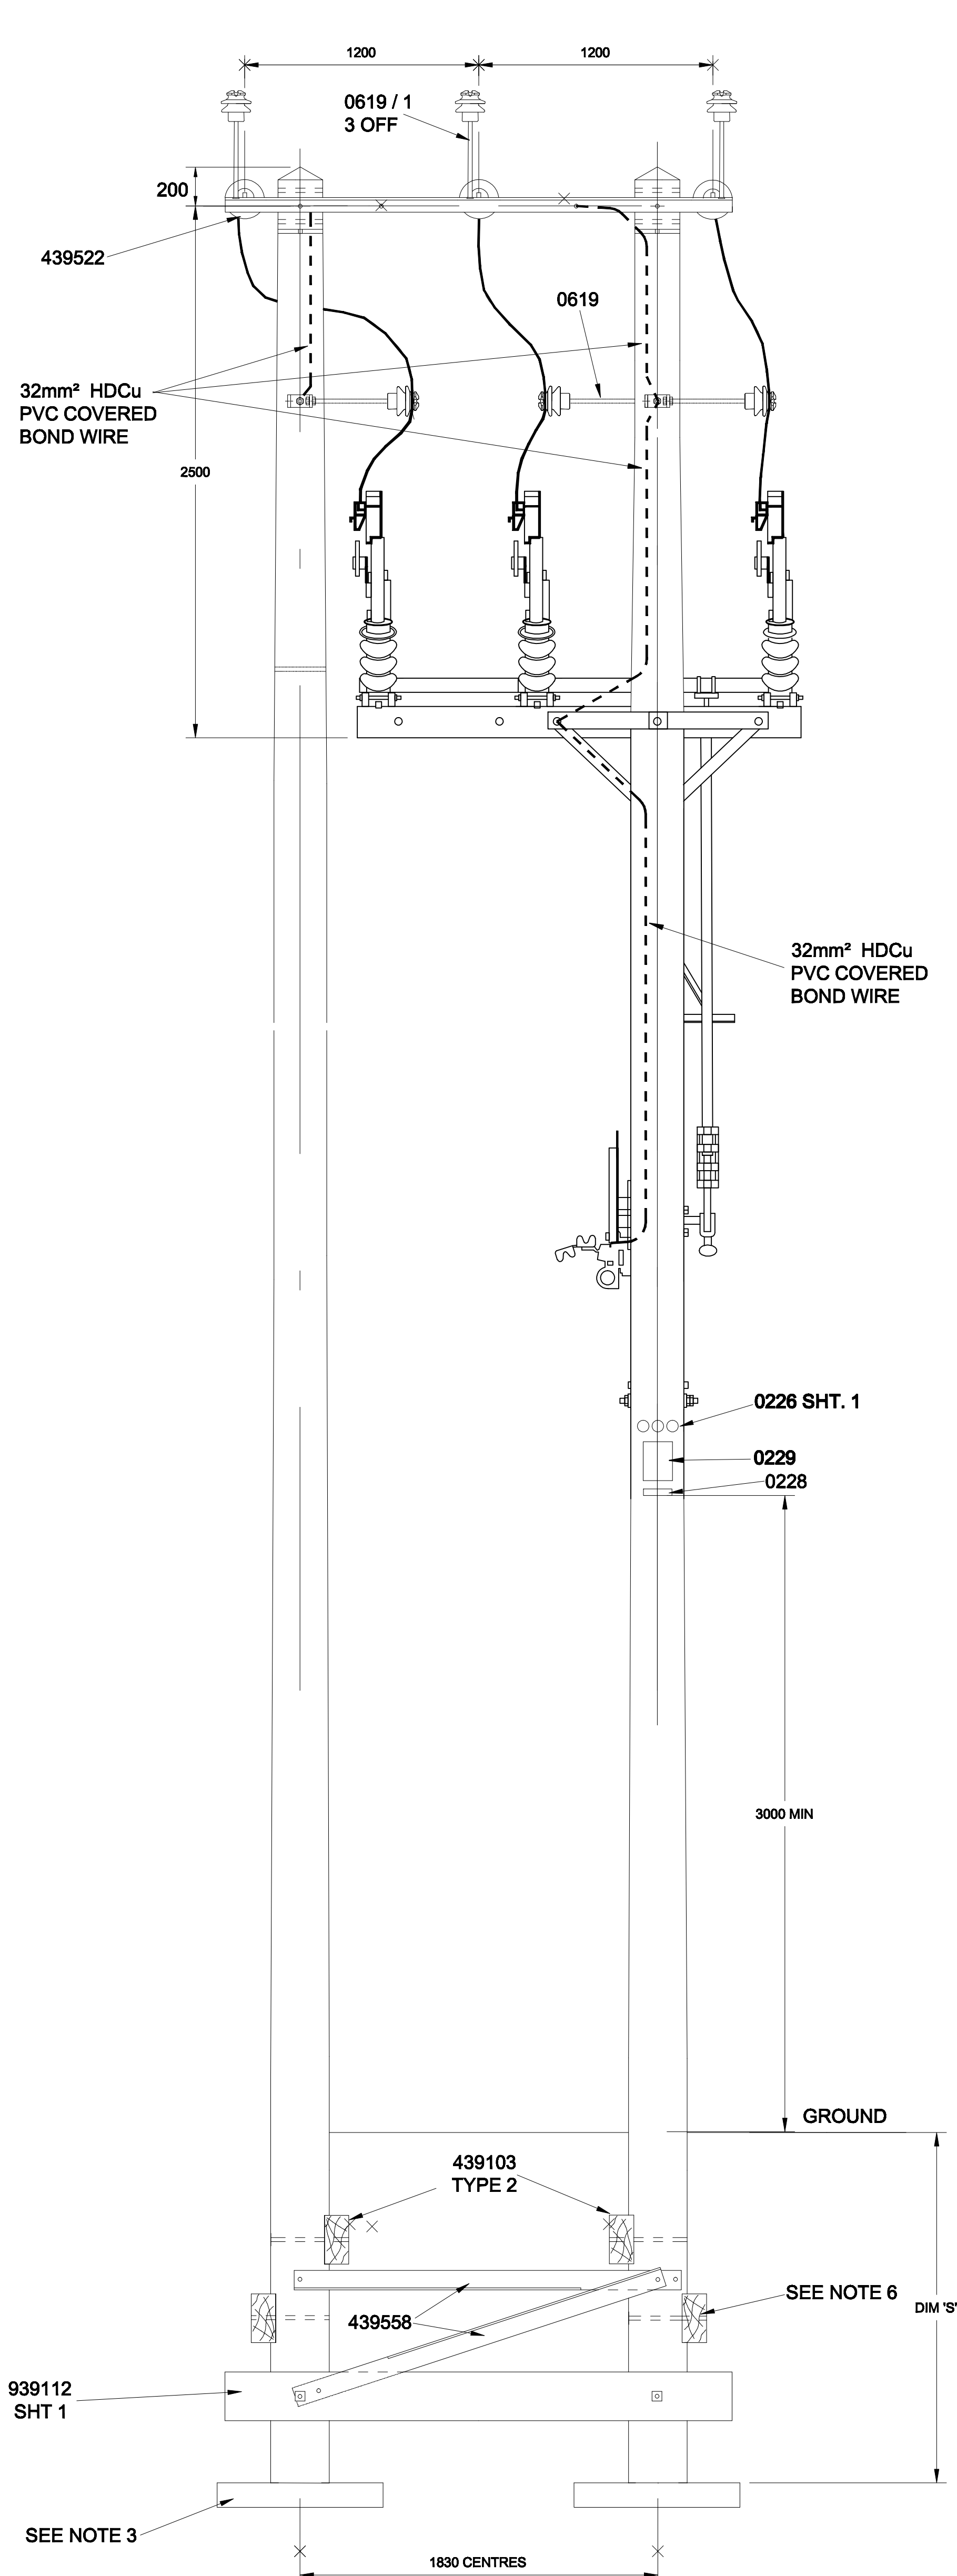

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS 439605 AT POLE TOP
 3. 439103 TYPE 1 BLOCKS LAID TOGETHER TO FORM A FOOTING WHERE UNSUITABLE GROUND CONDITIONS EXIST
 4. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I BASED DRAWINGS OTHER DRAWINGS REFER TO 1.09.101..... SERIES
 5. AT ROAD CROSSING SUPPORTS, MINIMUM REGULATION ROAD CONDUCTOR CLEARANCES MUST BE PROVIDED TO THE LOWERMOST JUMPER
 6. THE LOWERMOST BLOCK MAY BE OMITTED WHERE GOOD GROUND CONDITIONS EXIST

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

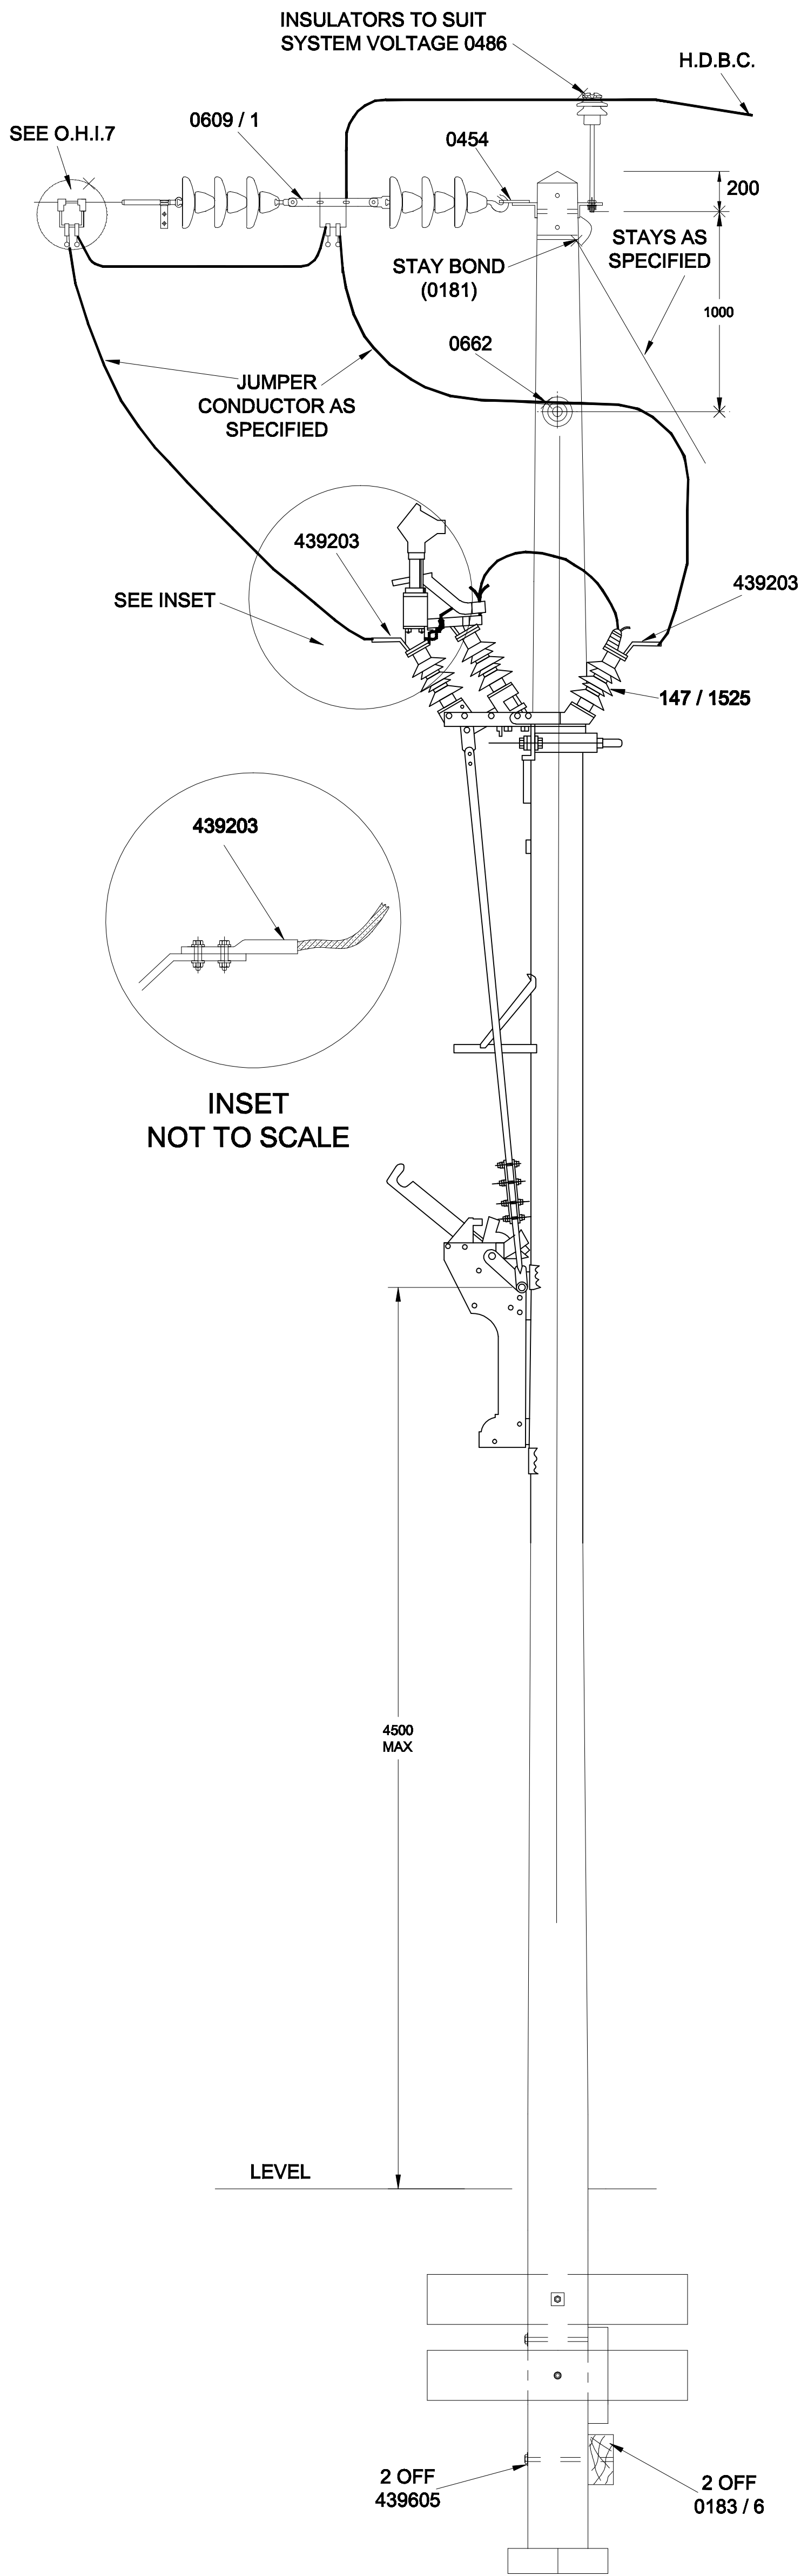

POLE LENGTH	DIM 'S'
11.0m INCLUSIVE	1.9m
12.0m - 14.0m	2.1m
15.0	2.4m
16.0m TO 20.0m INCLUSIVE	2.4m

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC REF. No 04 / 294

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11kV AND 20kV OVERHEAD LINES LAY TERMINAL SUPPORT WITH ROCKING TYPE AERIAL ISOLATORS	
Sheet No. 3	Scale 1:20	Type OVERHEAD	LINES
Prepared By Jonis Webb	Grid Reference	Ref No. C406468	Historic Drg.No. 1091090906
Revised 19/01/07	Checked By G HAMMEL	Revision G	Notes
Date Issued 28/11/05			