



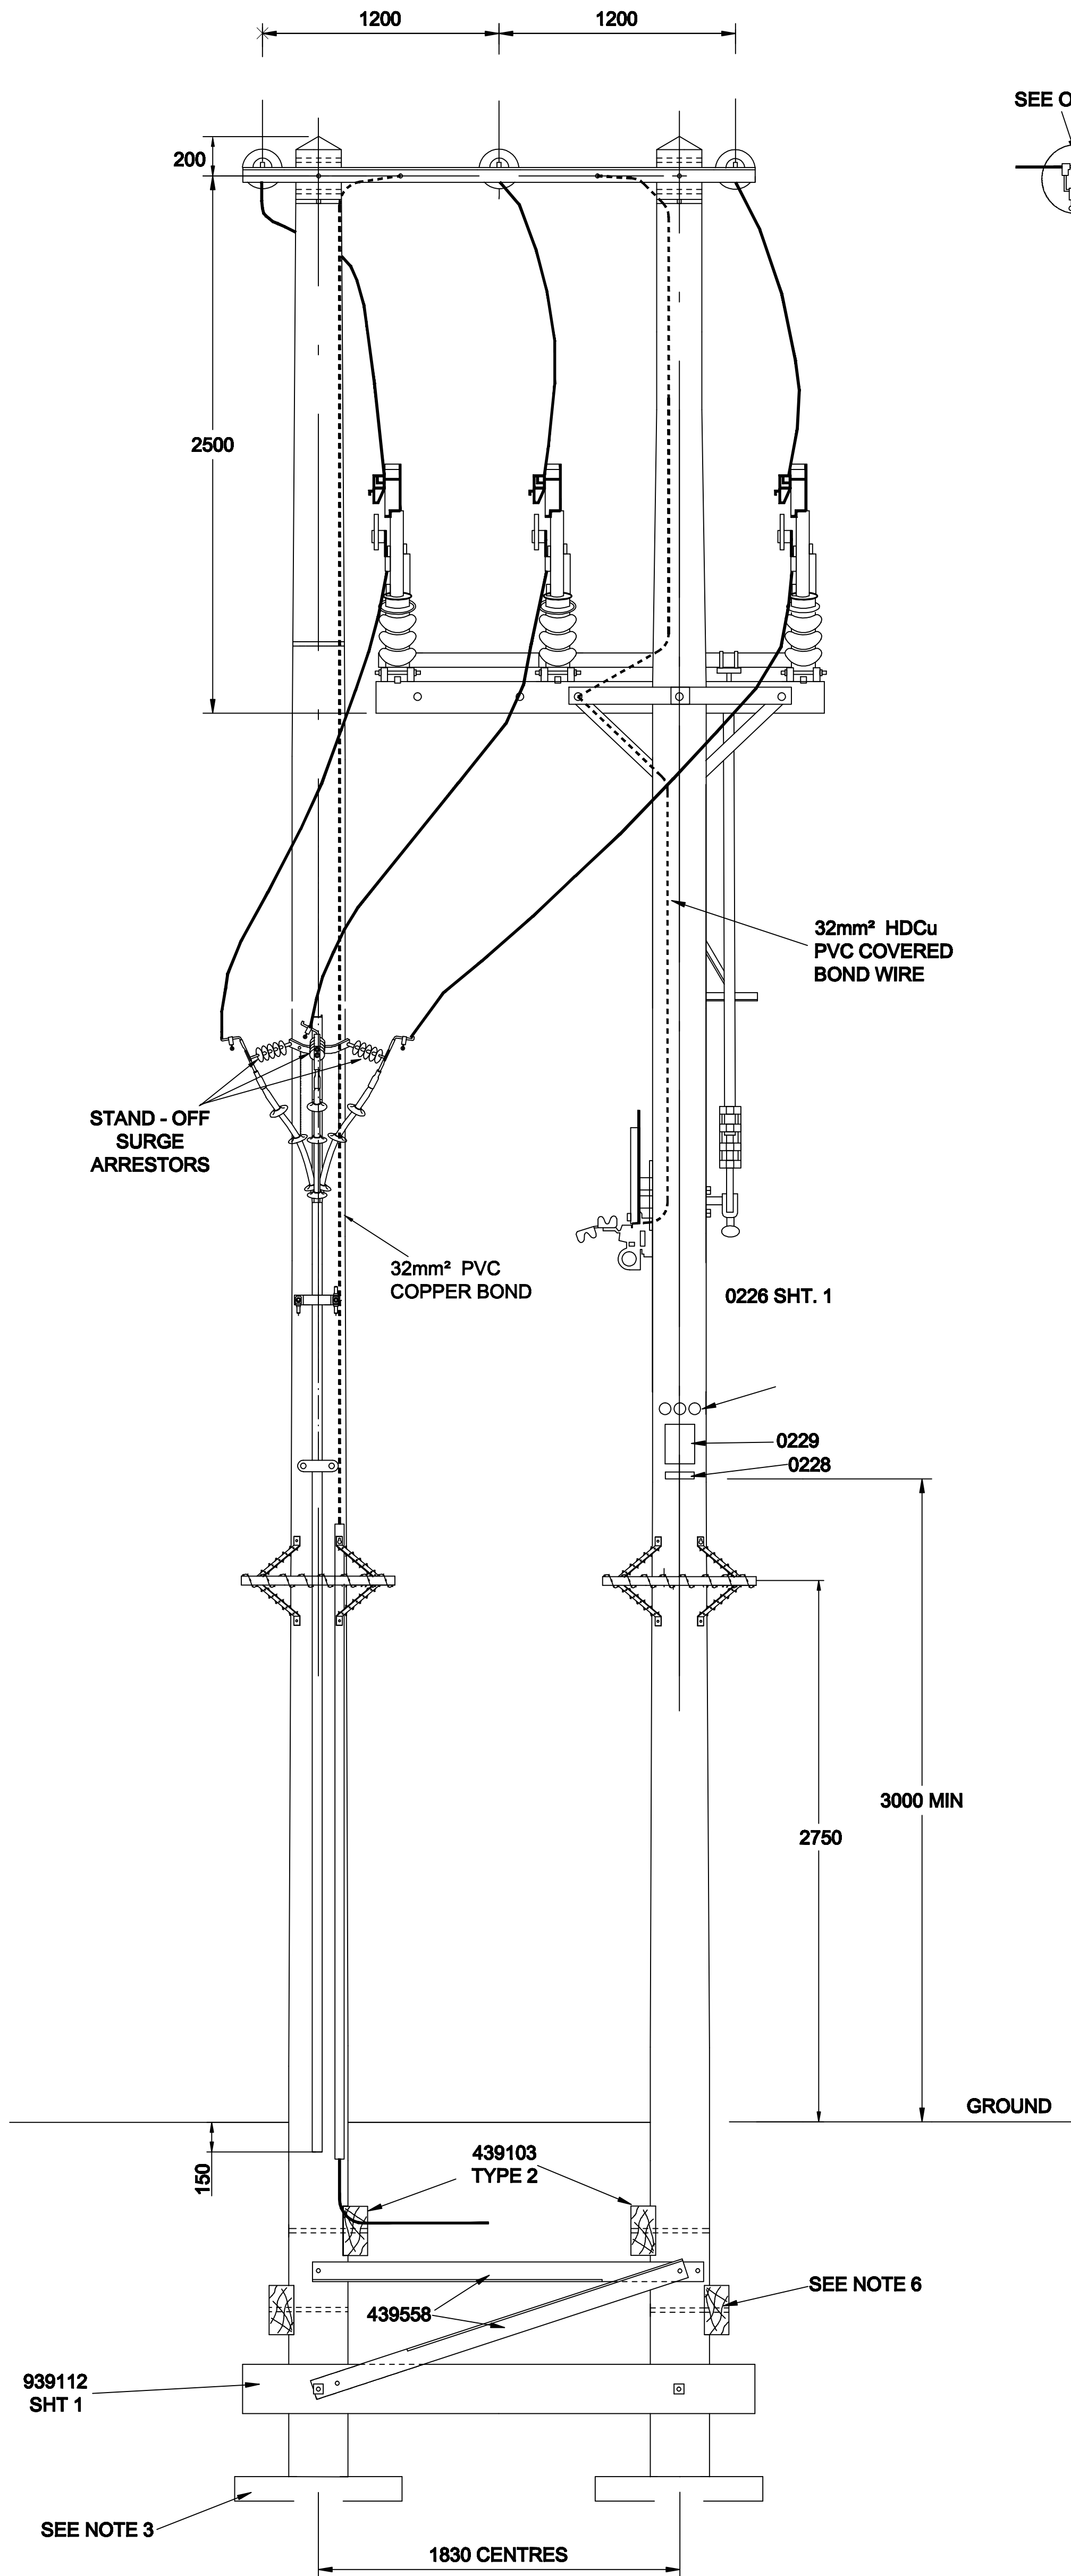

NOTES

1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS 439605 AT POLE TOP
3. 439103 TYPE 1 BLOCKS LAID TOGETHER TO FORM A FOOTING WHERE UNSUITABLE GROUND CONDITIONS EXIST
4. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I BASED DRAWINGS OTHER DRAWINGS REFER TO 1.09.101..... SERIES
5. AT ROAD CROSSING SUPPORTS, MINIMUM REGULATION ROAD CONDUCTOR CLEARANCES MUST BE PROVIDED TO THE LOWERMOST JUMPER
6. THE LOWERMOST BLOCK MAY BE OMITTED WHERE GOOD GROUND CONDITIONS EXIST

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

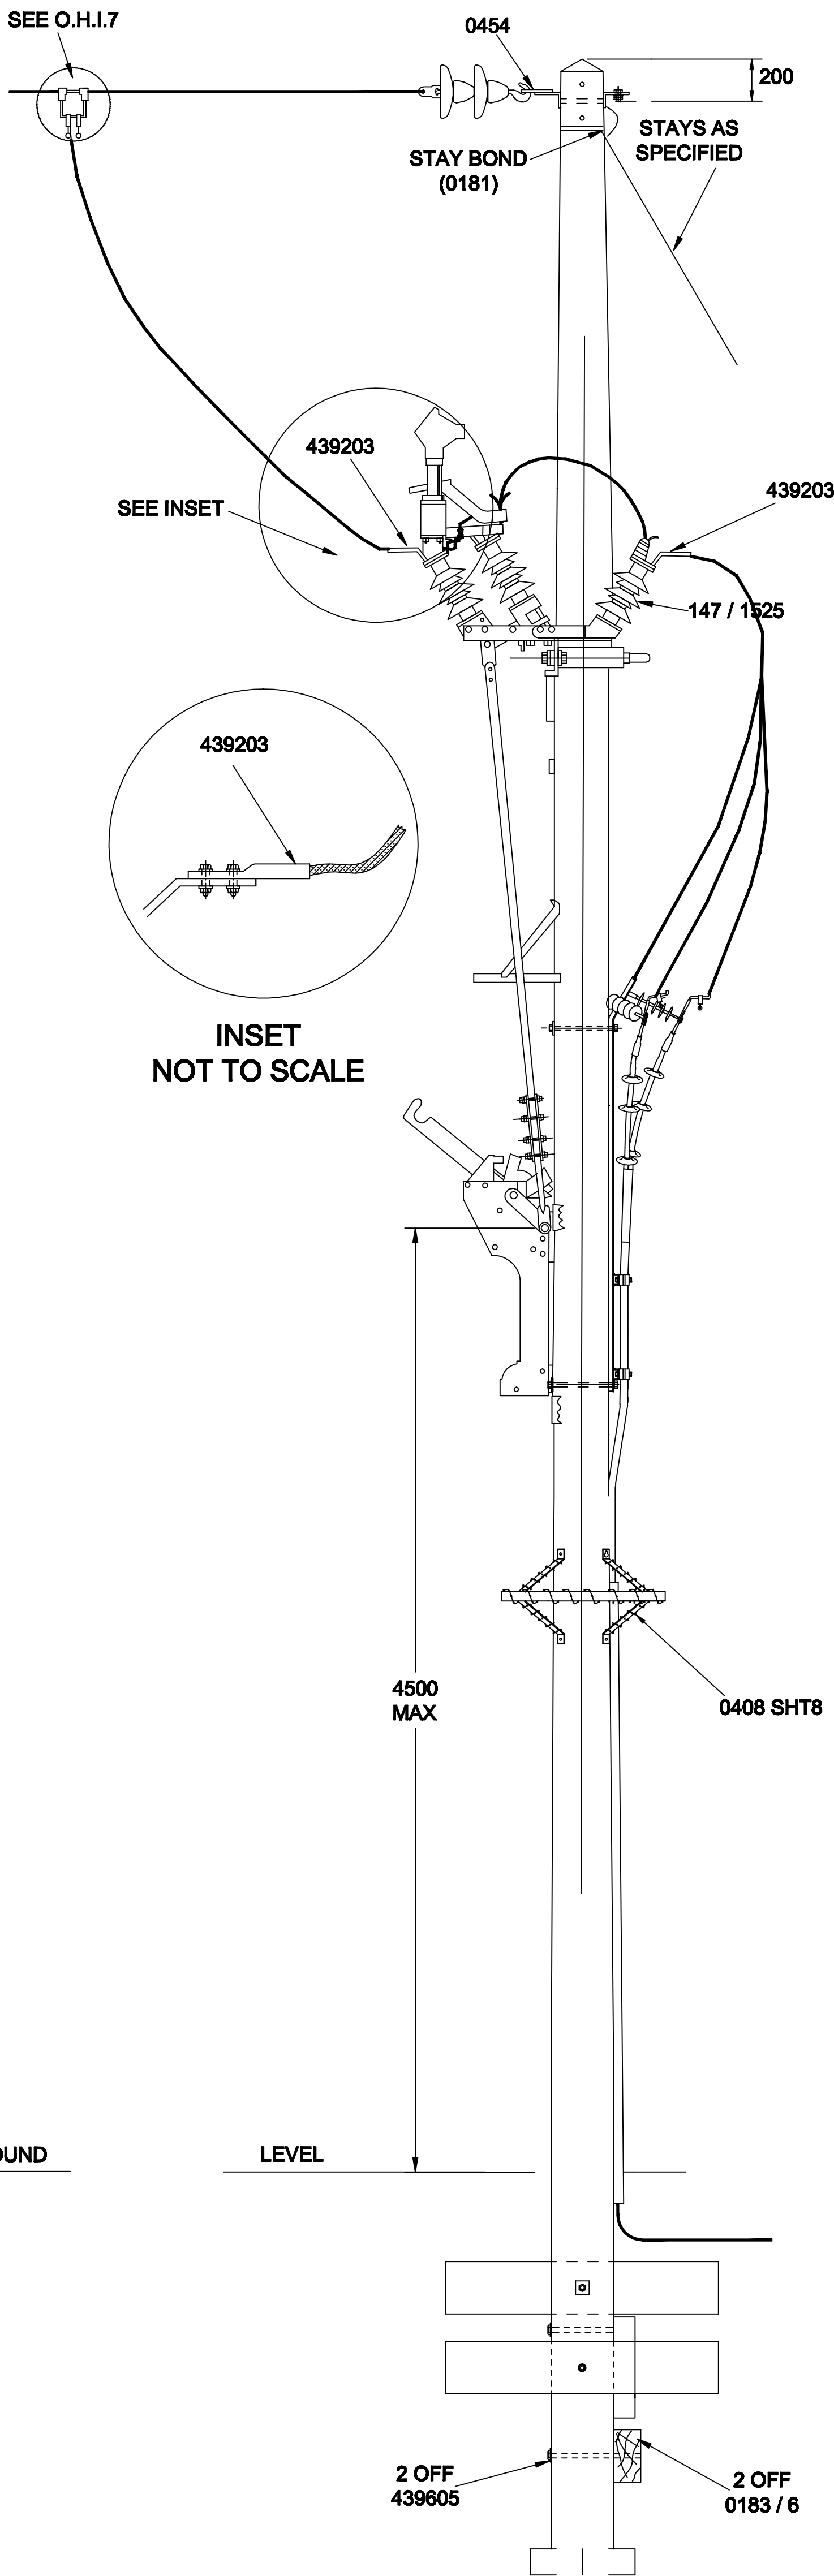

POLE LENGTH	DIM 'S'
11.0m INCLUSIVE	1.9m
12.0m - 14.0m	2.1m
15.0	2.4m
16.0m TO 20.0m INCLUSIVE	2.4m

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC REF. No 04 / 294

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11KV AND 20KV OVERHEAD LINES TERMINAL 'H' WITH A B S D AND CABLE TERMINATION	
Sheet No. 11	Scale 1:20	Type OVERHEAD POLES	
Prepared By Andrew Turnbull	Grid Reference	Ref No. C928960	Historic Drg.No. 1091090907
Revised 30/05/05	Checked By G HAMMEL	Revision B	Notes
Date Issued 10/04/06			