


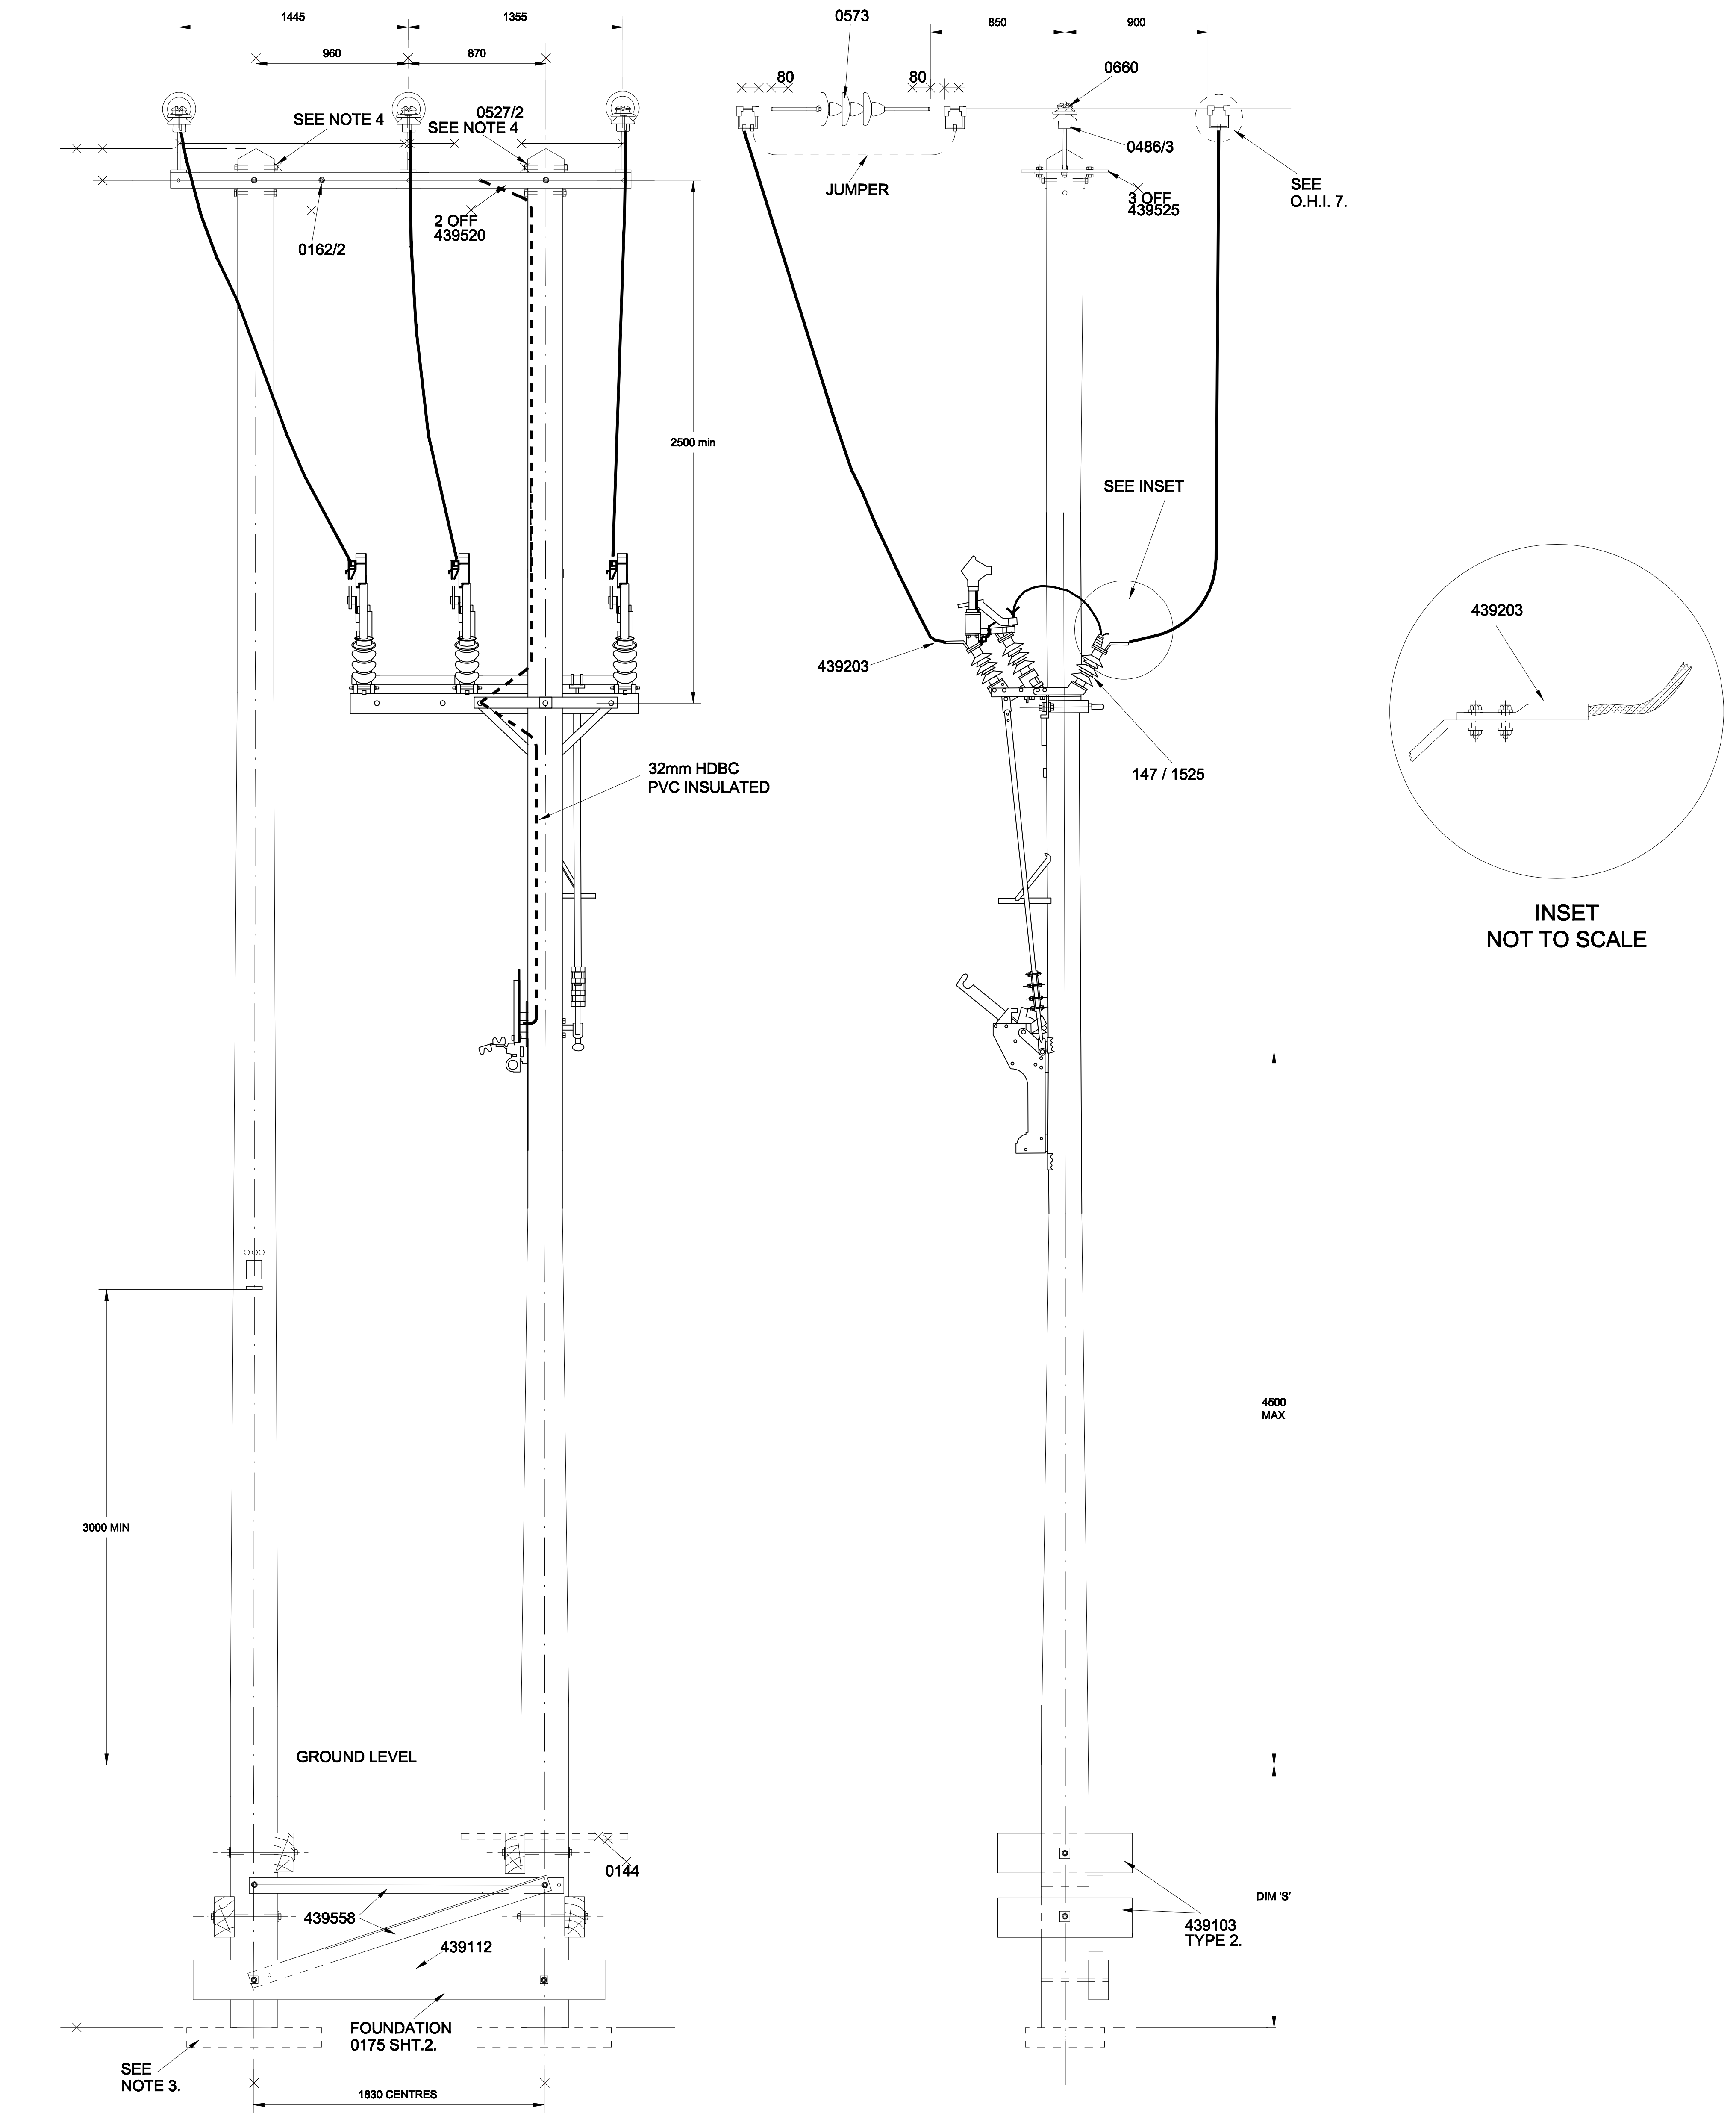

NOTES:-

1. ALL POLE BOLTS TO BE M20 DIA TO BS 4190
2. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS
OTHER DETAIL DRAWINGS REFER TO 1.09.101 SERIES
3. 431903 TYPE 1 BLOCKS LAID TOGETHER TO FORM A FOOTING WHERE UNSUITABLE
GROUND CONDITIONS EXIST
4. FIT 2 - M20 POLE BOLTS WITH 2 WASHERS 439605 AT POLE TOP

POLE LENGTH	DIM 'S'
11.0m INCLUSIVE	1.9m
12.0 TO 14.0m INCLUSIVE	2.1m
15.0m INCLUSIVE	2.4m

THIS DRAWING ALSO REFERRED TO IN WORK SPEC.REF.NO.04/291

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS STATED OTHERWISE.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11/20KV OVERHEAD LINES HORIZONTAL MOUNTED ROCLING TYPE AERIAL ISOLATOR ON 'H' INTERMEDIATE SUPPORT	
Sheet No.	Scale	Type	LINES
1	1:20	OVERHEAD	
Prepared By Jonis, Webb	Grid Reference	Ref No.	C406471
Revised 19/01/07	Checked By G HAMMEL	Historic Drg.No.	1091090908
Date Issued 28/11/05		Revision	N Notes