
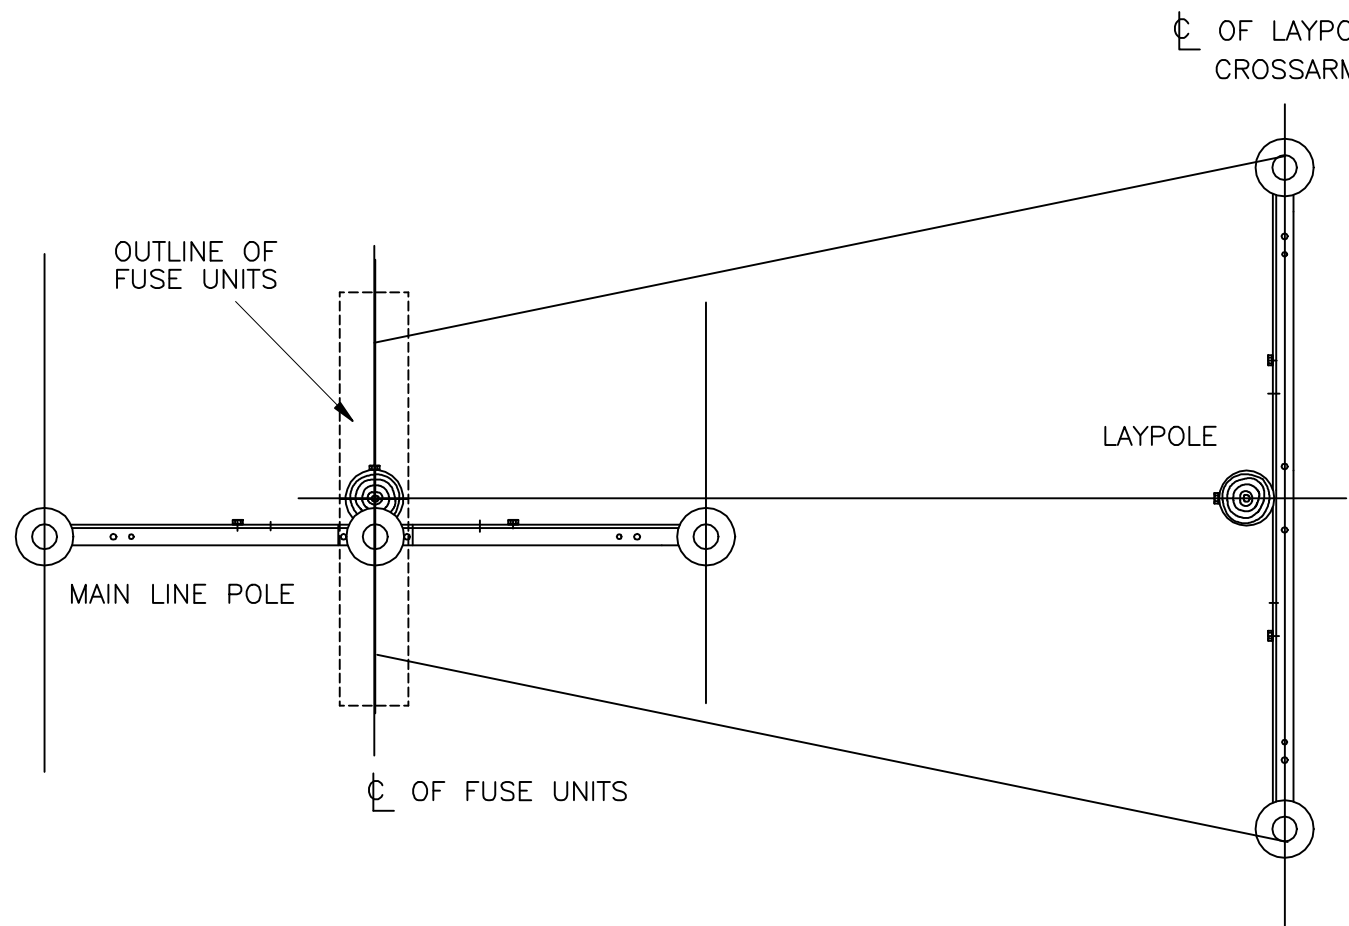


POLE TOP CONSTRUCTION AS SPECIFIED

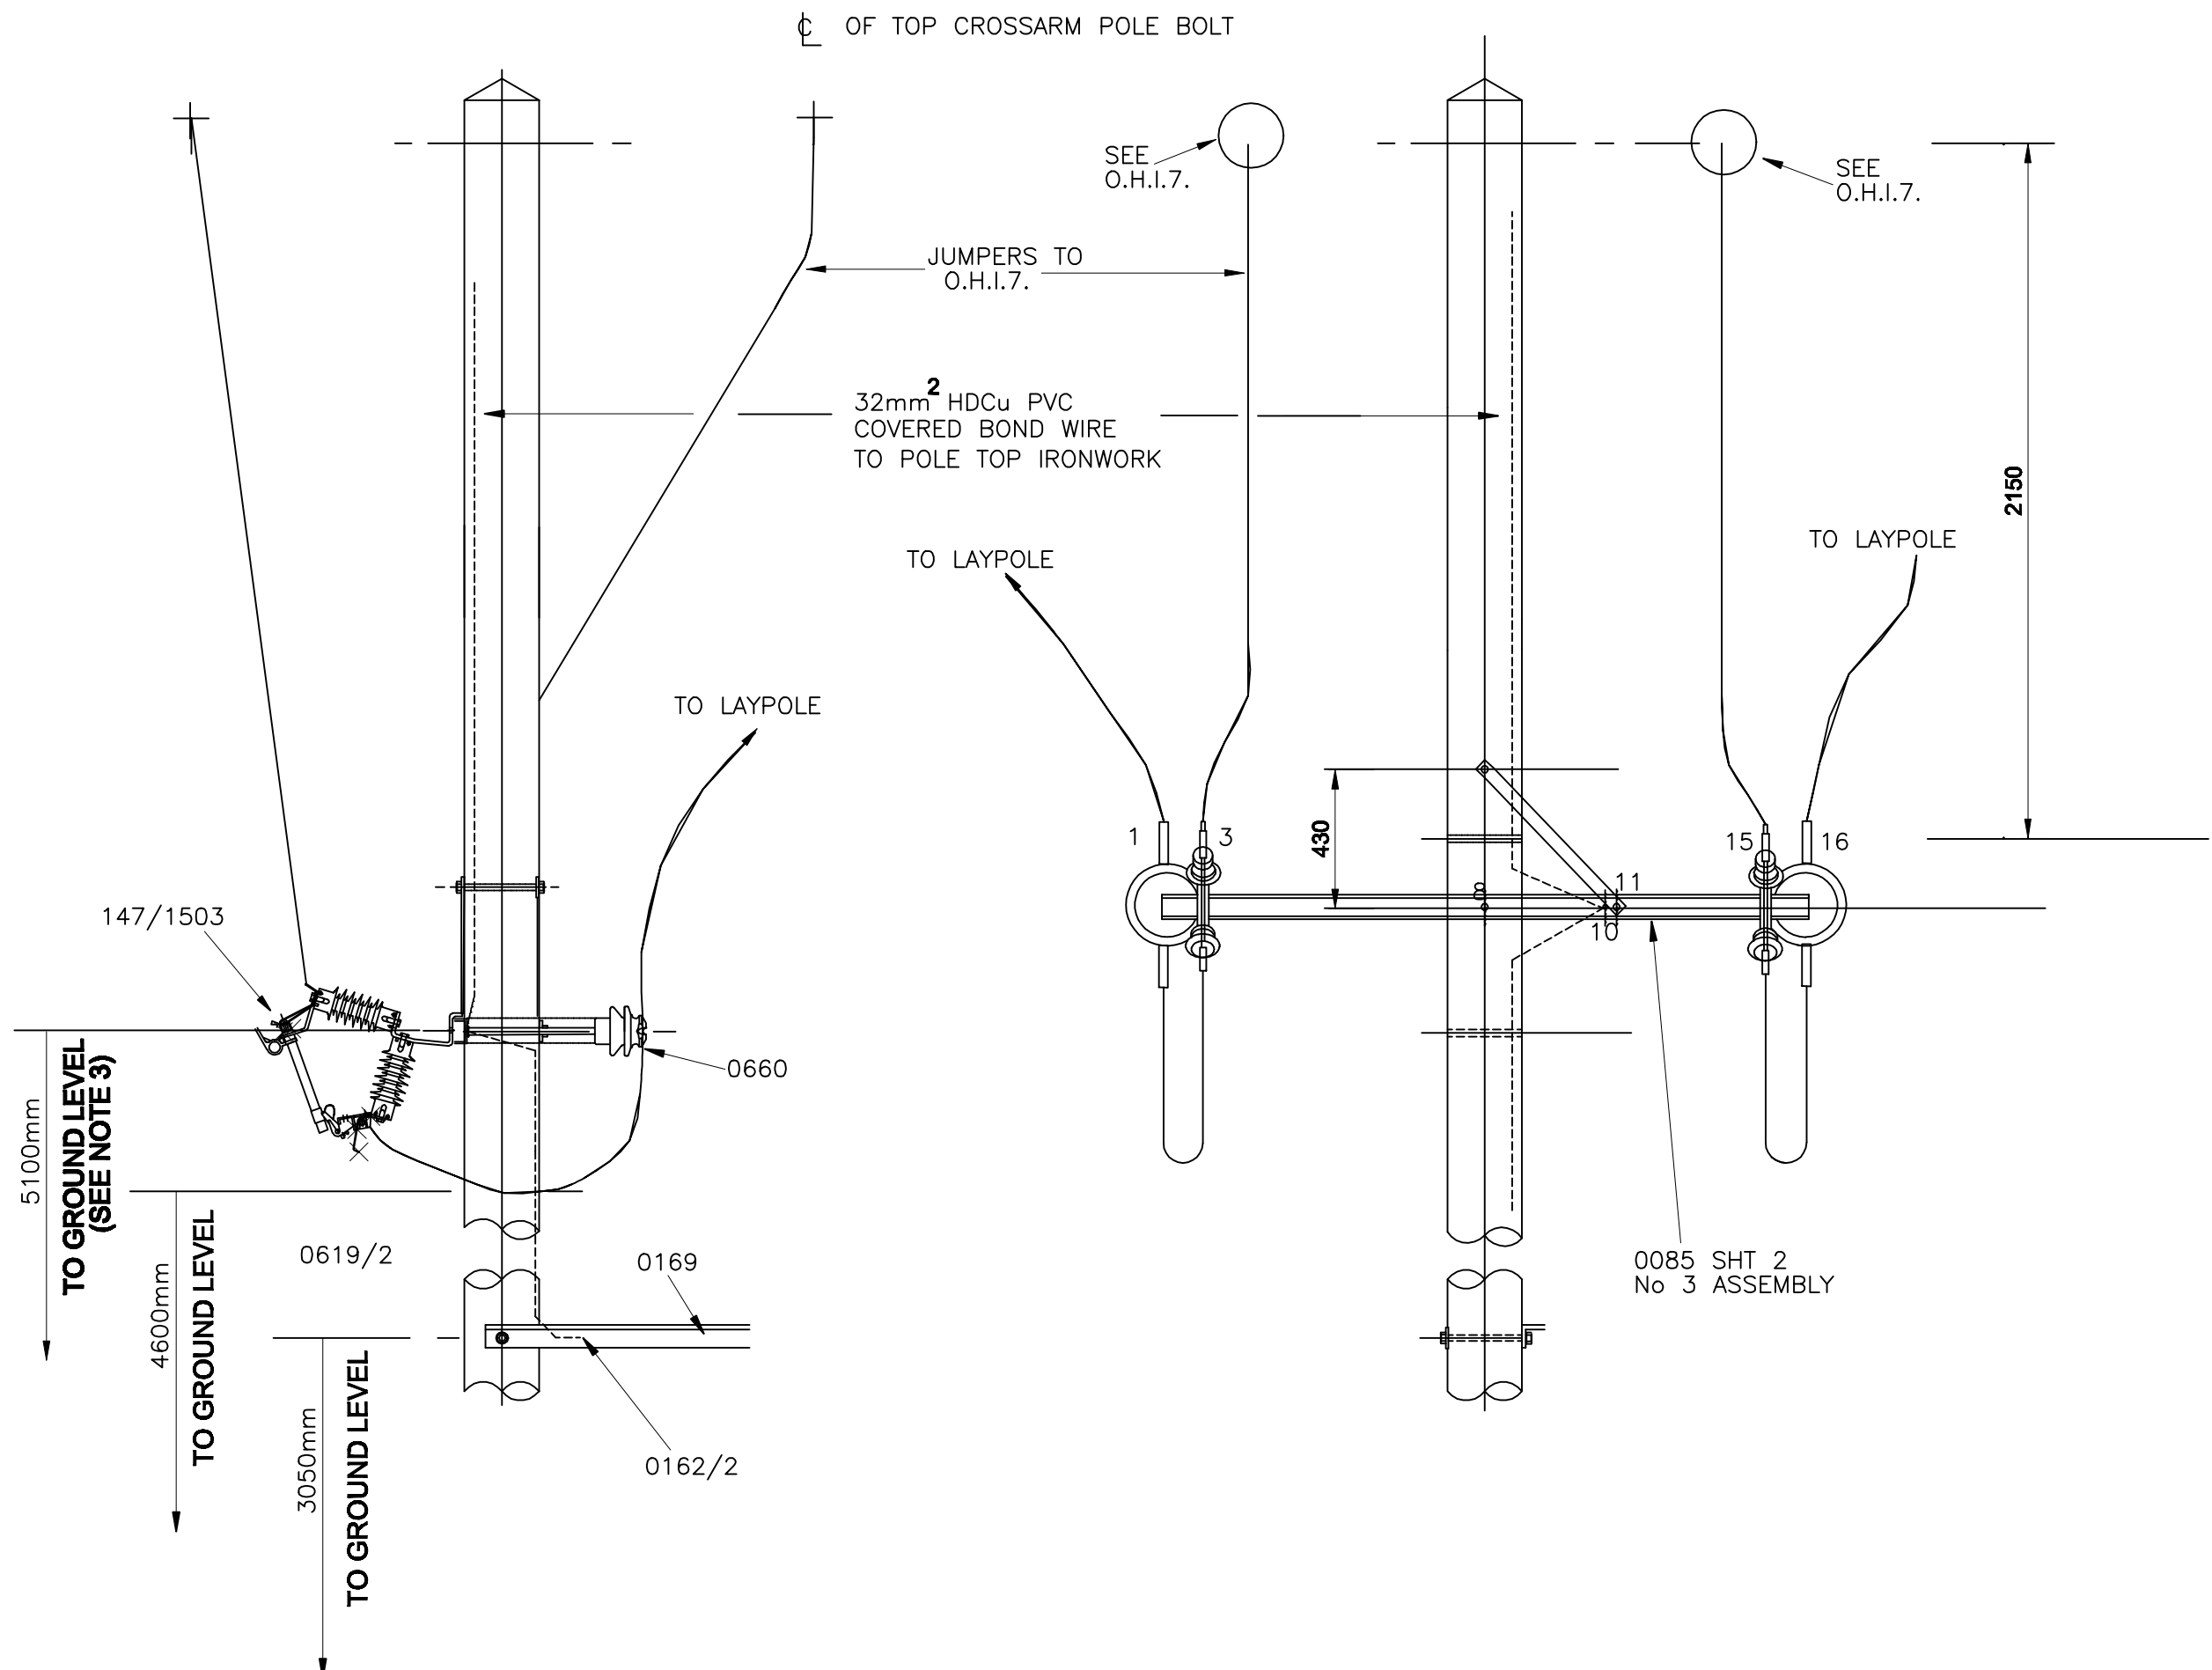

DETAIL 'A'

NORMAL POSITION OF LAYPOLE FROM MAIN LINE POLE.

CL OF FUSES TO BE PARALLEL WITH CL OF LAYPOLE CROSSARM IN ALL CASES.

NOTES:

1. ALL HOLES IN POLE TO BE 22mm DIA. POLE BOLTS TO BE M20.
2. POLES TO BE DRILLED AND NOTCHED 12mm DEEP FOR CHANNELS.
3. AT ROAD CROSSING SUPPORTS MINIMUM LINE CONDUCTOR REGULATION CLEARANCES MUST BE PROVIDED TO THE LOWEST JUMPER CONDUCTOR AND THE DIMENSIONS BETWEEN BRACKETS ADJUSTED ACCORDINGLY.
4. SUITABLE FOR POLES OF THE FOLLOWING LENGTHS:- 9.5m AND 10.0m.
5. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. BASED DRAWINGS, OTHER DRAWING Nos REFER TO 1.09.101. SERIES.
6. PILOT PINS TO DRG No 1.09.101.0528/2 ON EARTHED POLES ALL PILOT PINS TO BE FITTED WITH TUBULAR BIRDCUARD

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. NO. 04/254

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF		
Manufacturer Details		11KV & 20KV OVERHEAD LINES ARRANGEMENT OF SINGLE PHASE TEE-OFF TO LAYPOLE WITH H V FUSE UNITS		
Sheet No. 1	Scale 1:20	Type OVERHEAD		
Prepared By Barbara.Simpson				
Revised 07/03/06	Grid Reference	Ref No. C101771	Historic Drg.No.	1091111000
Date Issued 09/09/99	Checked By J WEBB	Revision E	Notes	