
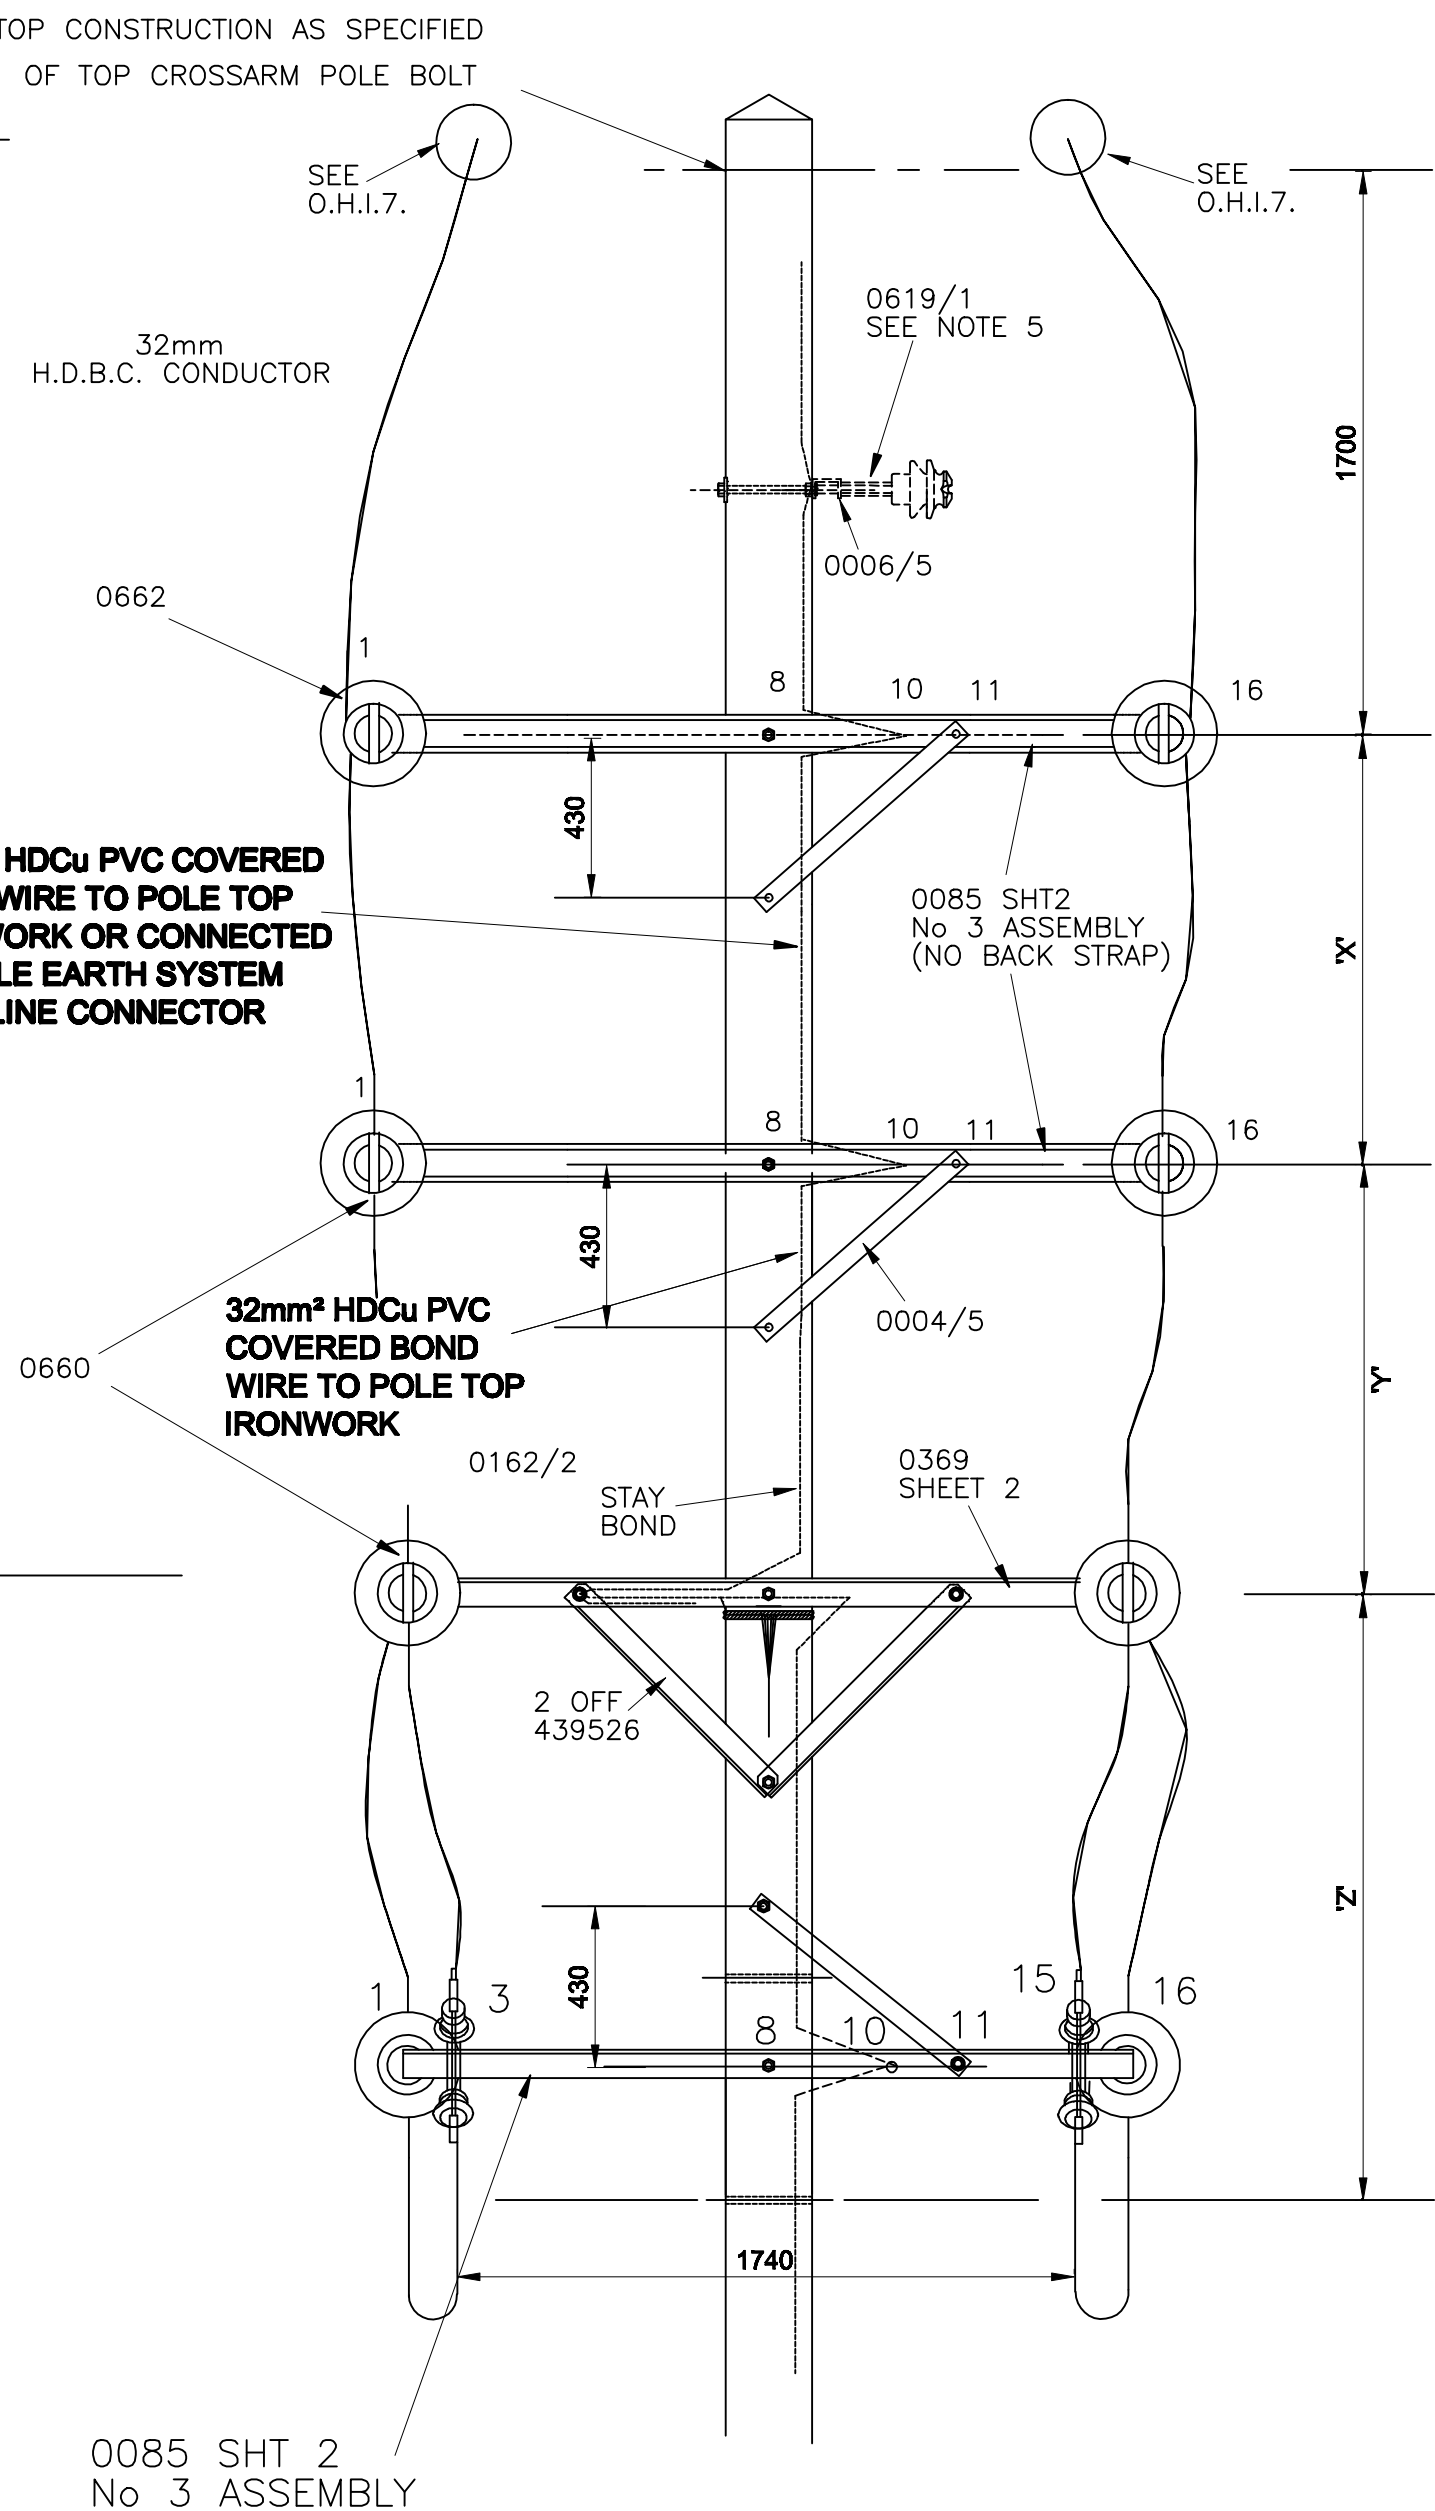


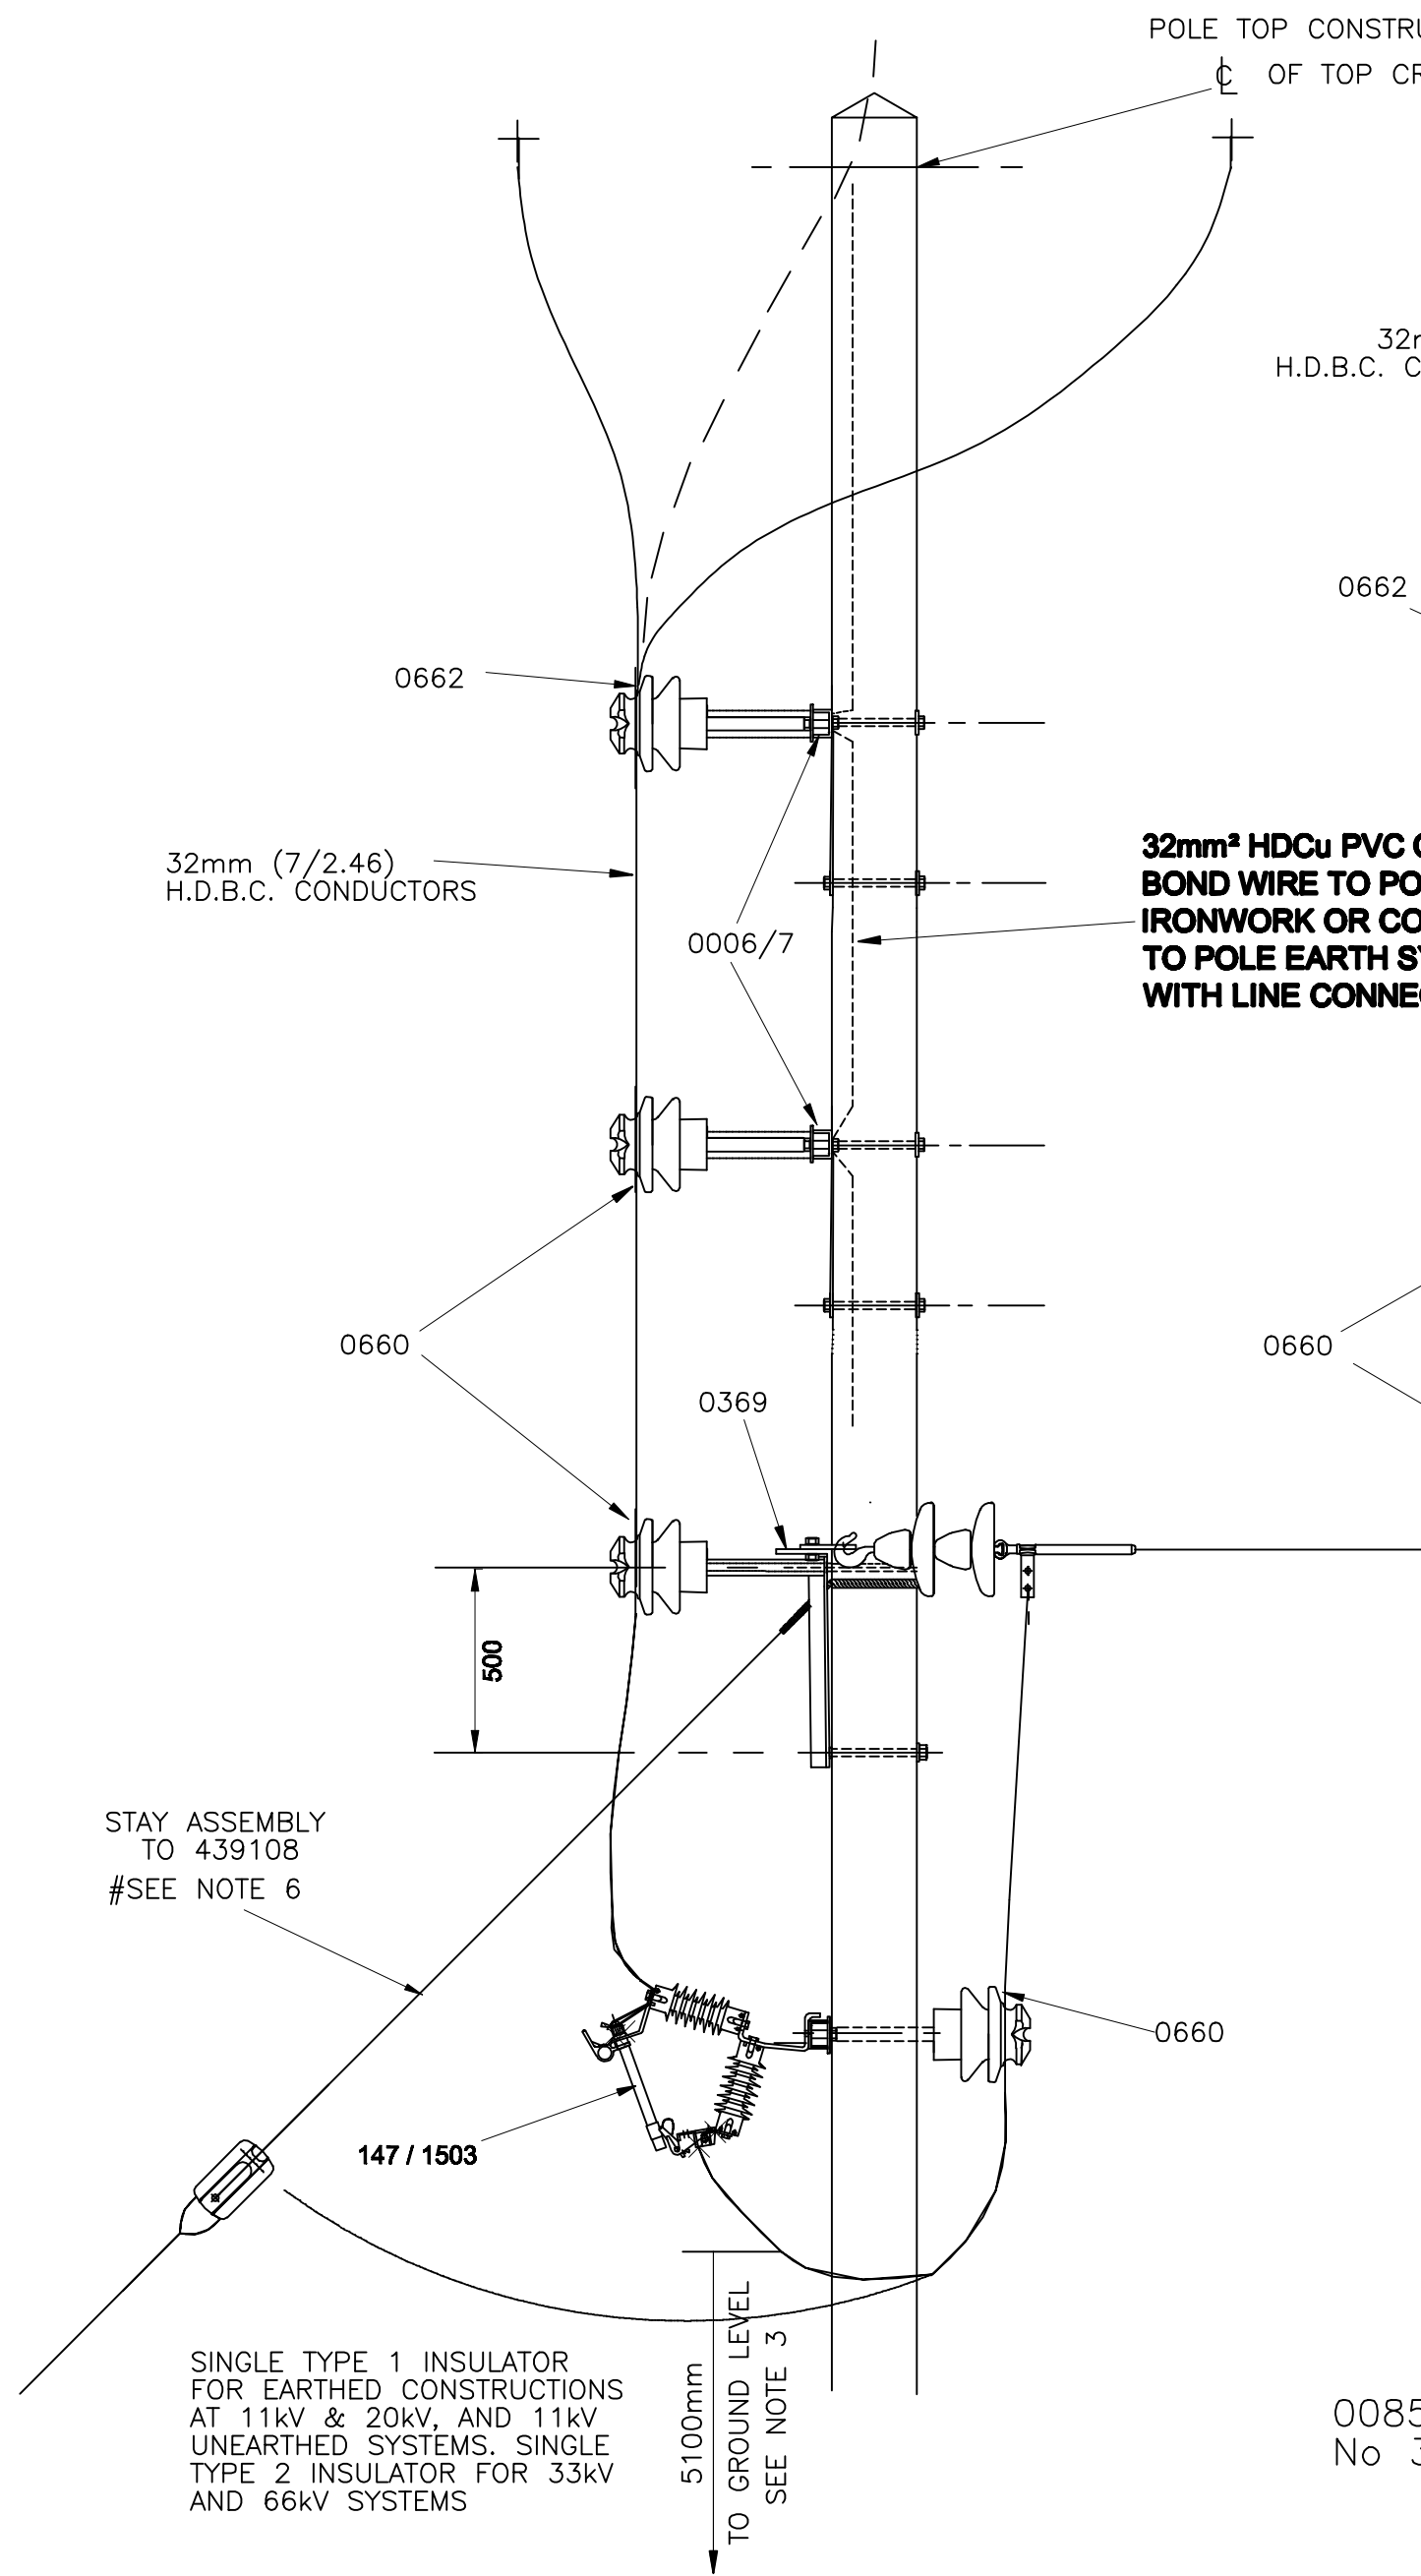

POLE LENGTH		DIMENSIONS		
		'X'	'Y'	'Z'
FEET	METRES	mm	mm	mm
34	—	—	—	1930
—	10.5	—	—	2050
36	—	—	—	2200
—	11.0	—	—	2250
—	11.5	—	1140	1610
38	—	—	1190	1610
—	12.0	—	1550	1700
40	—	—	1610	1800
42	—	—	1820	1900
—	13.0	—	1950	2000
45	—	1500	1520	1610
—	14.0	1640	1700	1610
48	—	1850	1850	1850
—	15.0	1950	2000	2000
50	—	2000	2000	2160
—	16.0	2200	2200	2250

- NOTES:
- ALL HOLES IN POLE TO BE 22mm DIA. POLE BOLTS TO BE M20.
 - POLES TO BE DRILLED AND NOTCHED 12mm DEEP FOR CHANNELS.
 - AT ROAD CROSSING SUPPORTS MINIMUM LINE CONDUCTOR REGULATION CLEARANCES MUST BE PROVIDED TO THE LOWEST JUMPER CONDUCTOR AND THE DIMENSIONS BETWEEN BRACKETS ADJUSTED ACCORDINGLY.
 - PILOT PINS TO DRG.1.09.101.0619 ON EARTHED POLES ALL PILOT PINS TO BE FITTED WITH TUBULAR BIRDCARDS.
 - APPROXIMATE INSULATOR POSITION FOR WHITE PHASE CONNECTION WITH WISHBONE IRONWORK WHEN REQUIRED.
 - WHEN TWO STAYS ARE SPECIFIED THEY ARE TO BE IN TANDEM. (STAY INSULATOR TO BE INSERTED IN STAY TO CLEAR HV JUMPER AT LOWEST POINT AND STILL PROVIDE A MIN OF 3m CLEARANCE TO GROUND)
 - DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. BASED DRAWINGS, OTHER DRAWING Nos REFER TO 1.09.101. SERIES.
 - ON SINGLE PHASE HOLE No 8 TO BE USED ON ITEM 0085 ON POLE
- ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. NO. 04/253

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		11kV AND 20kV OVERHEAD LINES ARRANGEMENT OF SINGLE FULL SPAN TEE-OFF WITH H.V. FUSE UNITS FOR MAIN LINE POLE 10.5M AND ABOVE	
Manufacturer Details		Type	LINES
Sheet No. 1	Scale	OVERHEAD	
Prepared By Janis.Webb		Ref No.	C101772
Revised 08/03/06	Grid Reference	Historic Drg.No.	1091111003
Date Issued 10/09/99	Checked By G HAMMEL	Revision	B Notes