


POLE TOP CONSTRUCTION AS SPECIFIED

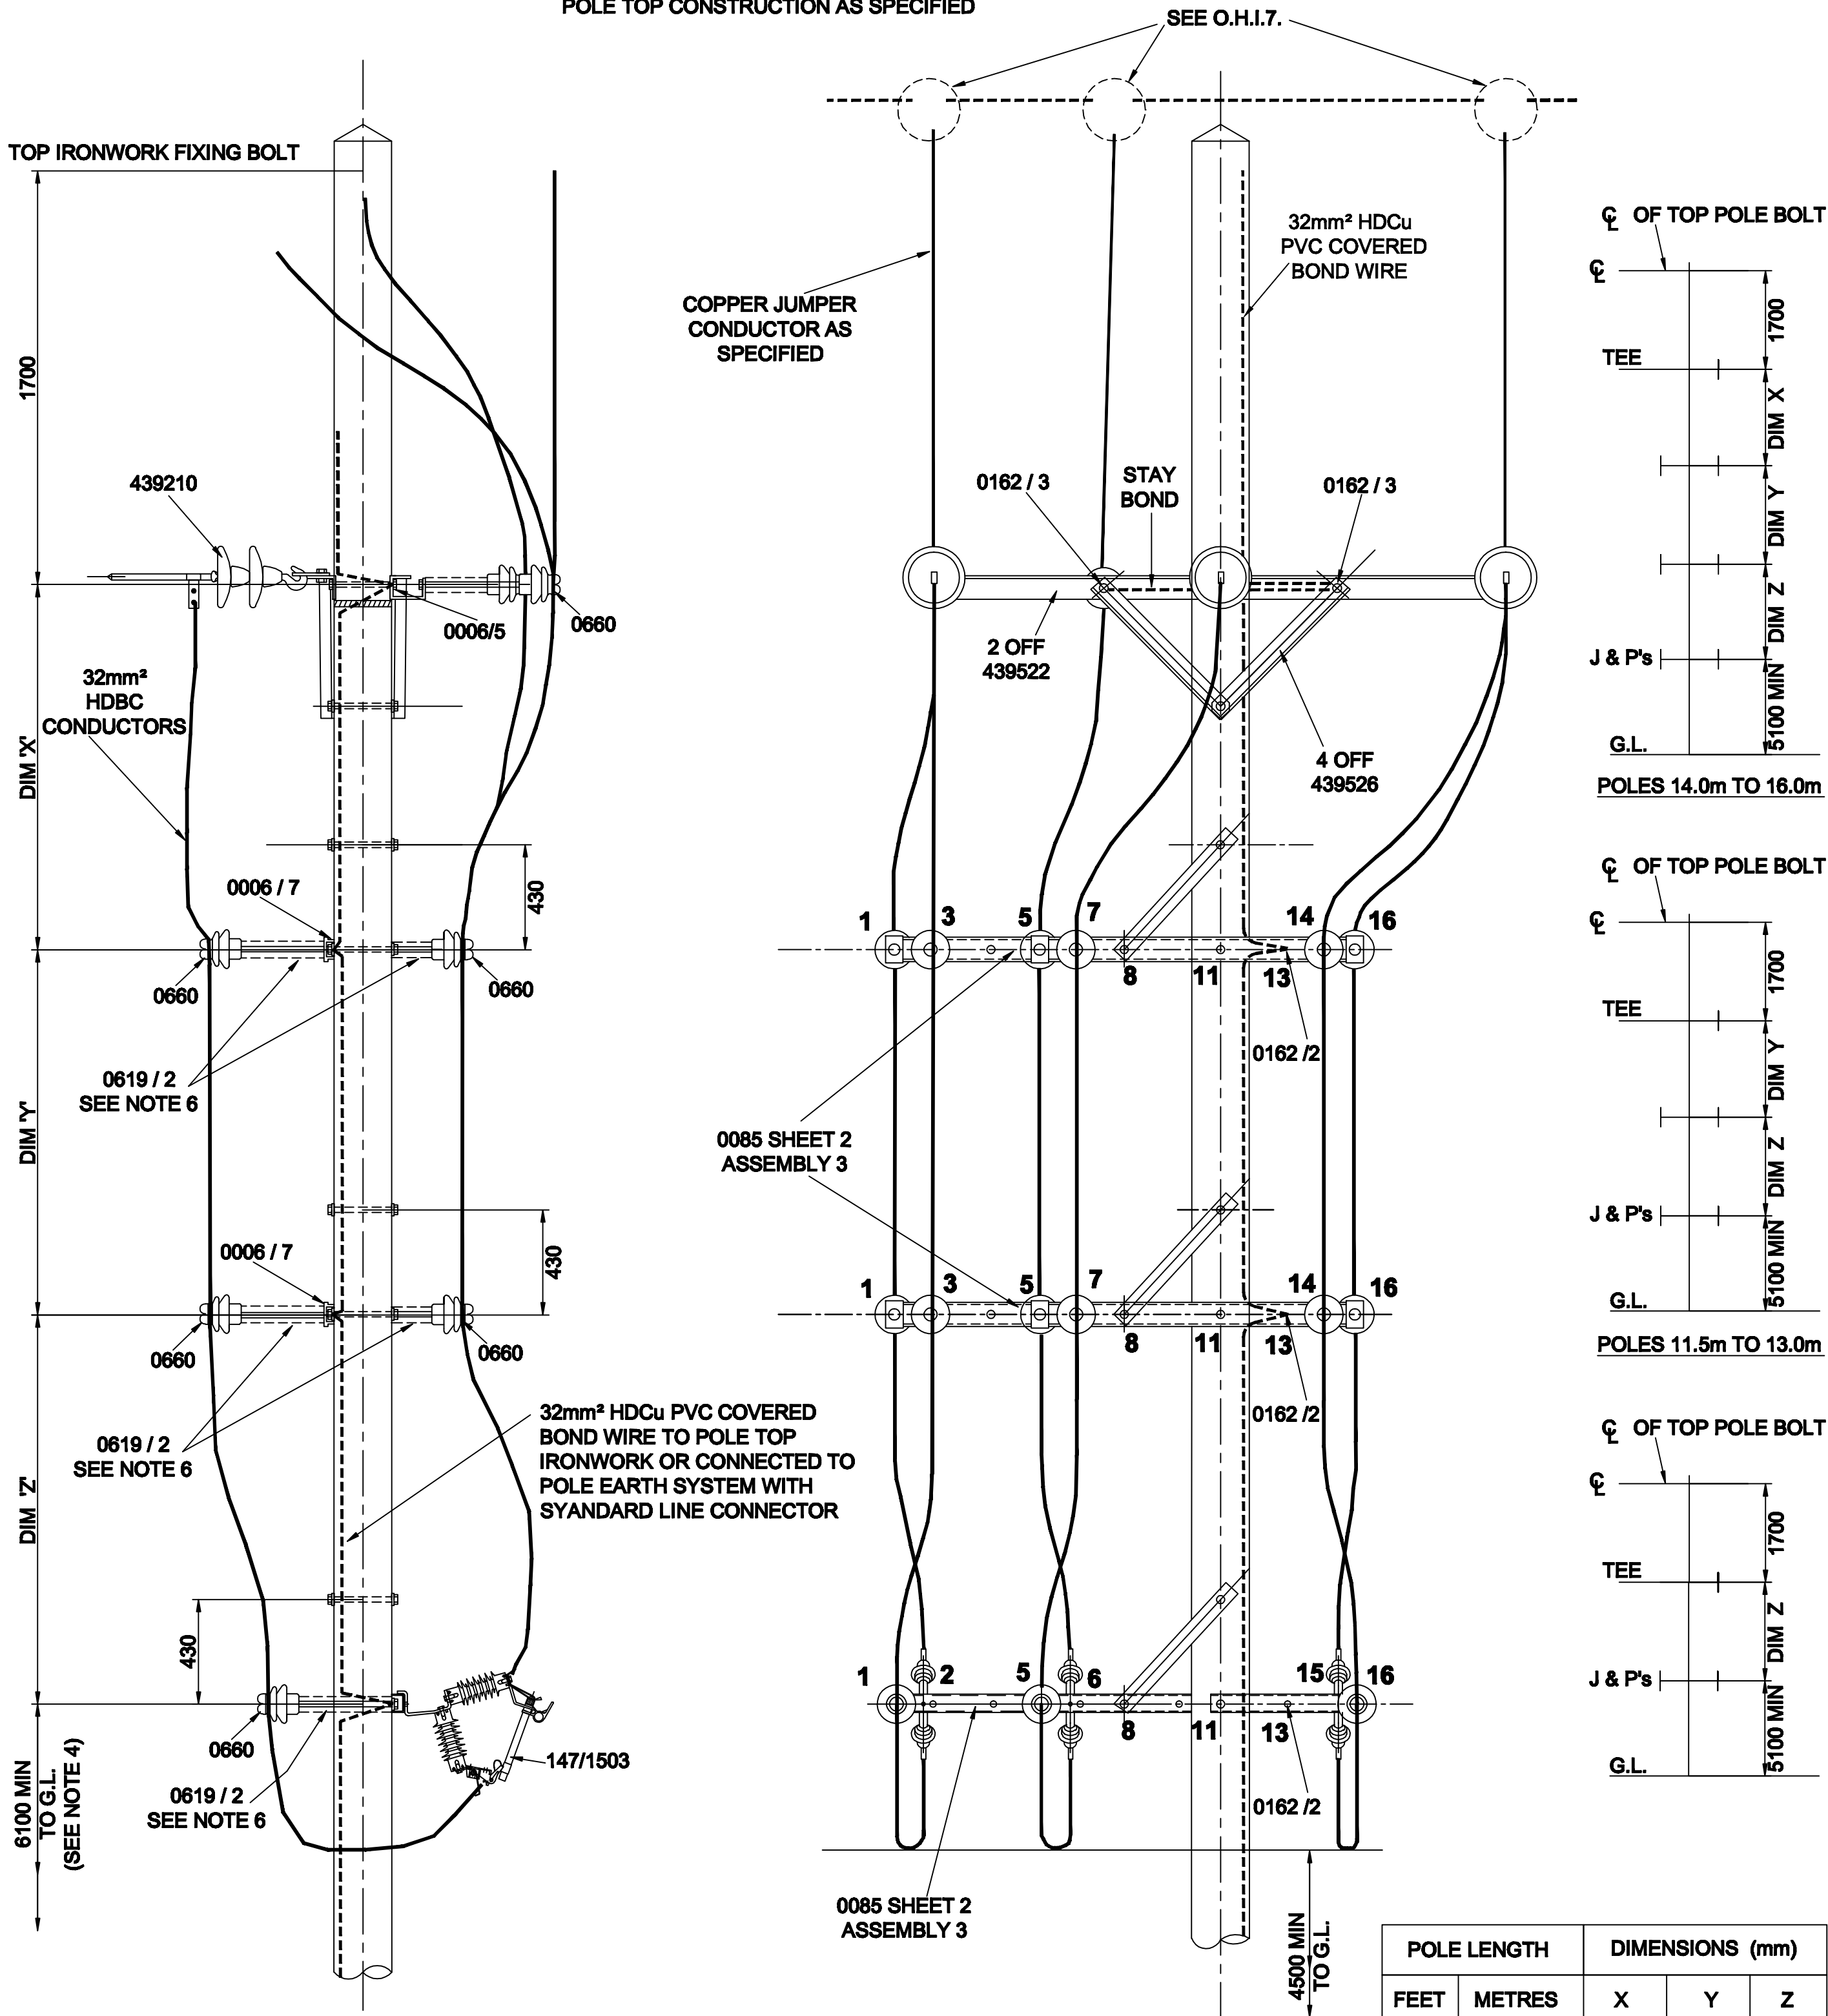

ANGLES BETWEEN TEE OFF CONDUCTORS AND MAIN LINE CONDUCTORS TO BE NOT LESS THAN 60°

NOTES:

1. MINIMUM POLE LENGTH TO BE 11.0m
2. ALL HOLES TO BE 22mm DIA POLE BOLTS TO BE M20
3. POLE DRILLED AND NOTCHED FOR 12mm CHANNELS
4. WHEN TWO STAYS ARE SPECIFIED THEY ARE TO BE ERECTED IN TANDEM (MIN 2.0m BETWEEN STAY PITS)
5. STAY INSULATOR MUST BE INSTALLED SO AS TO BE BELOW THE LOWEST H.V. JUMPER WHEN AT A VERTICAL ANGLE
6. PILOT PINS TO DRG 1.09.101.0619 ON EARTHED POLES
ALL PILOT PINS TO BE FITTED WITH TUBULAR BIRDCUARD
7. AT ROAD CROSSINGS SUPPORTS MINIMUM LINE CONDUCTOR REGULATION CLEARANCES MUST BE PROVIDED TO THE LOWEST JUMPER CONDUCTOR AND THE DIMENSIONS BETWEEN BRACKETS ADJUSTED ACCORDINGLY. THE USE OF THIS CONSTRUCTION ON POLES LOCATED ON ROADSIDE FENCES IS TO BE AVOIDED
8. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS
OTHER DRAWING Nos REFER TO 1.09.101..... SERIES

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

THIS DRAWING REFERRED TO IN WORKS SPEC REF. No 04 / 256

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF		
Manufacturer Details		11KV AND 20KV OVERHEAD LINE ARRANGEMENT OF THREE PHASE FULL SPAN TEE OFF WITH HV TYPE FUSE UNITS ON SINGLE WOOD POLE		
Sheet No. 1	Scale 1:20	Type OVERHEAD POLES		
Prepared By Janis.Webb		Ref No. C927378	Historic Drg.No.	1091121064
Revised 07/03/06	Grid Reference	Revision C Notes		
Date Issued 03/03/06	Checked By G HAMMEL			