


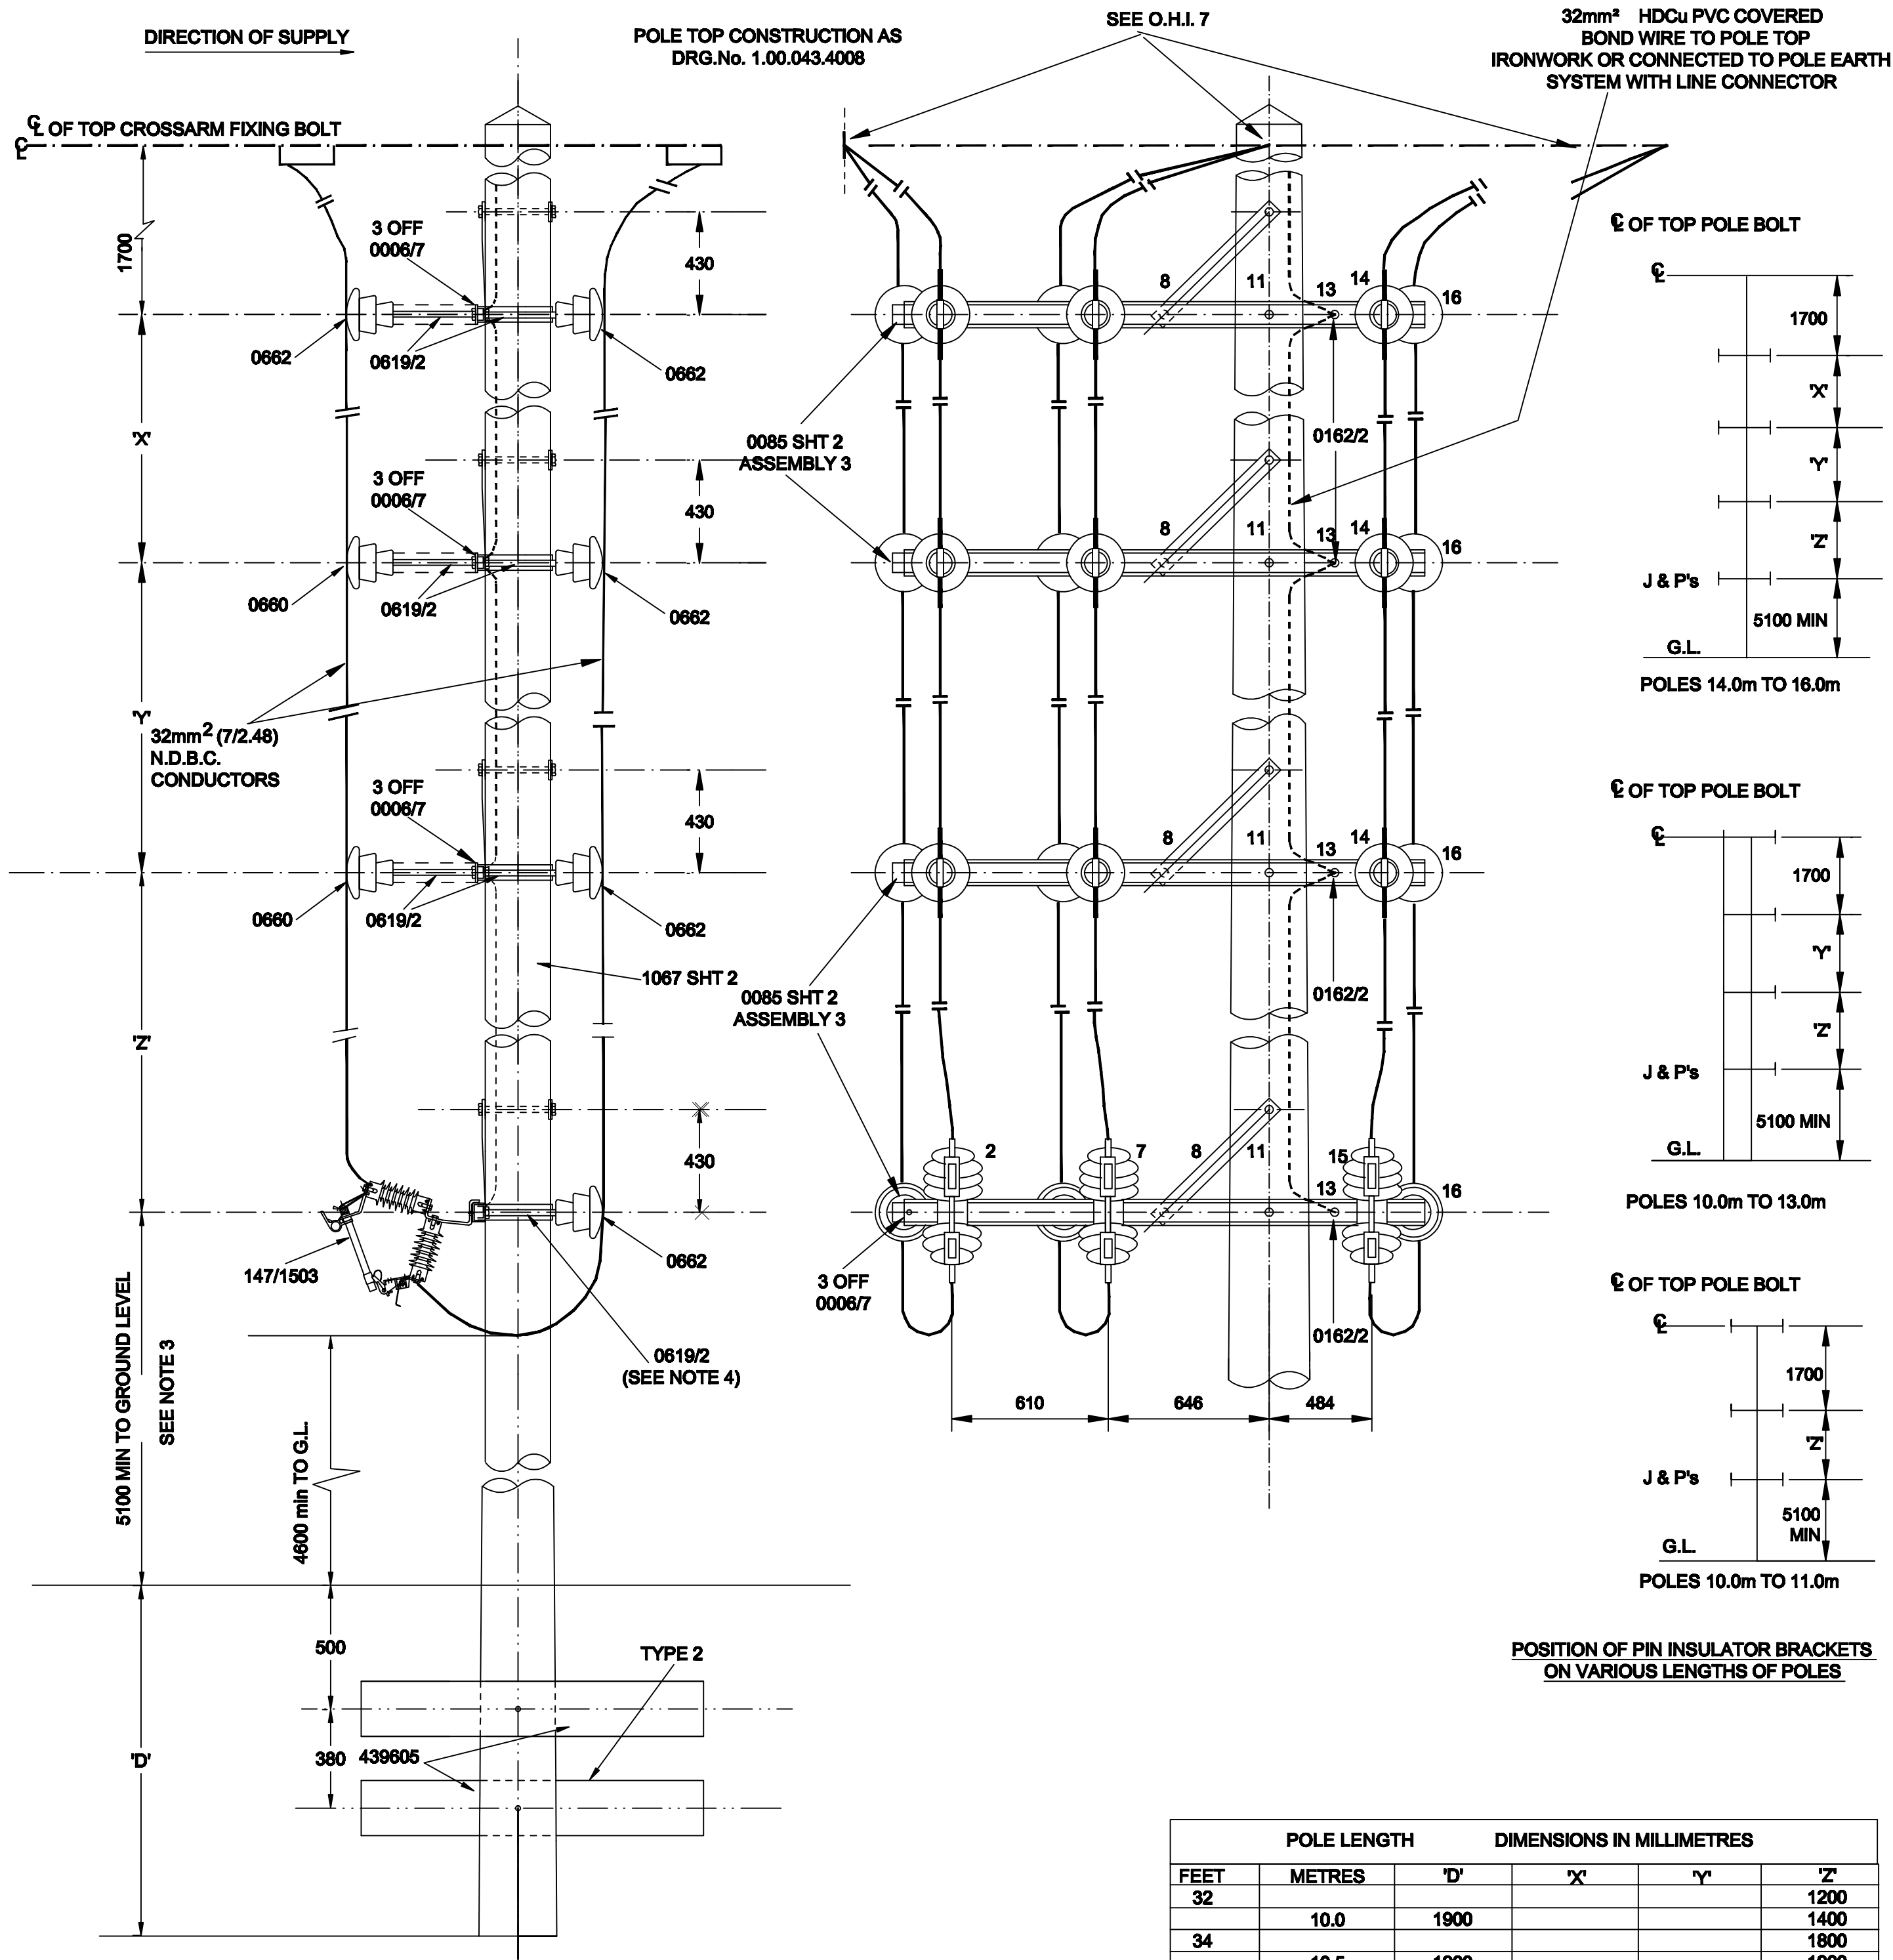

- NOTES**
- ALL HOLES IN POLE TO BE 22mm DIA. POLE BOLTS TO BE M20
1 CURVED WASHER TO DRAWING NUMBER 439605
 - POLES TO BE DRILLED AND NOTCHED 12mm DEEP FOR CHANNELS ON SITE
 - AT ROAD CROSSING SUPPORTS MINIMUM LINE CONDUCTOR REGULATION CLEARANCES MUST BE PROVIDED TO THE LOWEST JUMPER CONDUCTOR AND THE DIMENSIONS BETWEEN BRACKETS ADJUSTED ACCORDINGLY
 - ON EARTHED POLES. ALL PILOT PINS TO BE FITTED WITH TUBULAR BIRDCUARD
 - DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS. OTHER DETAIL DRAWINGS REFER TO 1.09.101. SERIES

POLE LENGTH		DIMENSIONS IN MILLIMETRES			
FEET	METRES	'D'	'X'	'Y'	'Z'
32					1200
	10.0	1900			1400
34					1800
	10.5	1900			1900
36					2100
	11.0	1900			2200
	11.5	1900		1300	1400
38				1300	1400
	12.0	2100		1600	1600
40				1700	1700
42				1700	2000
	13.0	2100		1900	2000
45			1500	1500	1600
	14.0	2400	1600	1700	1600
48			1800	1800	1800
	15.0	2400	1900	2000	2000
50			2000	2000	2100
	16.0	2400	2200	2200	2200

N.B. DIMENSIONS 'X' AND 'Y' ARE APPROXIMATE (SEE NOTE 3)

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		11KV & 20KV OVERHEAD LINES ARRANGEMENT OF 3 PHASE STRAIGHT LINE SECTION POLE WITH HV TYPE FUSE UNITS (2 FUSES AT ONE SIDE OF POLE)			
Sheet No. 1	Scale 1:20				
Prepared By Janis.Webb		Type OVERHEAD	LINES		
Revised 06/03/06	Grid Reference	Ref No.	C101779	Historic Drg.No.	1091121067
Date issued	Checked By G HAMMEL	Revision E	Notes		