




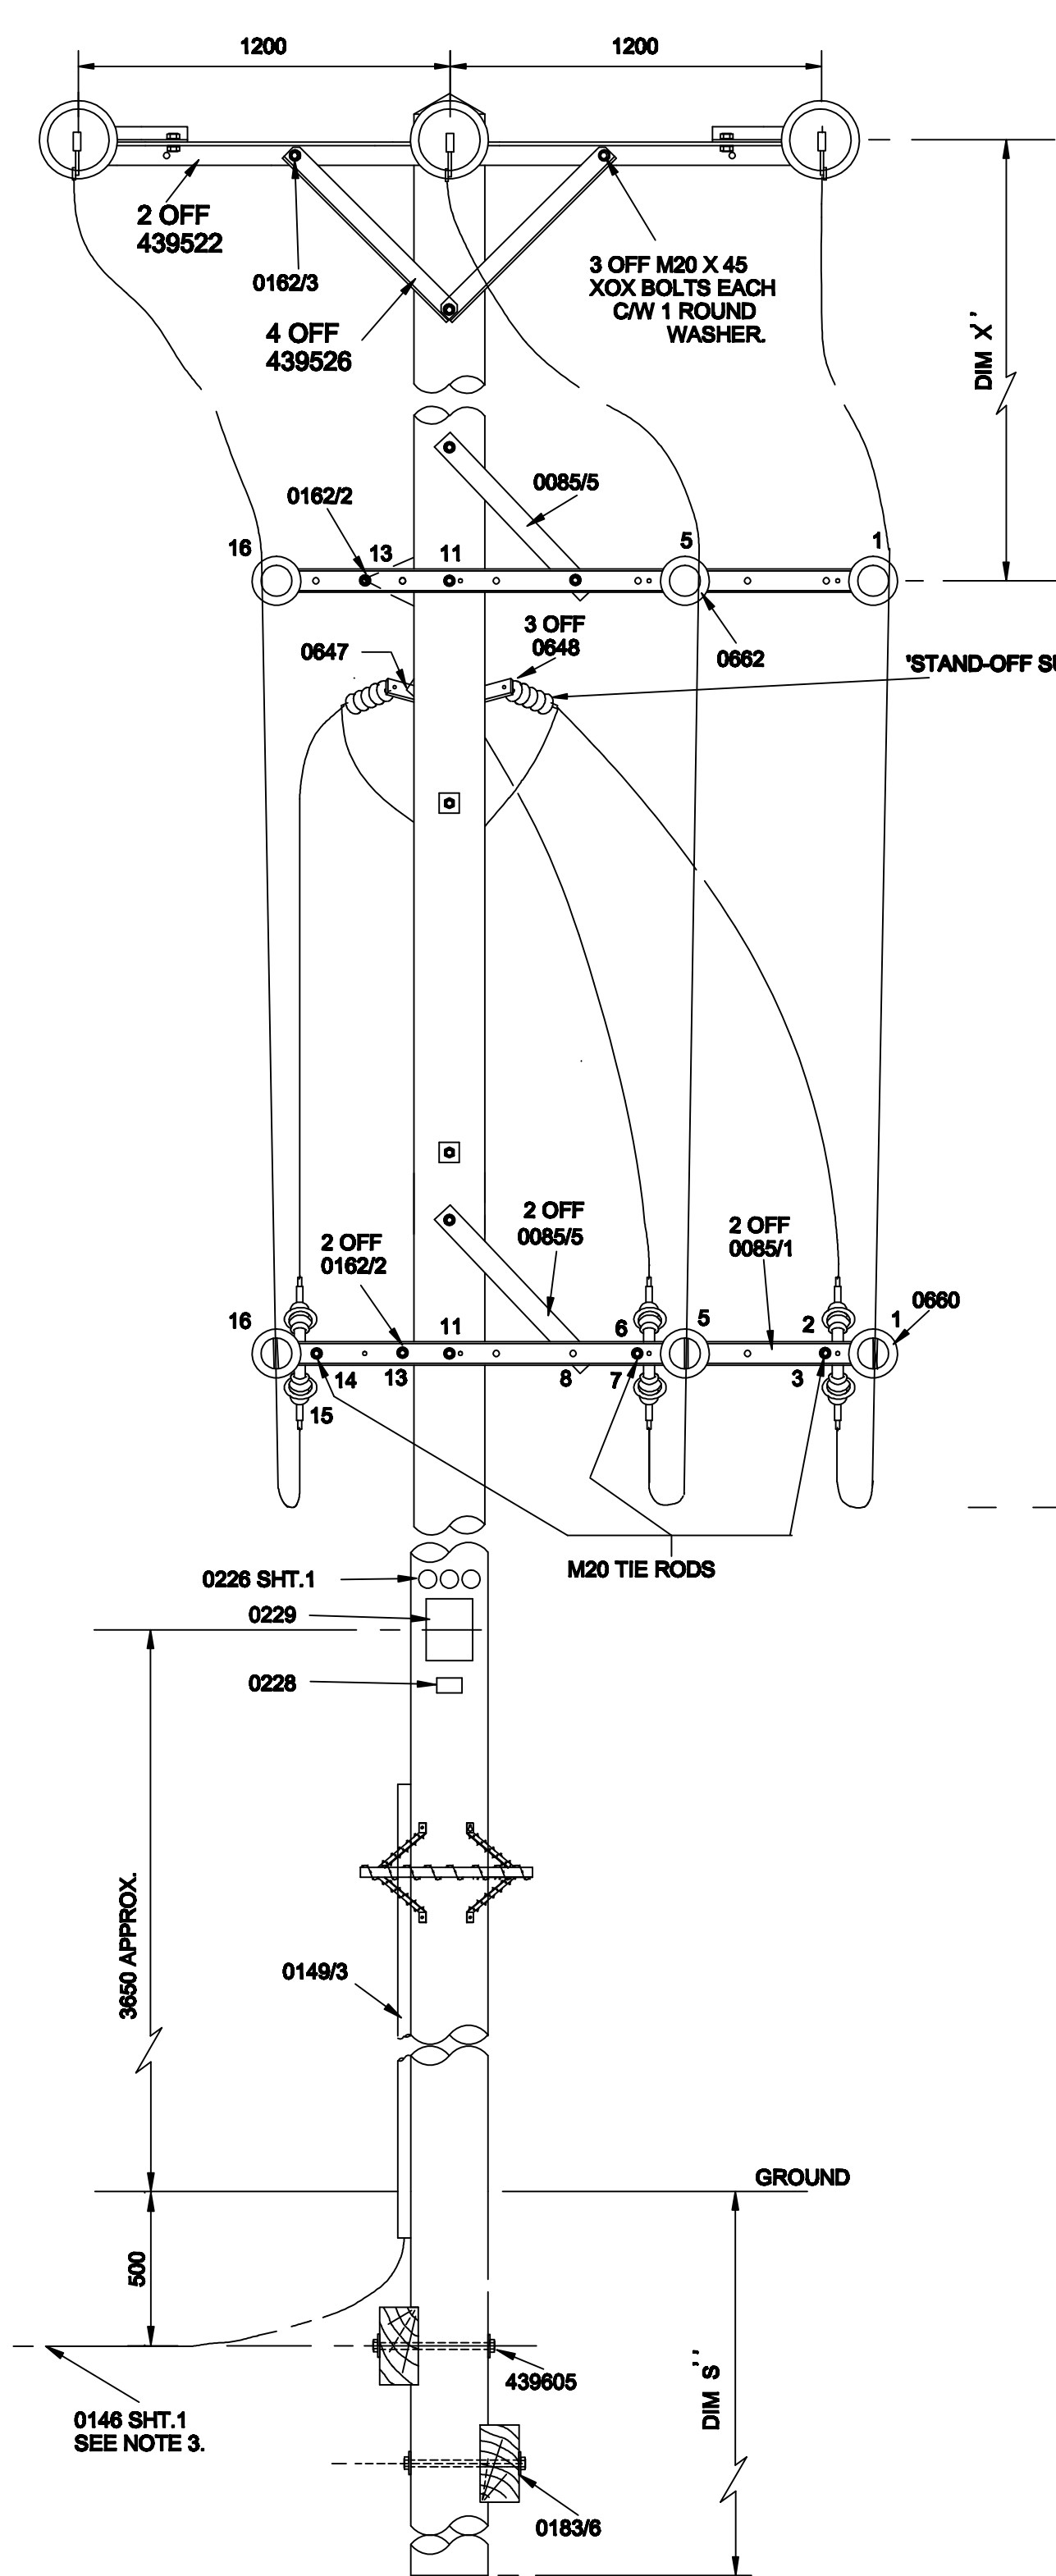

POLE LENGTH	DIM. S'	DIM. X'
11.0m	1.9m	1.45m
12.0m	2.1m	1.95m

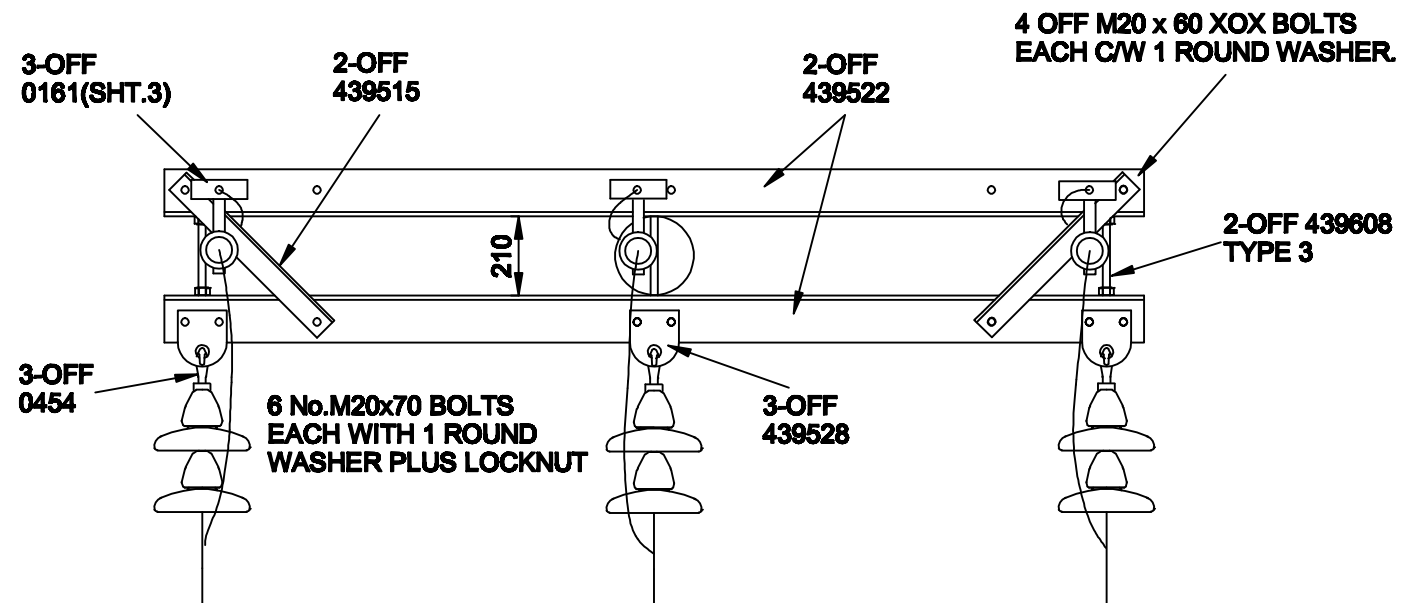

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

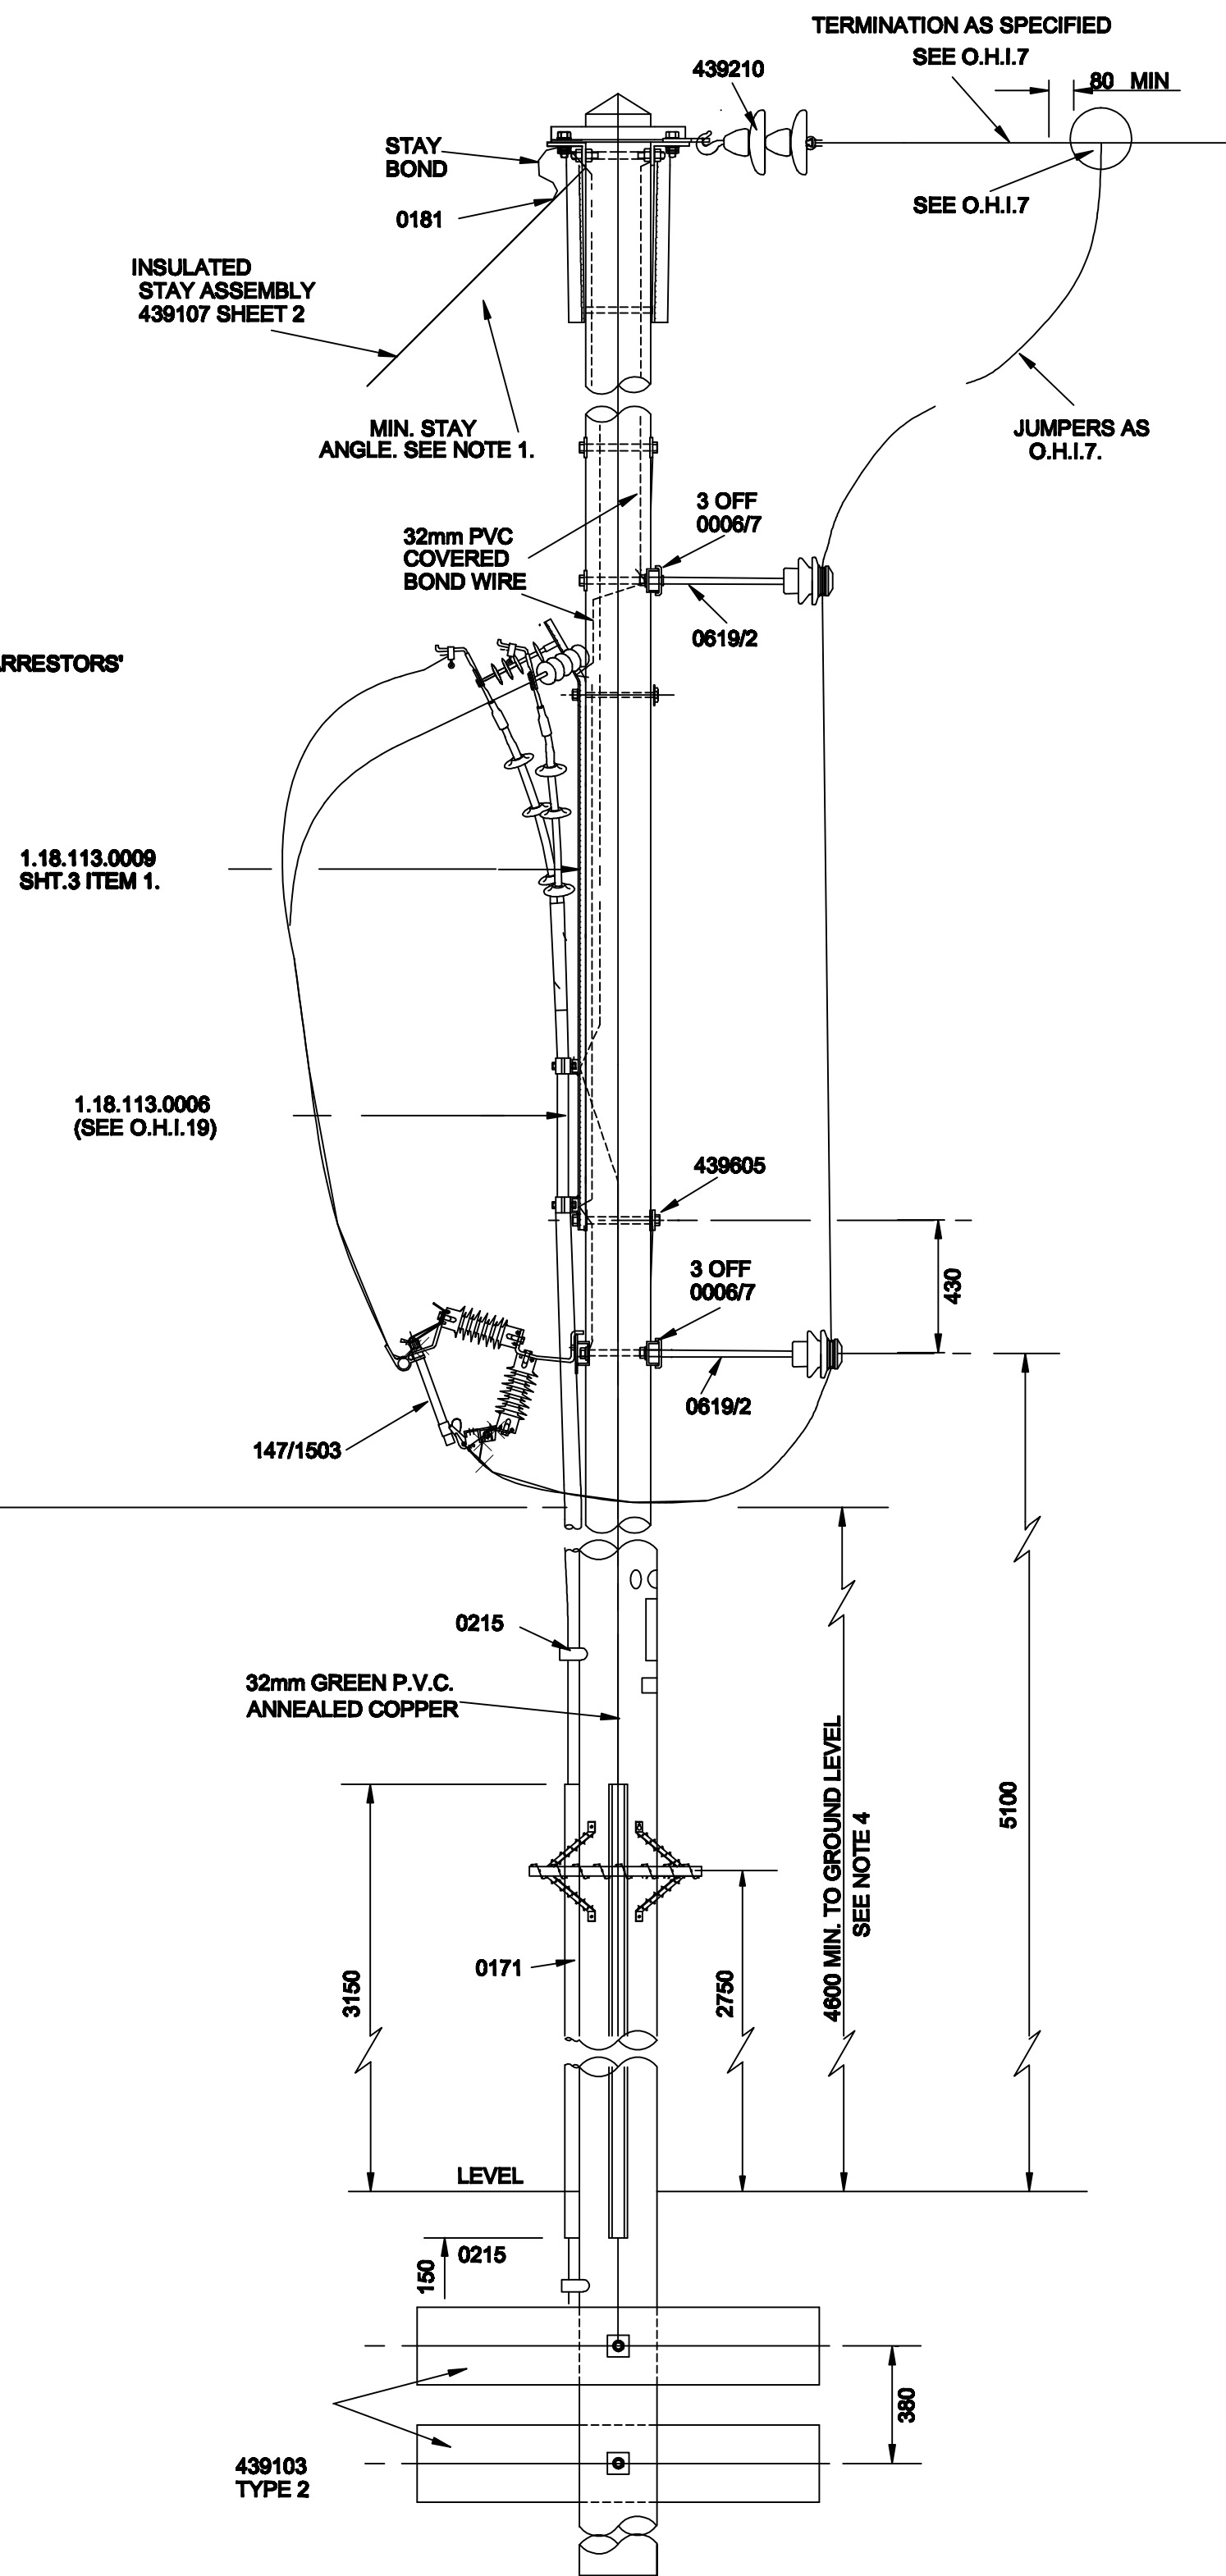

1. MINIMUM ANGLE OF INCLINATION, STAY TO POLE, TO BE 40°.
2. POLE BOLTS TO BE M20 DIA. UNLESS SPECIFIED OTHERWISE.
3. EARTHING ARRANGEMENTS TO BE IN ACCORDANCE WITH P2500.
4. AT ROAD CROSSING SUPPORTS MINIMUM LINE CONDUCTOR REGULATION CLEARANCES MUST BE PROVIDED TO THE LOWEST JUMPER.
5. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAIL DRAWINGS REFER TO 1.09.101. SERIES.
6. FOR SUPPLY OVERHEAD TO UNDERGROUND, MOUNT H.V. FUSES ON OVERHEAD LINE SIDE OF POLE WITH ASSOCIATED PILOT INSULATORS SUPPORTED BY REAR CHANNEL ASSEMBLY.

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF.No. 04/141

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
CE Electric UK Manufacturer Details		11KV OVERHEAD LINES LIGHT CONSTRUCTION CABLE TERMINAL SUPPORT WITH FUSE ISOLATORS (SUPPLY U/G TO OVERHEAD ASSEMBLY SHOWN)	
Sheet No. 1	Scale 1:20	Type OVERHEAD	LINES
Prepared By Janis.Webb	Grid Reference	Ref No. C101781	Historic Drg.No. 1091121069
Revised 03/03/06	Checked By S. SALKELD	Revision H	Notes
Date Issued 17/03/05			