
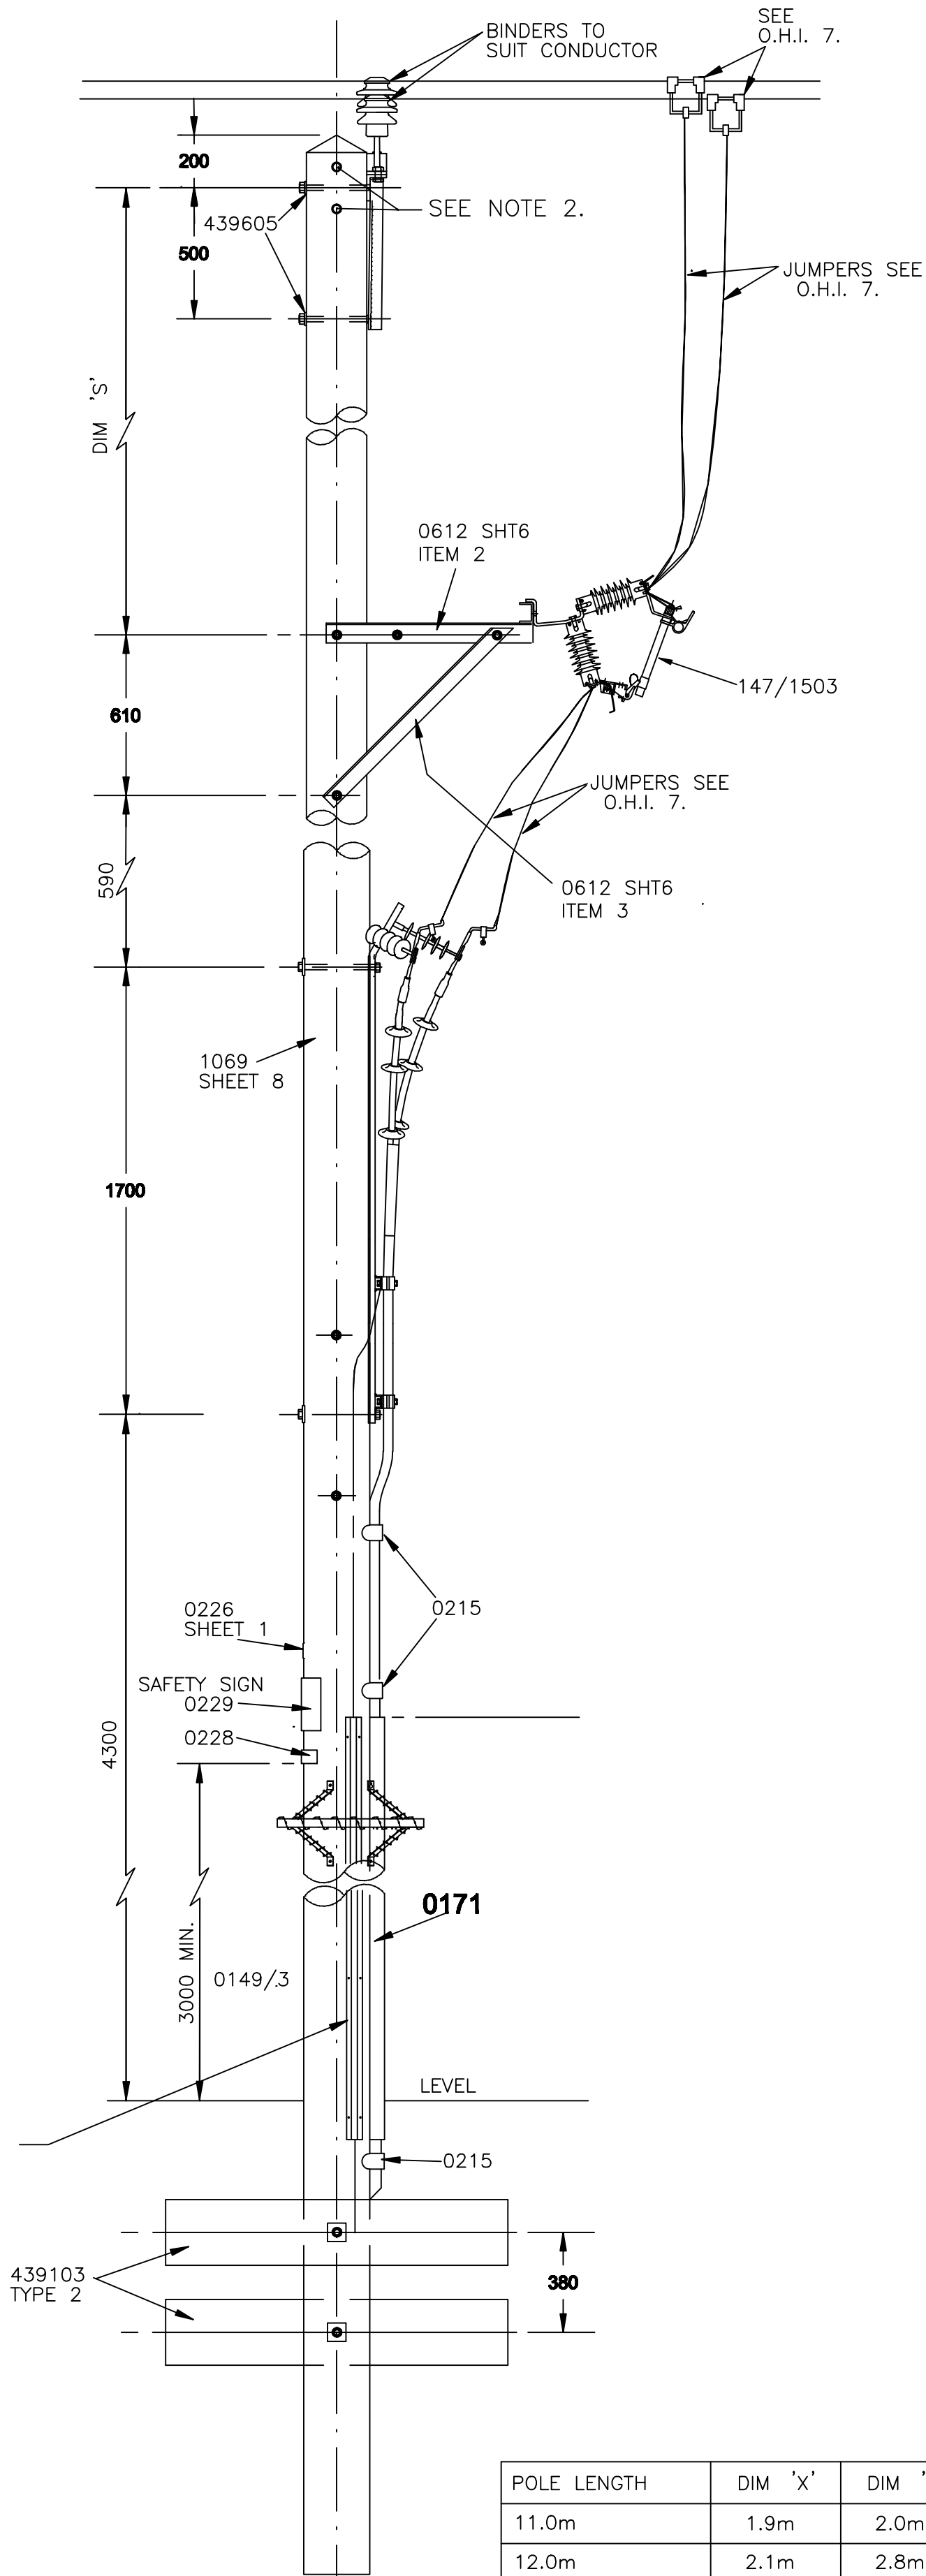


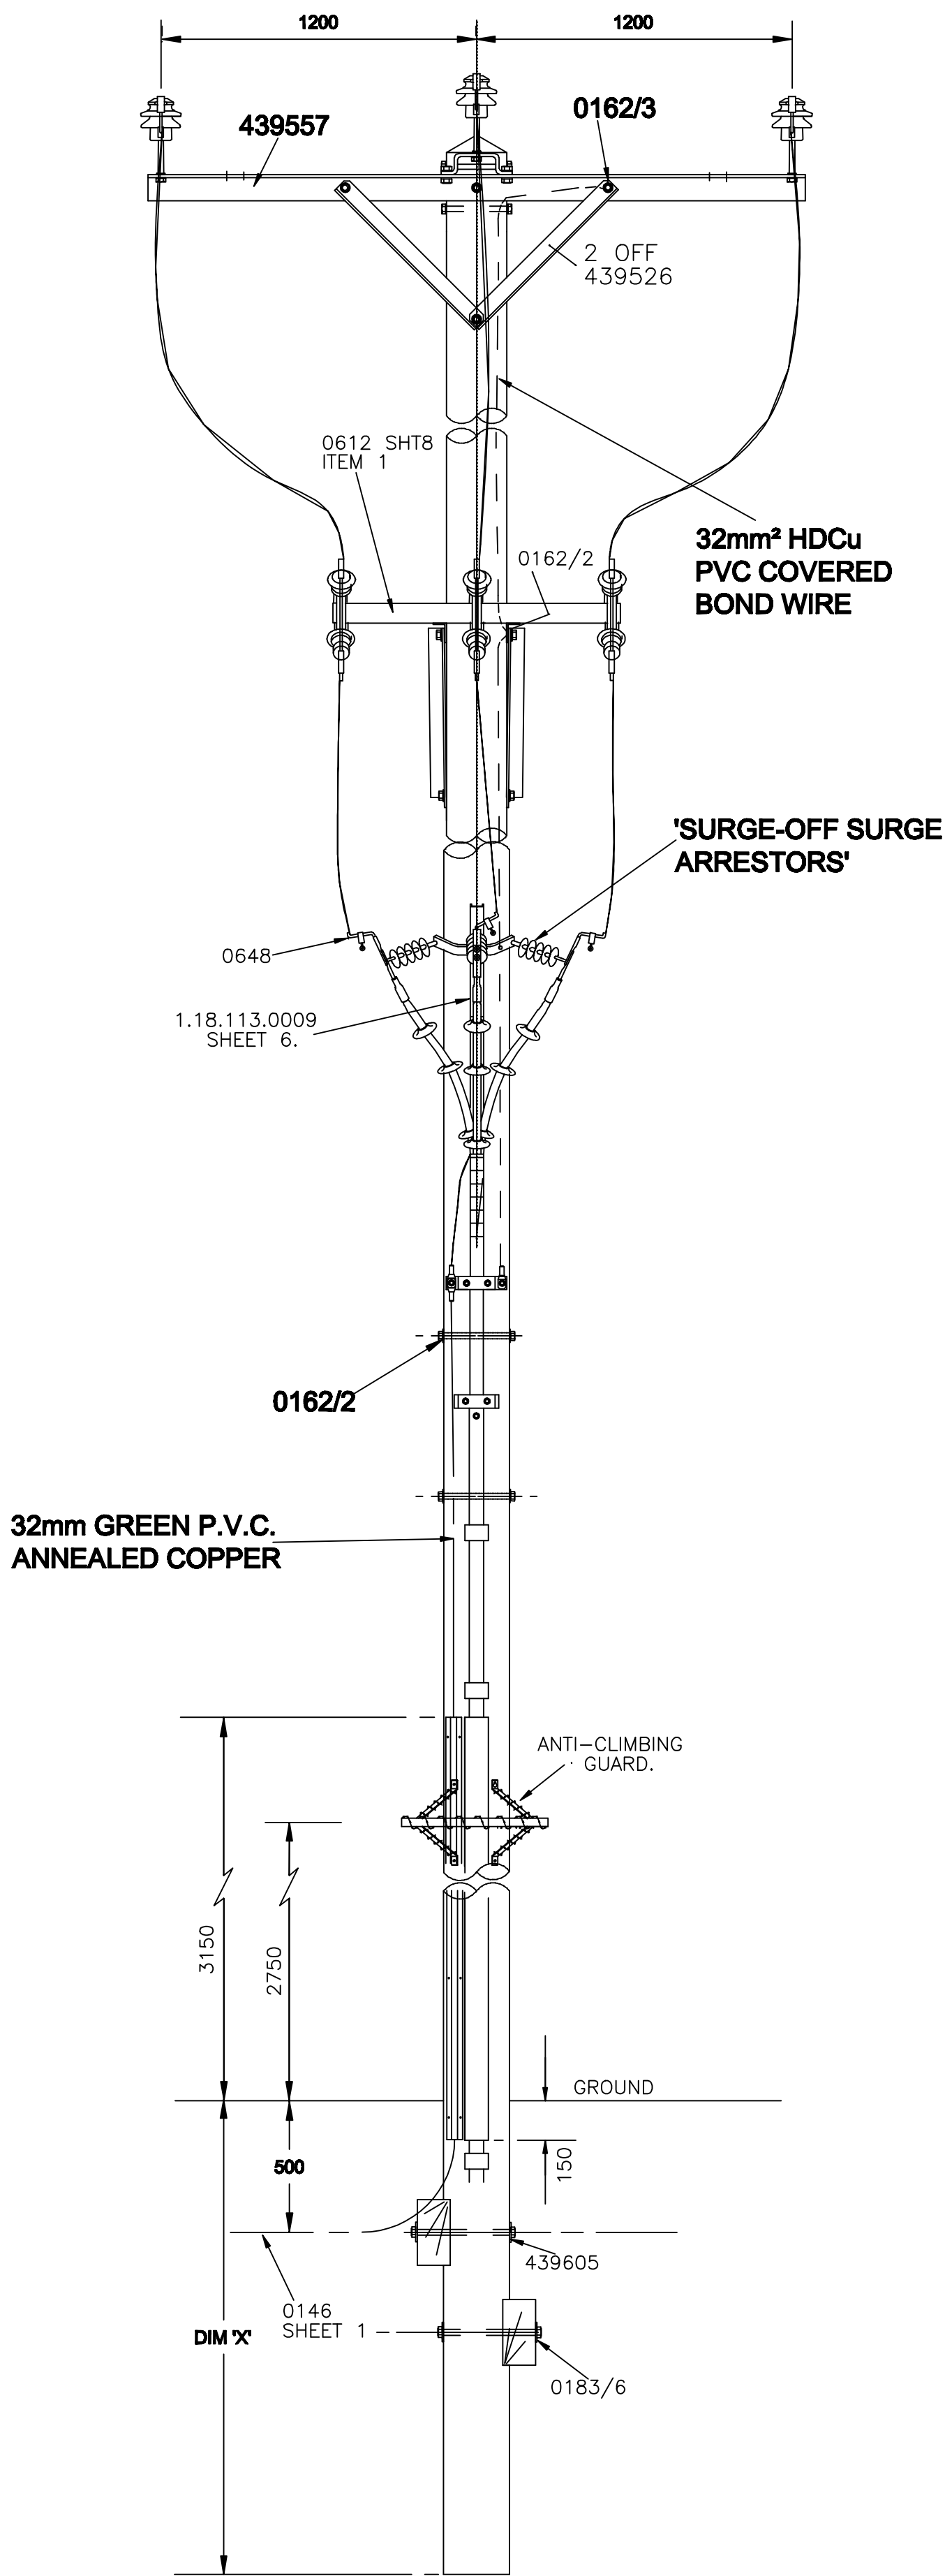

POLE LENGTH	DIM 'X'	DIM 'S'
11.0m	1.9m	2.0m
12.0m	2.1m	2.8m

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC.REF.No.04/262

NOTES:

- POLE BOLTS TO BE M20.
- FIT 2 No.M20 POLE BOLTS EACH WITH 2 WASHERS 439605 AT POLE TOP.
- WHEN A SINGLE PHASE LINE IS REQUIRED, THE STANDARD OF CONSTRUCTION TO BE APPROPRIATE TO THREE PHASE OPERATION THE CENTRE CONDUCTOR BEING OMITTED.
- MINIMUM POLE LENGTH 11.0m.
- DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. BASED DRAWINGS, OTHER DRAWINGS REFER TO 1.09.101. SRIES.
- SUPPLY LINE TO CABLE.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES INLESS OTHERWISE STATED.

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11 & 20KV OVERHEAD LINES THREE PHASE IN LINE POLE WITH HV CABLE TERMINATION CONTROLLED BY HV FUSE UNITS AND SURGE ARRESTORS	
Sheet No. 7	Scale 1:20	Type OVERHEAD LINES	
Prepared By Janis.Webb	Revised 07/03/06	Grid Reference 	Ref No. C101794
Date Issued 17/03/05	Checked By G HAMMEL	Revision F	Notes
		Historic Drg.No. 	1091121069