


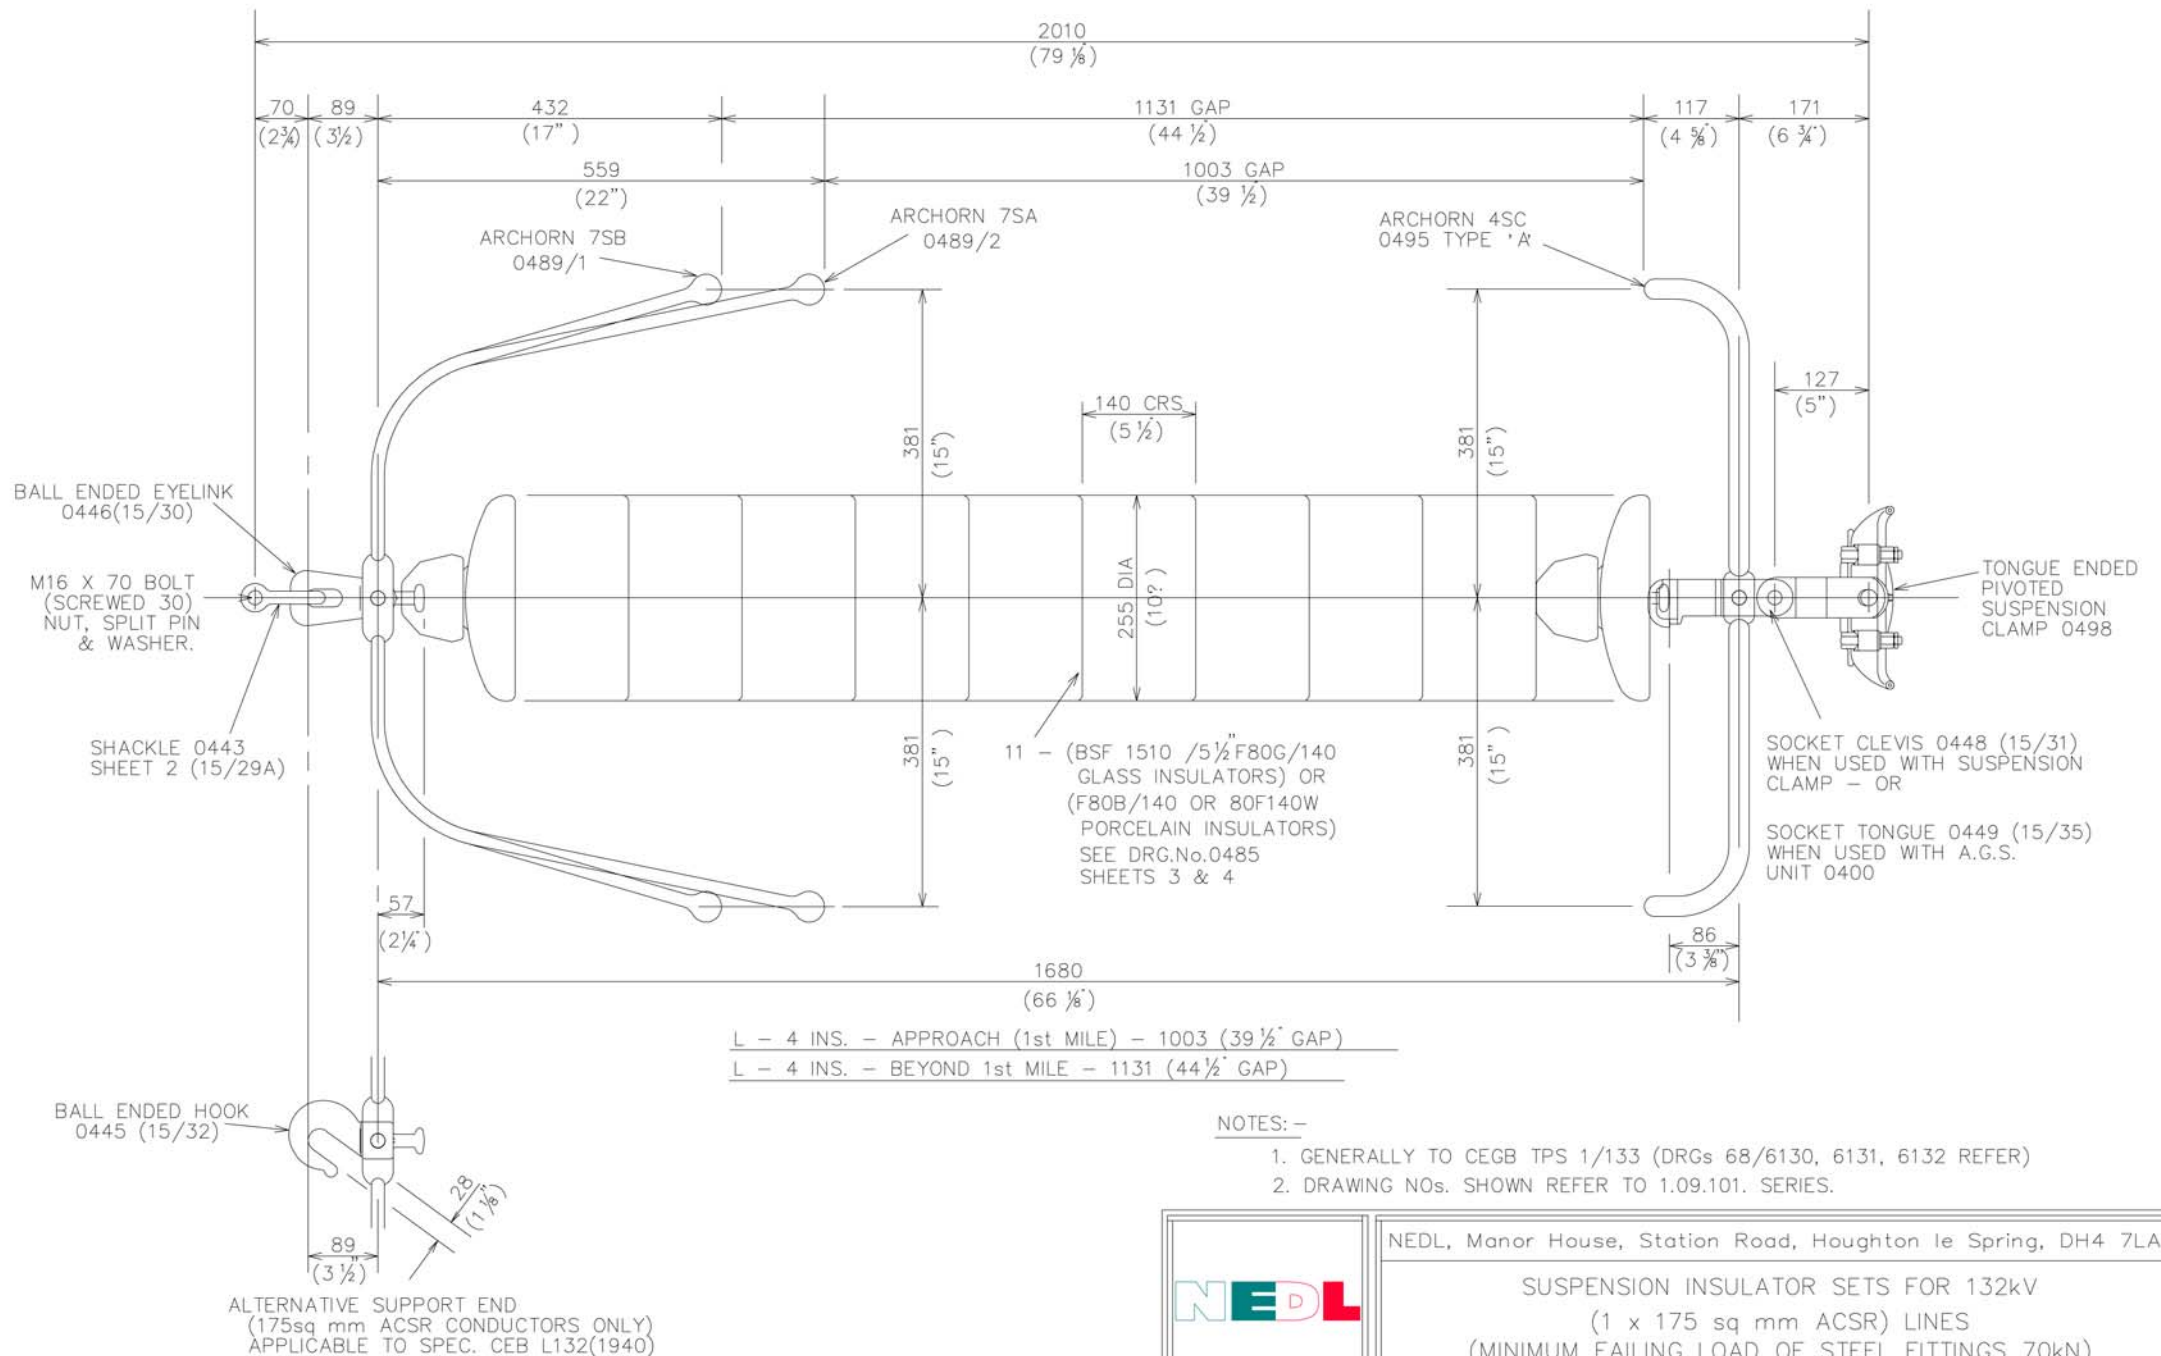

Prepared by	J.L.W.
Checked	H.A.J.
Date Issued	JUNE 80

NEDL, Manor House, Station Road, Houghton le Spring, DH4 7LA.	
SUSPENSION INSULATOR SETS FOR 132kV (1 x 175 sq mm ACSR) LINES (MINIMUM FAILING LOAD OF STEEL FITTINGS 70kN)	
Drg.No.	1 09 101 0428
Mod.	A B C D E
Sheet No.	1
Revised	AUG 2001
Scale	N.T.S.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.