


□□○□

□□○□

235.6 REF.

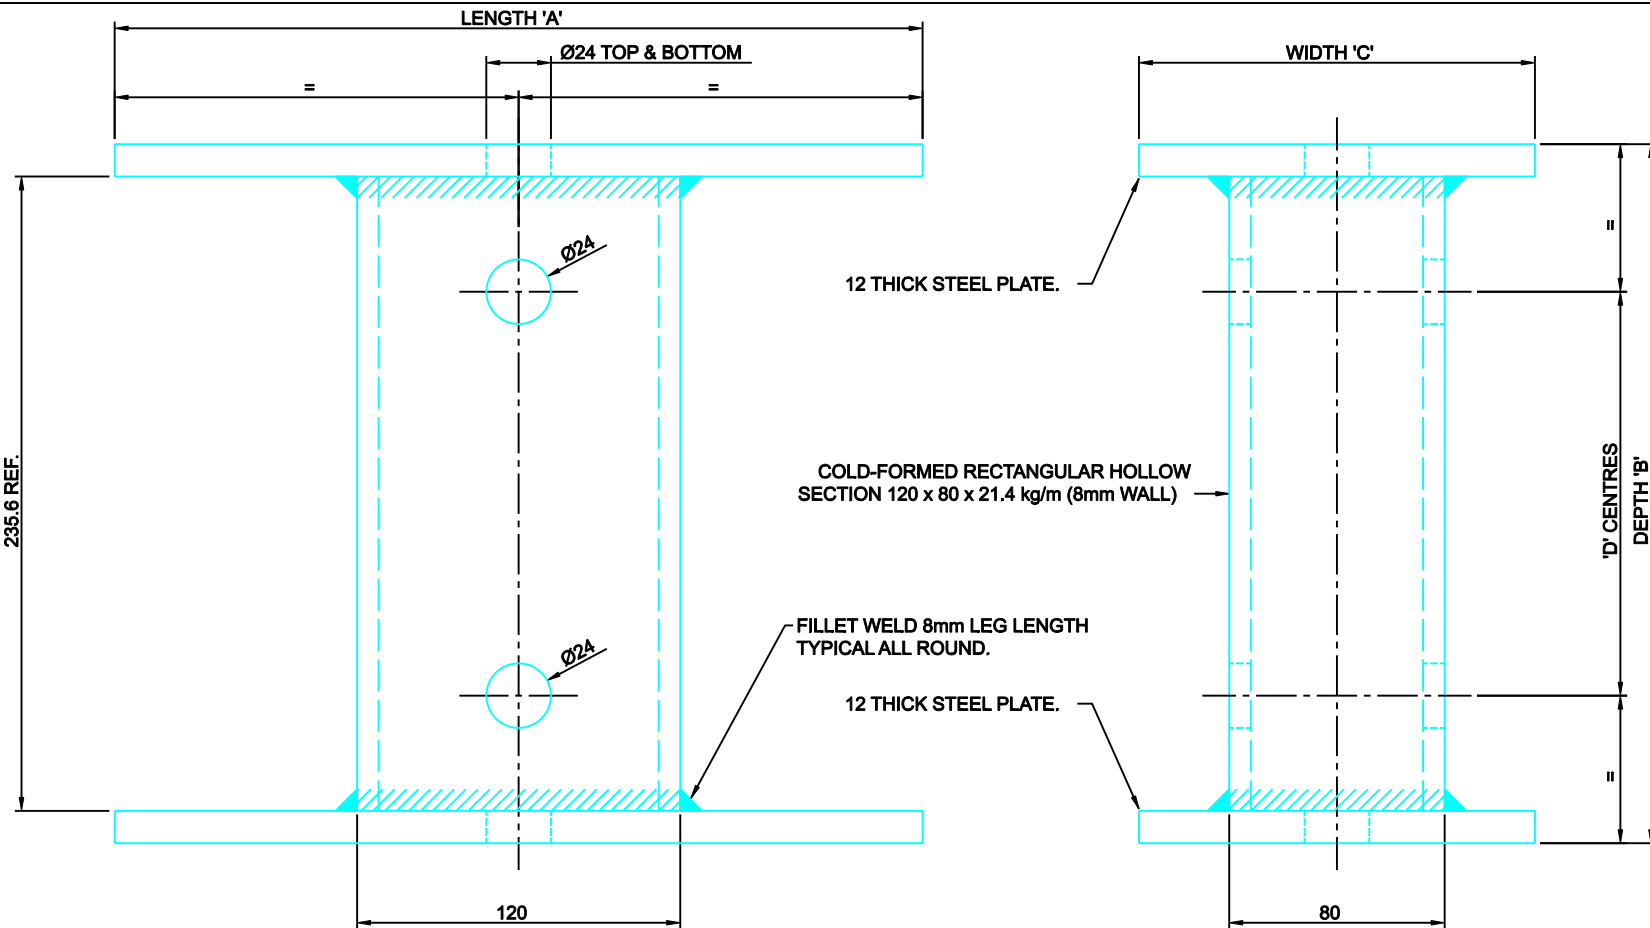

ITEM No.	LENGTH 'A'	DEPTH 'B'	WIDTH 'C'	'D' CENTRES	SHEAR BLOCK LOCATION
1	270	260	147	150	MEDIUM & STOUT POLE BASE (BURIED)
2	200	260	147	150	STOUT POLE APEX
3	170	260	147	150	MEDIUM POLE APEX
.	.	.	.	.	.
.	.	.	.	.	.
.	.	.	.	.	.

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. THE Ø24 HOLES AT THE TOP & BOTTOM ARE FOR RELIEF OF GALVANIZING PRESSURE.
3. WHOLE SHEAR BLOCK TO BE HOT DIP GALVANIZED AFTER COMPLETION OF ALL DRILLING & WELDING.



Manufacturer Details

Sheet No.
39

Scale
N.T.S.

Prepared By

Revised

Grid Reference

Date Issued
5/02/2007

Checked By
DAVE MARSHALL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

132kV OVERHEAD LINES
RUTTER TYPE POLE
HEAVY DUTY WELDED SHEAR BLOCK
SCHEDULE USING RECTANGULAR HOLLOW SECTION

Type
OVERHEAD

DOCUMENT_SUB_CLASS

Ref No. 62470B

Historic
Drg.No.

1 09 101 0675

Revision Notes