


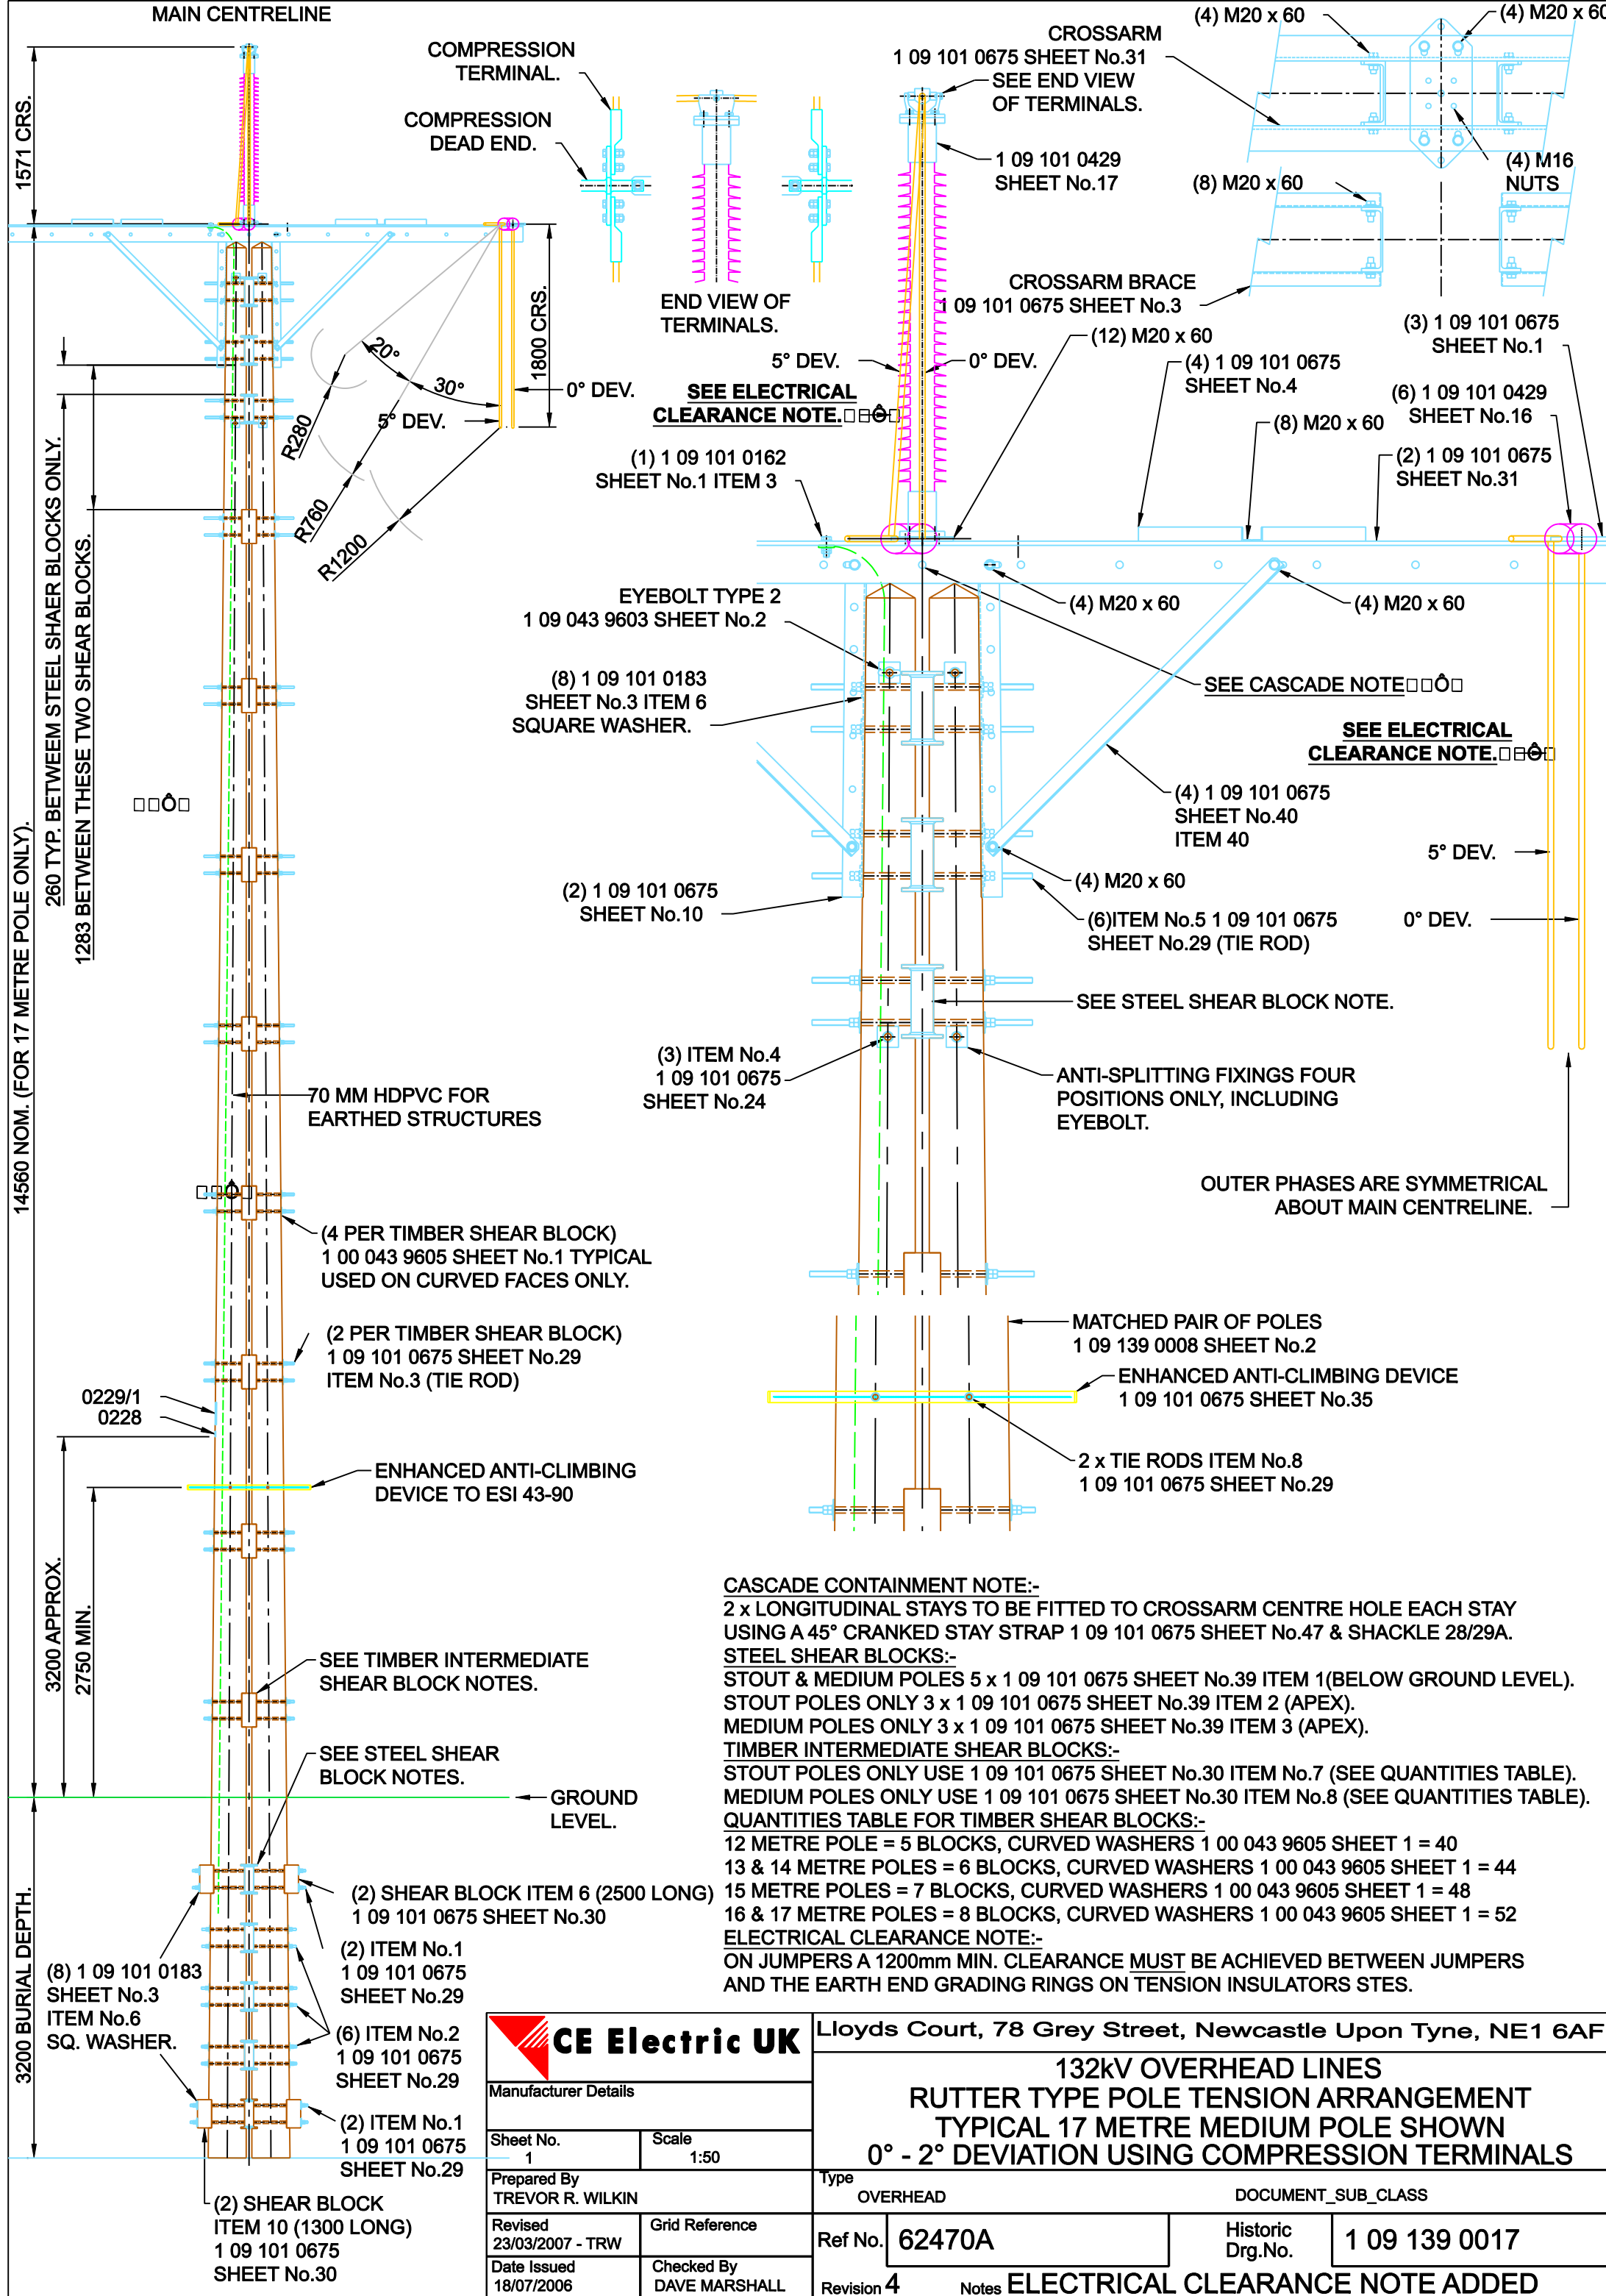

|                                                                                                           |  |                                                            |                                              |
|-----------------------------------------------------------------------------------------------------------|--|------------------------------------------------------------|----------------------------------------------|
|  <b>CE Electric UK</b> |  | Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF |                                              |
| Manufacturer Details                                                                                      |  | <b>132kV OVERHEAD LINES</b>                                |                                              |
| Sheet No. 1                                                                                               |  | <b>RUTTER TYPE POLE TENSION ARRANGEMENT</b>                |                                              |
| Scale 1:50                                                                                                |  | <b>TYPICAL 17 METRE MEDIUM POLE SHOWN</b>                  |                                              |
| Prepared By TREVOR R. WILKIN                                                                              |  | <b>0° - 2° DEVIATION USING COMPRESSION TERMINALS</b>       |                                              |
| Revised 23/03/2007 - TRW                                                                                  |  | Type OVERHEAD                                              | DOCUMENT_SUB_CLASS                           |
| Date Issued 18/07/2006                                                                                    |  | Ref No. 62470A                                             | Historic Drg.No. 1 09 139 0017               |
| Checked By DAVE MARSHALL                                                                                  |  | Revision 4                                                 | Notes <b>ELECTRICAL CLEARANCE NOTE ADDED</b> |