



LIMIT OF ARC TO ENSURE EARTH ELECTRODE 3.0m MINIMUM FROM EARTH MAT.



MINIMUM 3.0m BETWEEN EARTH ELECTRODE AND NEAREST POINT ON EARTH MAT.

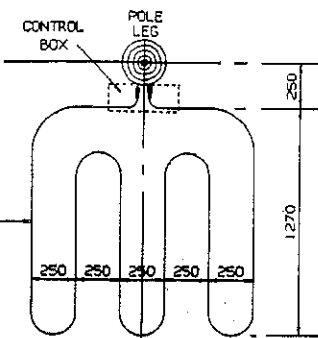

SECTION ON X - X

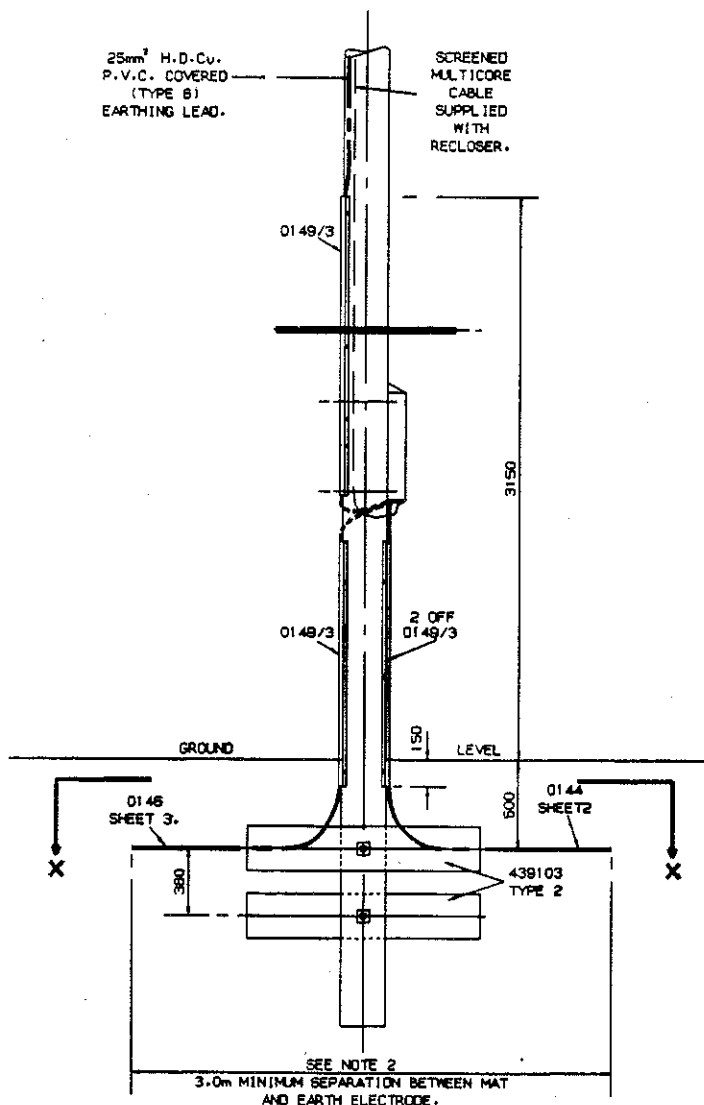

NOTES:

1. MAT AND LEADS TO BE 32mm BARE HARD DRAWN COPPER IN CONTINUOUS LENGTH.
2. MINIMUM DISTANCE BETWEEN EARTH ELECTRODE AND EARTH MAT TO BE 3.0m (P1 2500)

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

NORTHERN ELECTRIC 		Chief Engineer's Dept., Carroll House Newcastle-upon-Tyne NE1 6NE.	
		11kV & 20kV OVERHEAD LINES TYPICAL ARRANGEMENT OF EARTHING MAT FOR E.S.R. AUTO-RECLOSER/SECTIONALISER/AUXILIARY EQUIPMENT	
Drawn J.B.	Traced	Dwg. No.	Sheet No. 2
Checked S.H.C.K.	Date Issue SEP. 81	1 09 101 0144	Revised
		Scale 1 : 20	