


ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

H.V. STEELWORK
AS SPECIFIED

CONDUCTOR CONNECTION
WITH LUG 0237 AND
FASTENING 0162


25mm² ANNEALED COPPER
BLACK P.V.C. (TYPE 6)
COVERED CONDUCTOR
FIXED TO POLE WITH
CLEATS  400mm
APART.

CASING AND
FIXING 0149

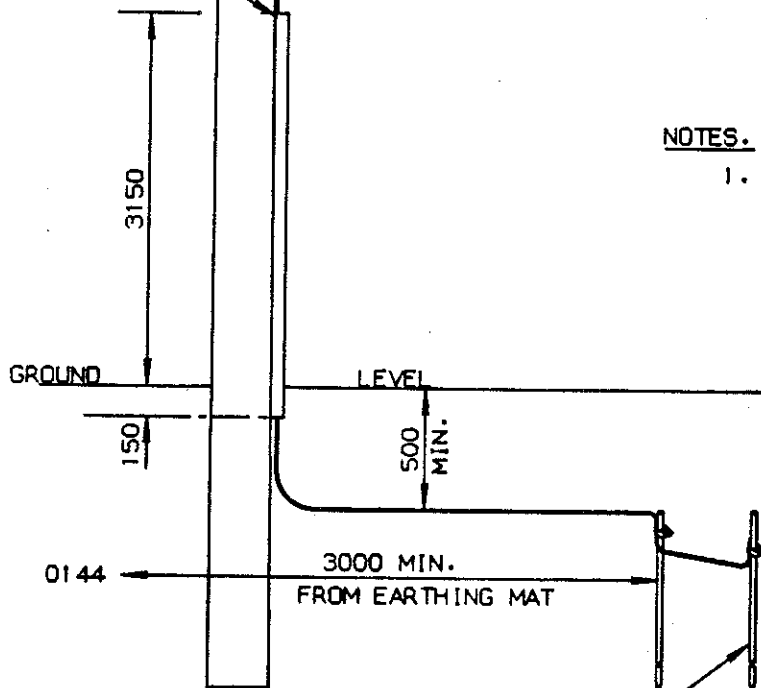


TO OBTAIN THE REQUIRED EARTH RESISTANCE IT MAY BE
NECESSARY TO CONNECT ADDITIONAL ELECTRODES IN PARALLEL.
(MINIMUM DISTANCE BETWEEN SUBSEQUENT ELECTRODES - 3.0M)
SEE SHEET 4 FOR DETAIL.

GROUND LEVEL

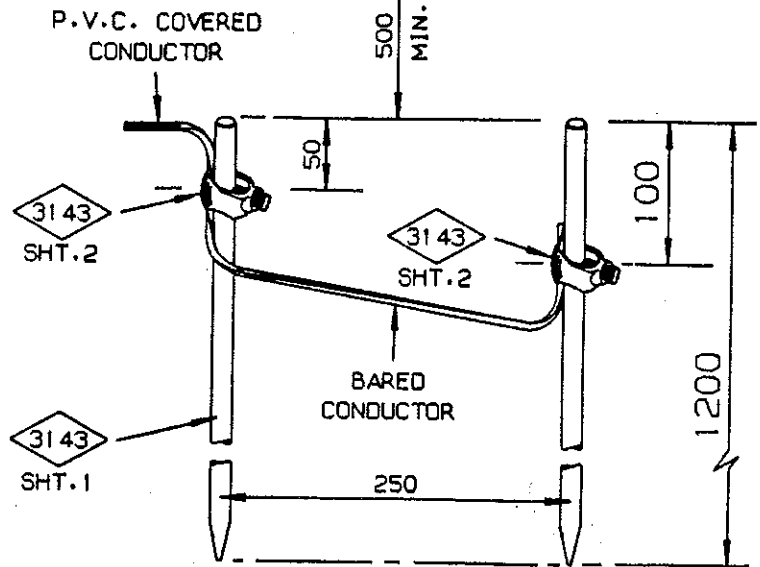


DETAIL OF
EARTHING ELECTRODES.
(N.T.S.)

NOTES.

1. DETAIL DRAWINGS SHOWN THUS  REFER TO L.V. DRAWINGS NOS. PREFIXED 1.09.119..... OTHER DRAWINGS REFER TO 1.09.101..... SERIES

THIS DRG. ALSO REFERRED TO IN WORK SPEC REF.NO 05/282

NORTHERN
ELECTRIC



Operations Director's Dept., Carlisle House Newcastle-upon-Tyne NE1 6NE.

INSTALLATION OF H.V. EARTHING ELECTRODES FOR AIR BREAK SWITCH DISCONNECTORS (11kV AND 20kV)

Drawn
J.B.

Traced

Checked
H.A.J.

Date Issued
FEB.80

Drg.No.

1 09 101 0146

Mod.

A B C


Sheet No. 3

No. of Sheets

Scale N.T.S.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

GROUND LEVEL

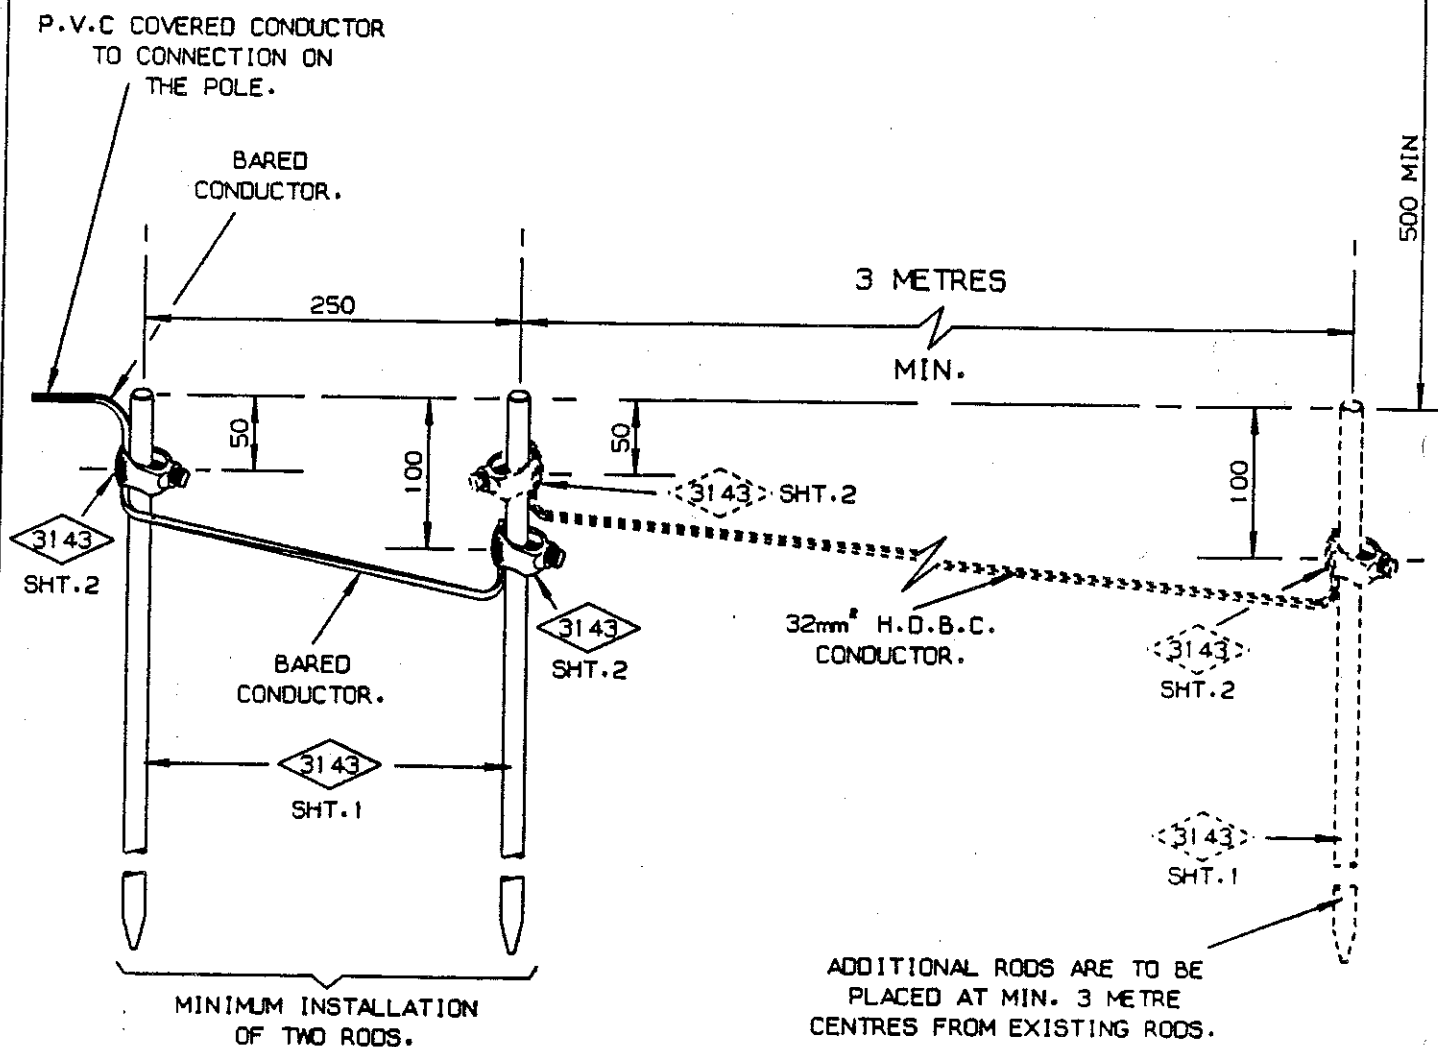


NOTES.

1. DETAIL DRAWINGS SHOWN THUS  REFER TO L.V. DRAWING NOS. PREFIXED 1.09.119..... OTHER DRAWINGS REFER TO 1.09.101..... SERIES.

THIS DRAWING ALSO REFERRED TO IN WORK SPEC. REF. NO. 04/403

NORTHERN
ELECTRIC



Operations Director's Dept., Carliol House Newcastle-upon-Tyne NE1 6NE.

INSTALLATION OF H.V. EARTHING ELECTRODES
(3 OR MORE RODS.)

Drawn
J.B.

Traced

Checked
H.A.J.

Date Issued
JULY 90

Drg. No.

1 09 101 0146

Mod.

Sheet No. 4

No. of Sheets

Scale 1 : 5