


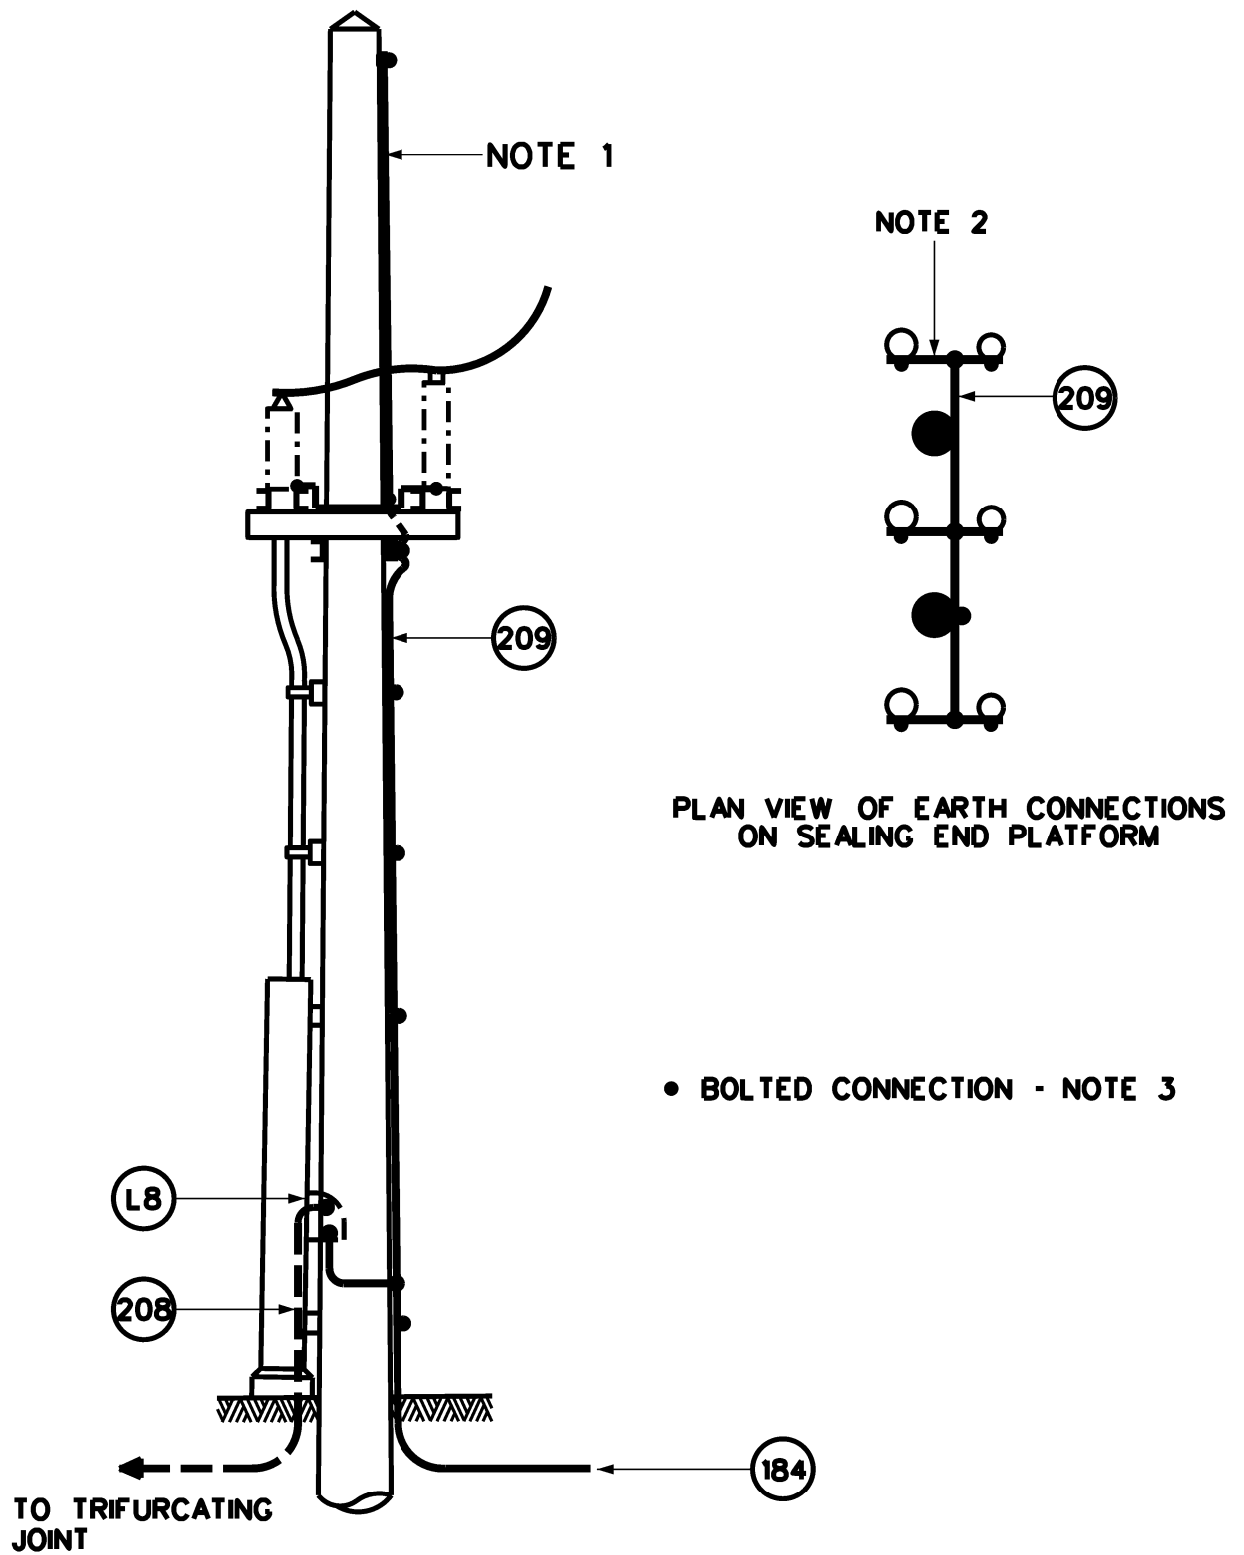

drawn	BT	EARTHING DIAGRAM			
traced	IPM	33kV CABLE TERMINATION WITH SURGE DIVERTERS CE/C/37(M)			
checked	JMG				
approved	BT				
revision	B	date 29-5-90	original scale	Y204L0403	