
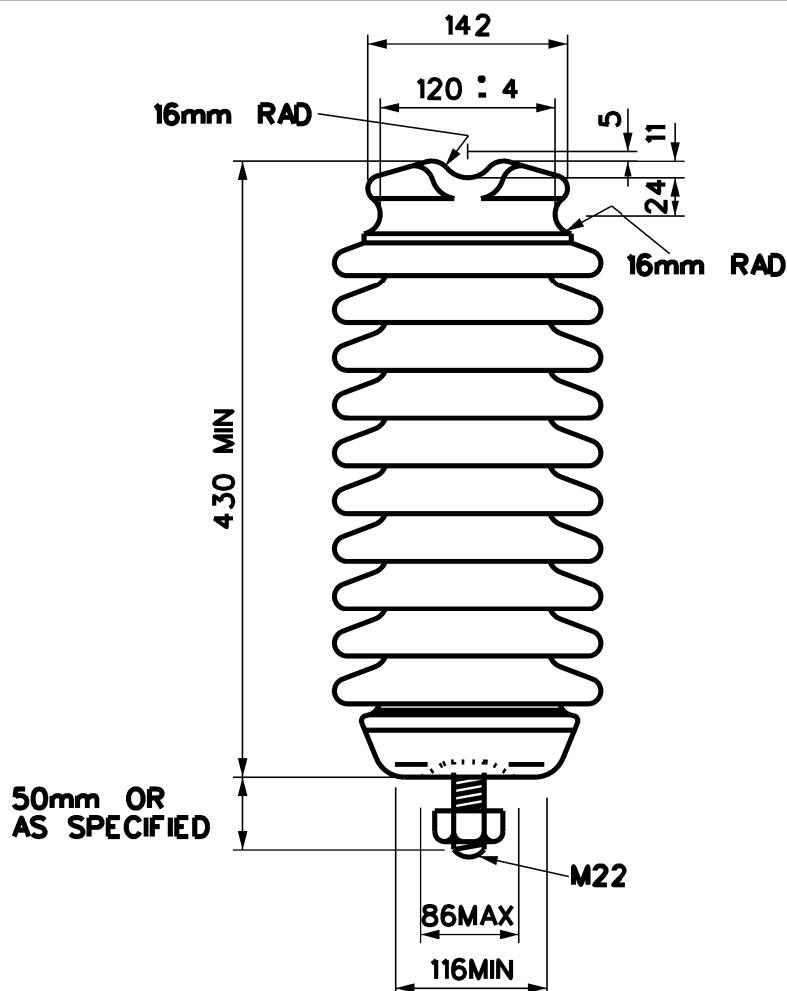




TOTAL CREEPAGE DISTANCE = 900 MIN

- 1 DIMENSIONS AND CHARACTERISTICS TO COMPLY WITH ESISTANDARD 43 - 93 AND BS 137 FOR A NOMINAL SYSTEM VOLTAGE (3 PHASE) OF 33kV MINIMUM TRANSVERSE FAILING LOAD TO BE 10kN
- 2 TOLERANCES EXCEPT WHERE SPECIFIED ON DRG ARE TO COMPLY WITH BS137
- 3 INSULATOR SUPPLIED COMPLETE WITH GALVD. MAL. C.I. BASE AND FITTED WITH GALVD. M22 STUD 50mm IN LENGTH BELOW BASE AND ONE NUT TO COMPLY WITH BS3288 PART2
- 4 INSULATOR TO BE INDELIBLY MARKED IN ACCORDANCE WITH BS 137
- 5 IN LOCALITIES NOT SUBJECT TO HEAVY SALT OR INDUSTRIAL DEPOSITS, THE PIN INSULATOR TO DRG Y003X2106 MAY BE USED
- 6 PORCELAIN TO BE GLAZED BROWN

ALL DIMENSIONS SHOWN IN MILLIMETRES

drawn	K.L.S. 26.1.66	33kV LINE POST INSULATOR					
traced	J.M.W. 26.1.66	FOR USE IN LOCALITIES SUBJECT TO HEAVY SALT OR INDUSTRIAL DEPOSITS					
checked	-						
approved	Y.E.						
revision	A	date	93	original scale	1:5		Y204L0701