




FOR POLE FABRICATION SEE Y208L0601
 FOR EARTHING ARRANGEMENT SEE Y208L0102
 FOR CROSS ARM STEEL WORK SEE Y208L0901
 FOR CABLE SUPPORT STEEL WORK SEE Y208L0902

drawn	P.M.P.	33kV XLPE CABLE TERMINATION CE/C/36 SURGE OR NON SURGE DIVETER		
	09.08.05			
traced	-			
checked	-			
approved	-	date	original scale	1:50
		Y208L0101		CAD

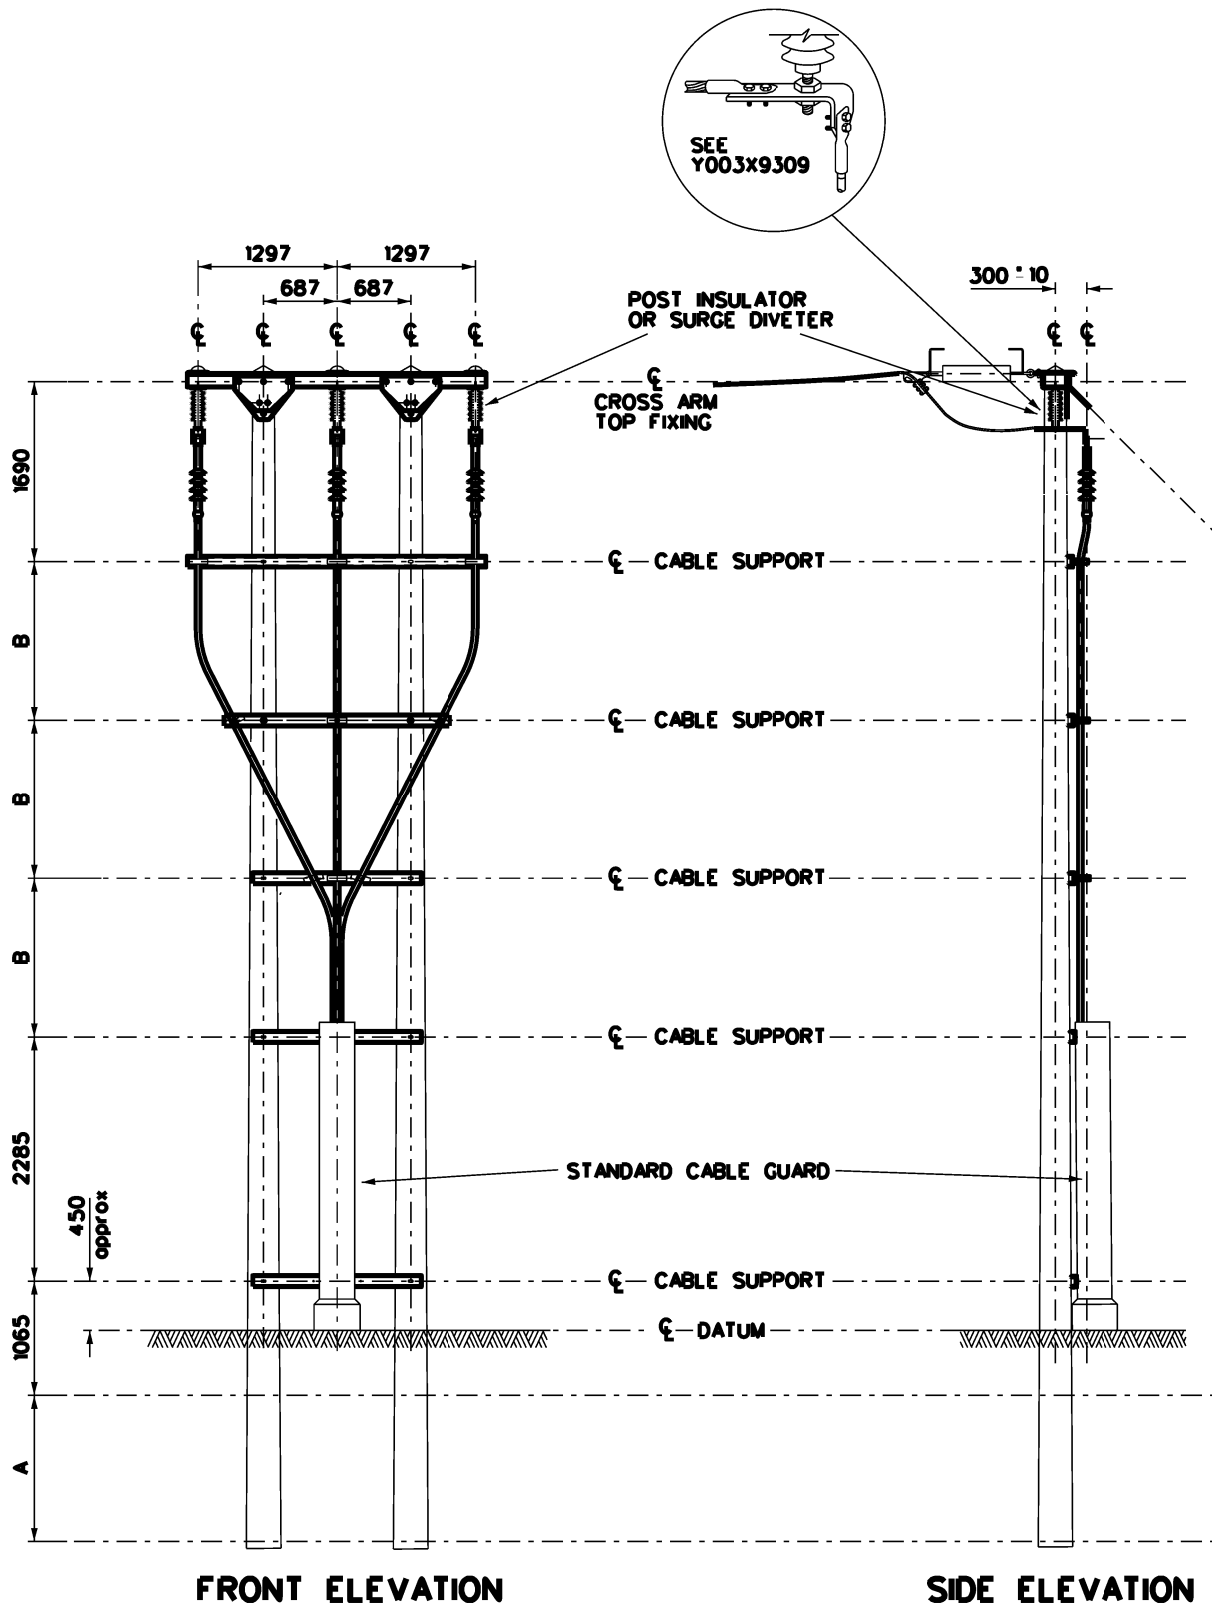