

SEE DETAIL A


PS 1461 DON + ADD OF:



SIDE ELEVATION


on 1.09.123.1187 5#1 N.

SHOULD HAVE 4 FLAT SURFACES

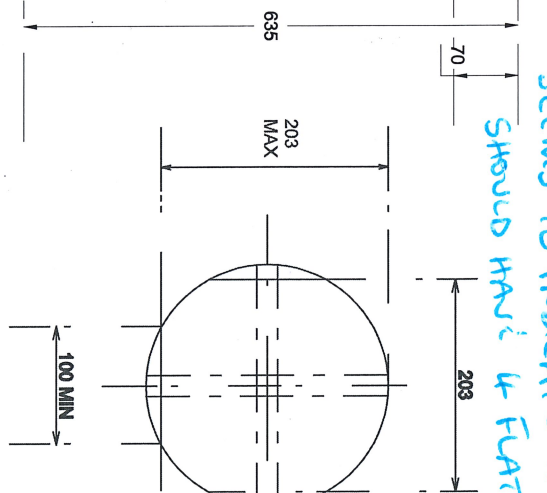

MISSING MEASUREMENT

THIS IN TURN THEN MOVES THE POSITION OF THE HOLE AT THE TOP OF DIMENSION X INDICATED BY 200MM THEREFORE REDUCING 0239

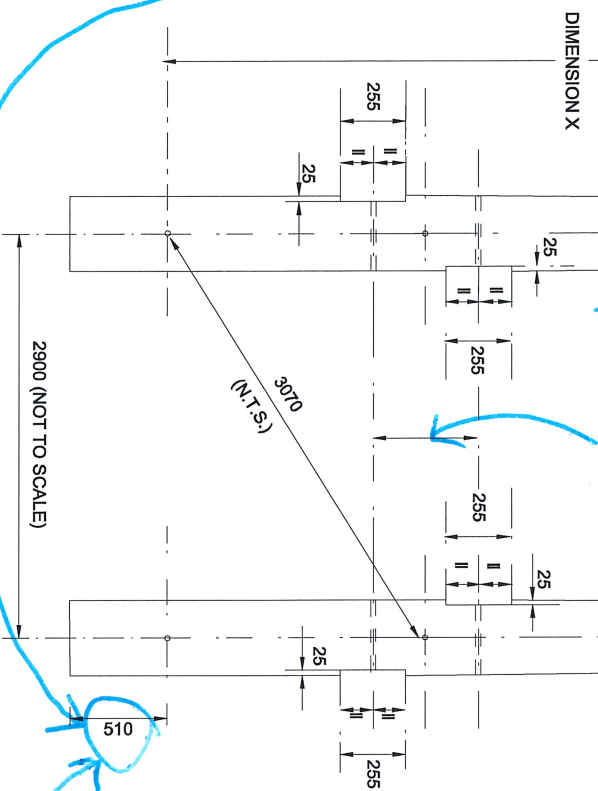

DETAIL B
PLAN

105

DIMENSION Y
CANNOT BE VARIABLE
IF USING THE 3 FIXED
MEASUREMENTS SHOWN
(WORKS FOR FOR LENGTHS
12-15 BUT NOT FOR
16.0M)

POLE LENGTH	DM X	DM Y
12.0m	5040	1700
13.0m	6040	1700
14.0m	7040	1700
15.0m	8040	1700
16.0m	9040	1800

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 230mm
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
3. POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BALKS AS SHOWN
5. POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BALKS
TO
DRG NO. 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS
EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS
1 00 043 9804 AND 9805 RESPECTIVELY.
6. HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL
BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

 NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		66KV SINGLE CIRCUIT LINES DRILLING AND SCARFING FOR TERMINAL SUPPORT WITH SURGE ARRESTERS - 1173 SHEET 4			
Sheet No.	Scale				
5	1:20				
Prepared By Barbara Gordon					
Revised 18/08/15	Grid Reference	Ref No.	C995434	Historic Dwg No.	1091231173
Date Issued 16/02/11	Checked By S SALKELD	Revision	G	Notes	