




NOTES

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION E/STOUT - 226mm.
2. HOLES TO BE 22mm DIA.
3. POLE BUTTS CUT AT RIGHT ANGLES TO TEMPLATE PRIOR TO CREOSOTING.
4. 50x66 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.

POLE LENGTH	DIM Y
UP TO AND INCLUDING 12.0m	1500
13.0m TO 15.0m INCLUSIVE	1700
16.0m AND 17.0m	1900
18.0m	1900
20.0m	2500
22.0m	2500
24.0m	2500

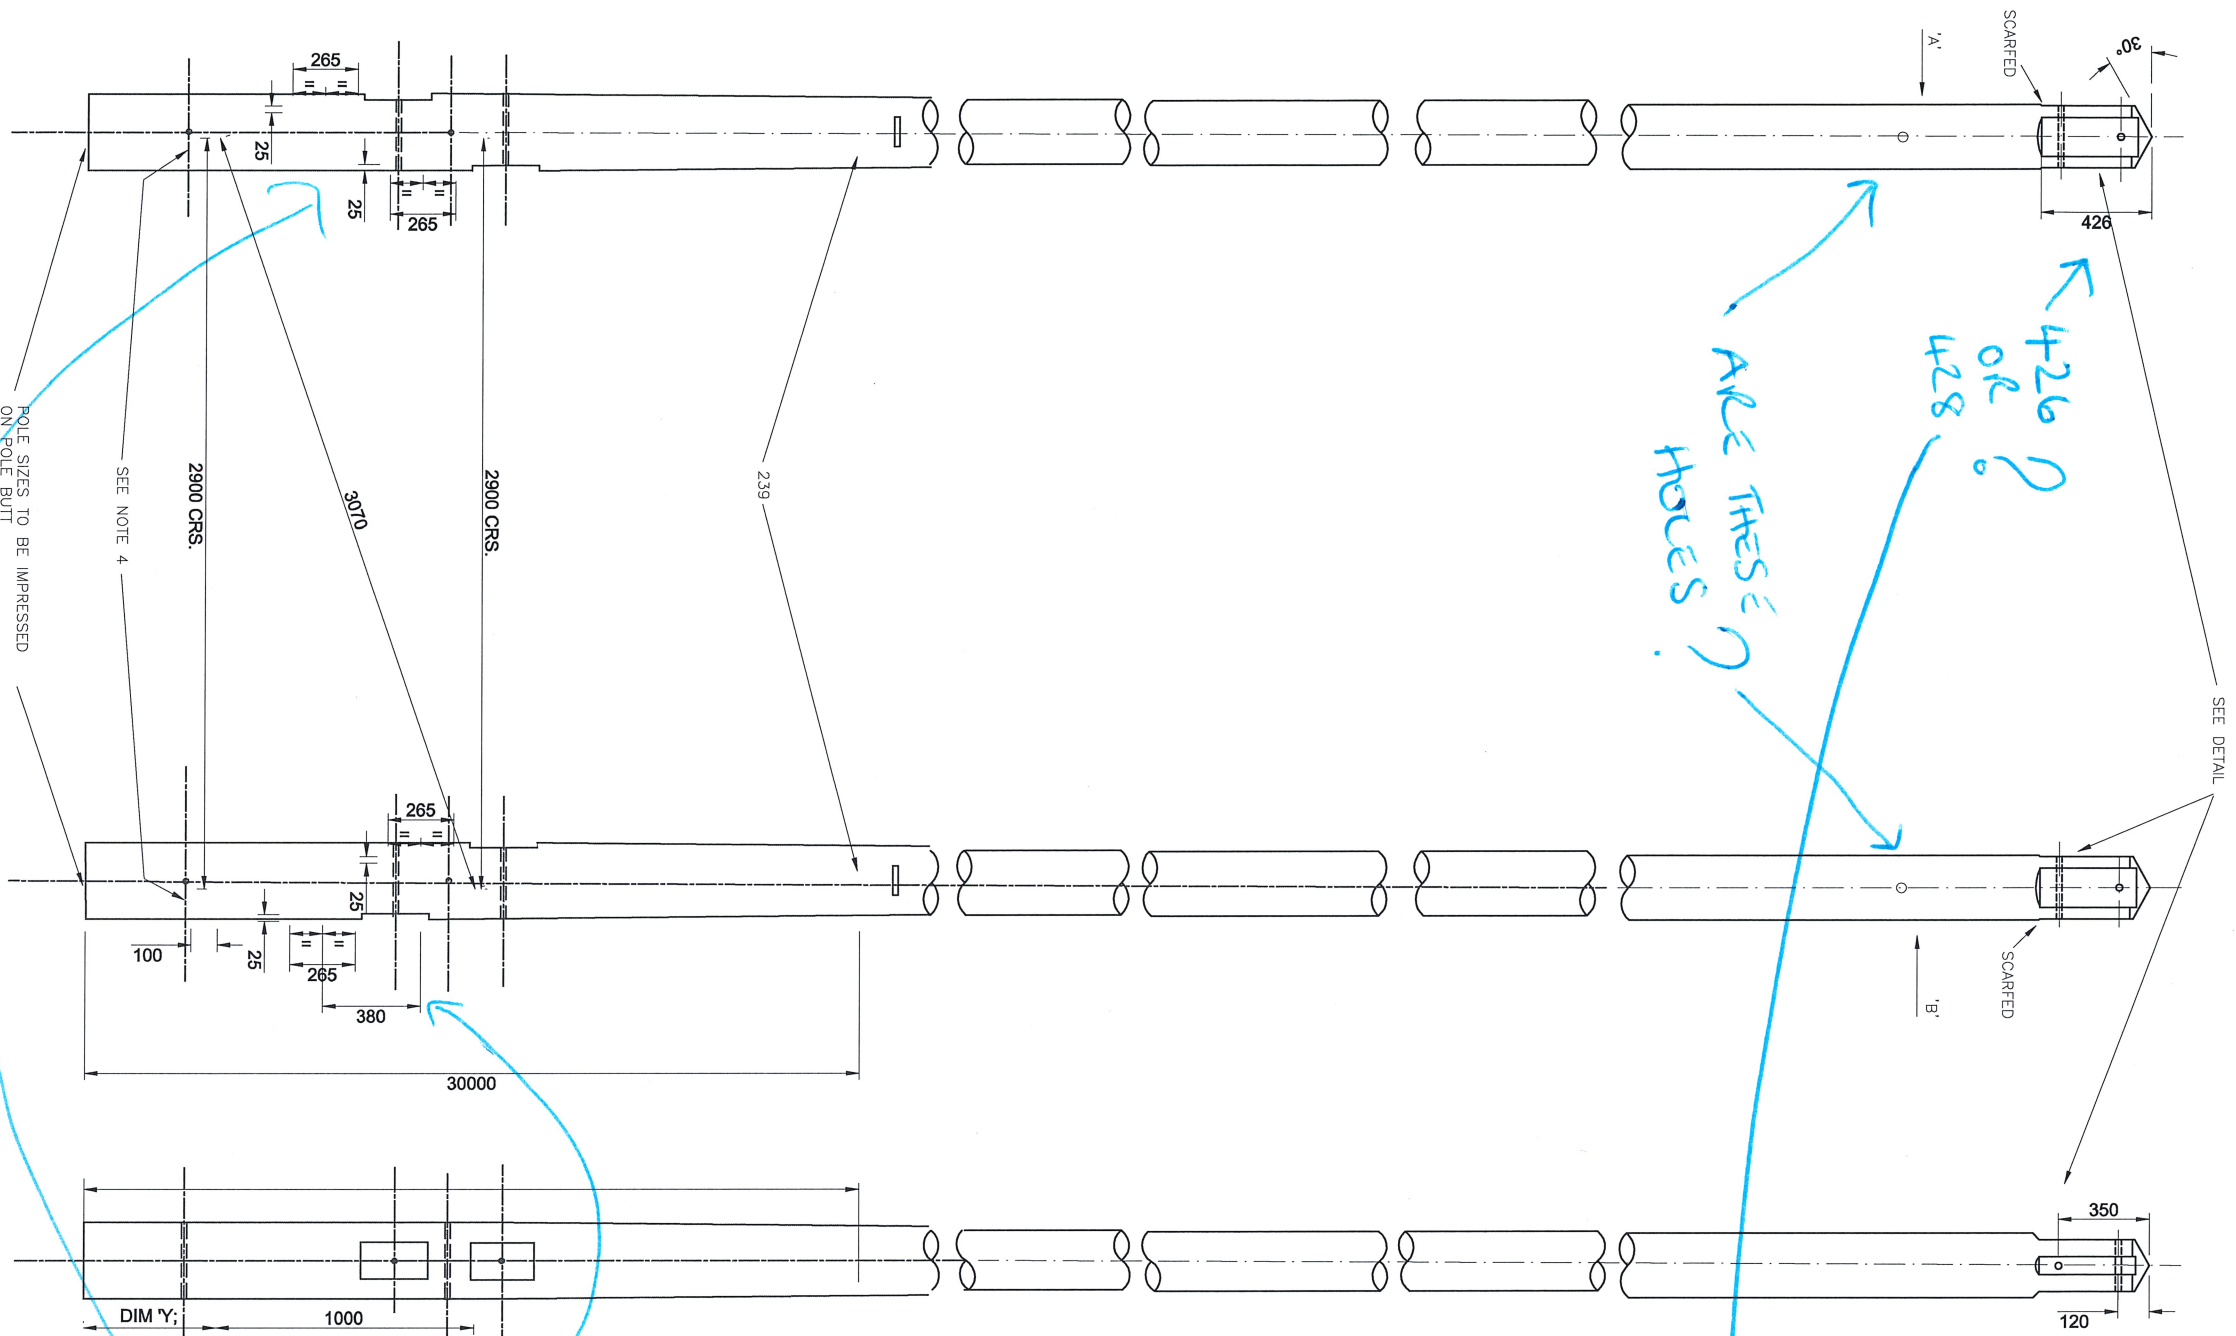

NORTHERN POWERGRID

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

Sheet No. 2

Scale 1:20

Prepared By Joorn, Dorkley

Revised 13/12/13

Date Issued 03/07/07

Grid Reference

Checked By G. HAMMILL

Revision G

Type OVERHEAD

Ref No. C949776

Historic Drg. No. 1091390019

132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR TERMINAL 'H' POLE STRUCTURE

All dimensions shown are in millimetres unless stated otherwise

