




ITEM 1. 530 LONG x 220 WIDE x 15 THICK FLAT BAR.

NOTES:-

1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
3. ALL BURRS TO BE REMOVED.
4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

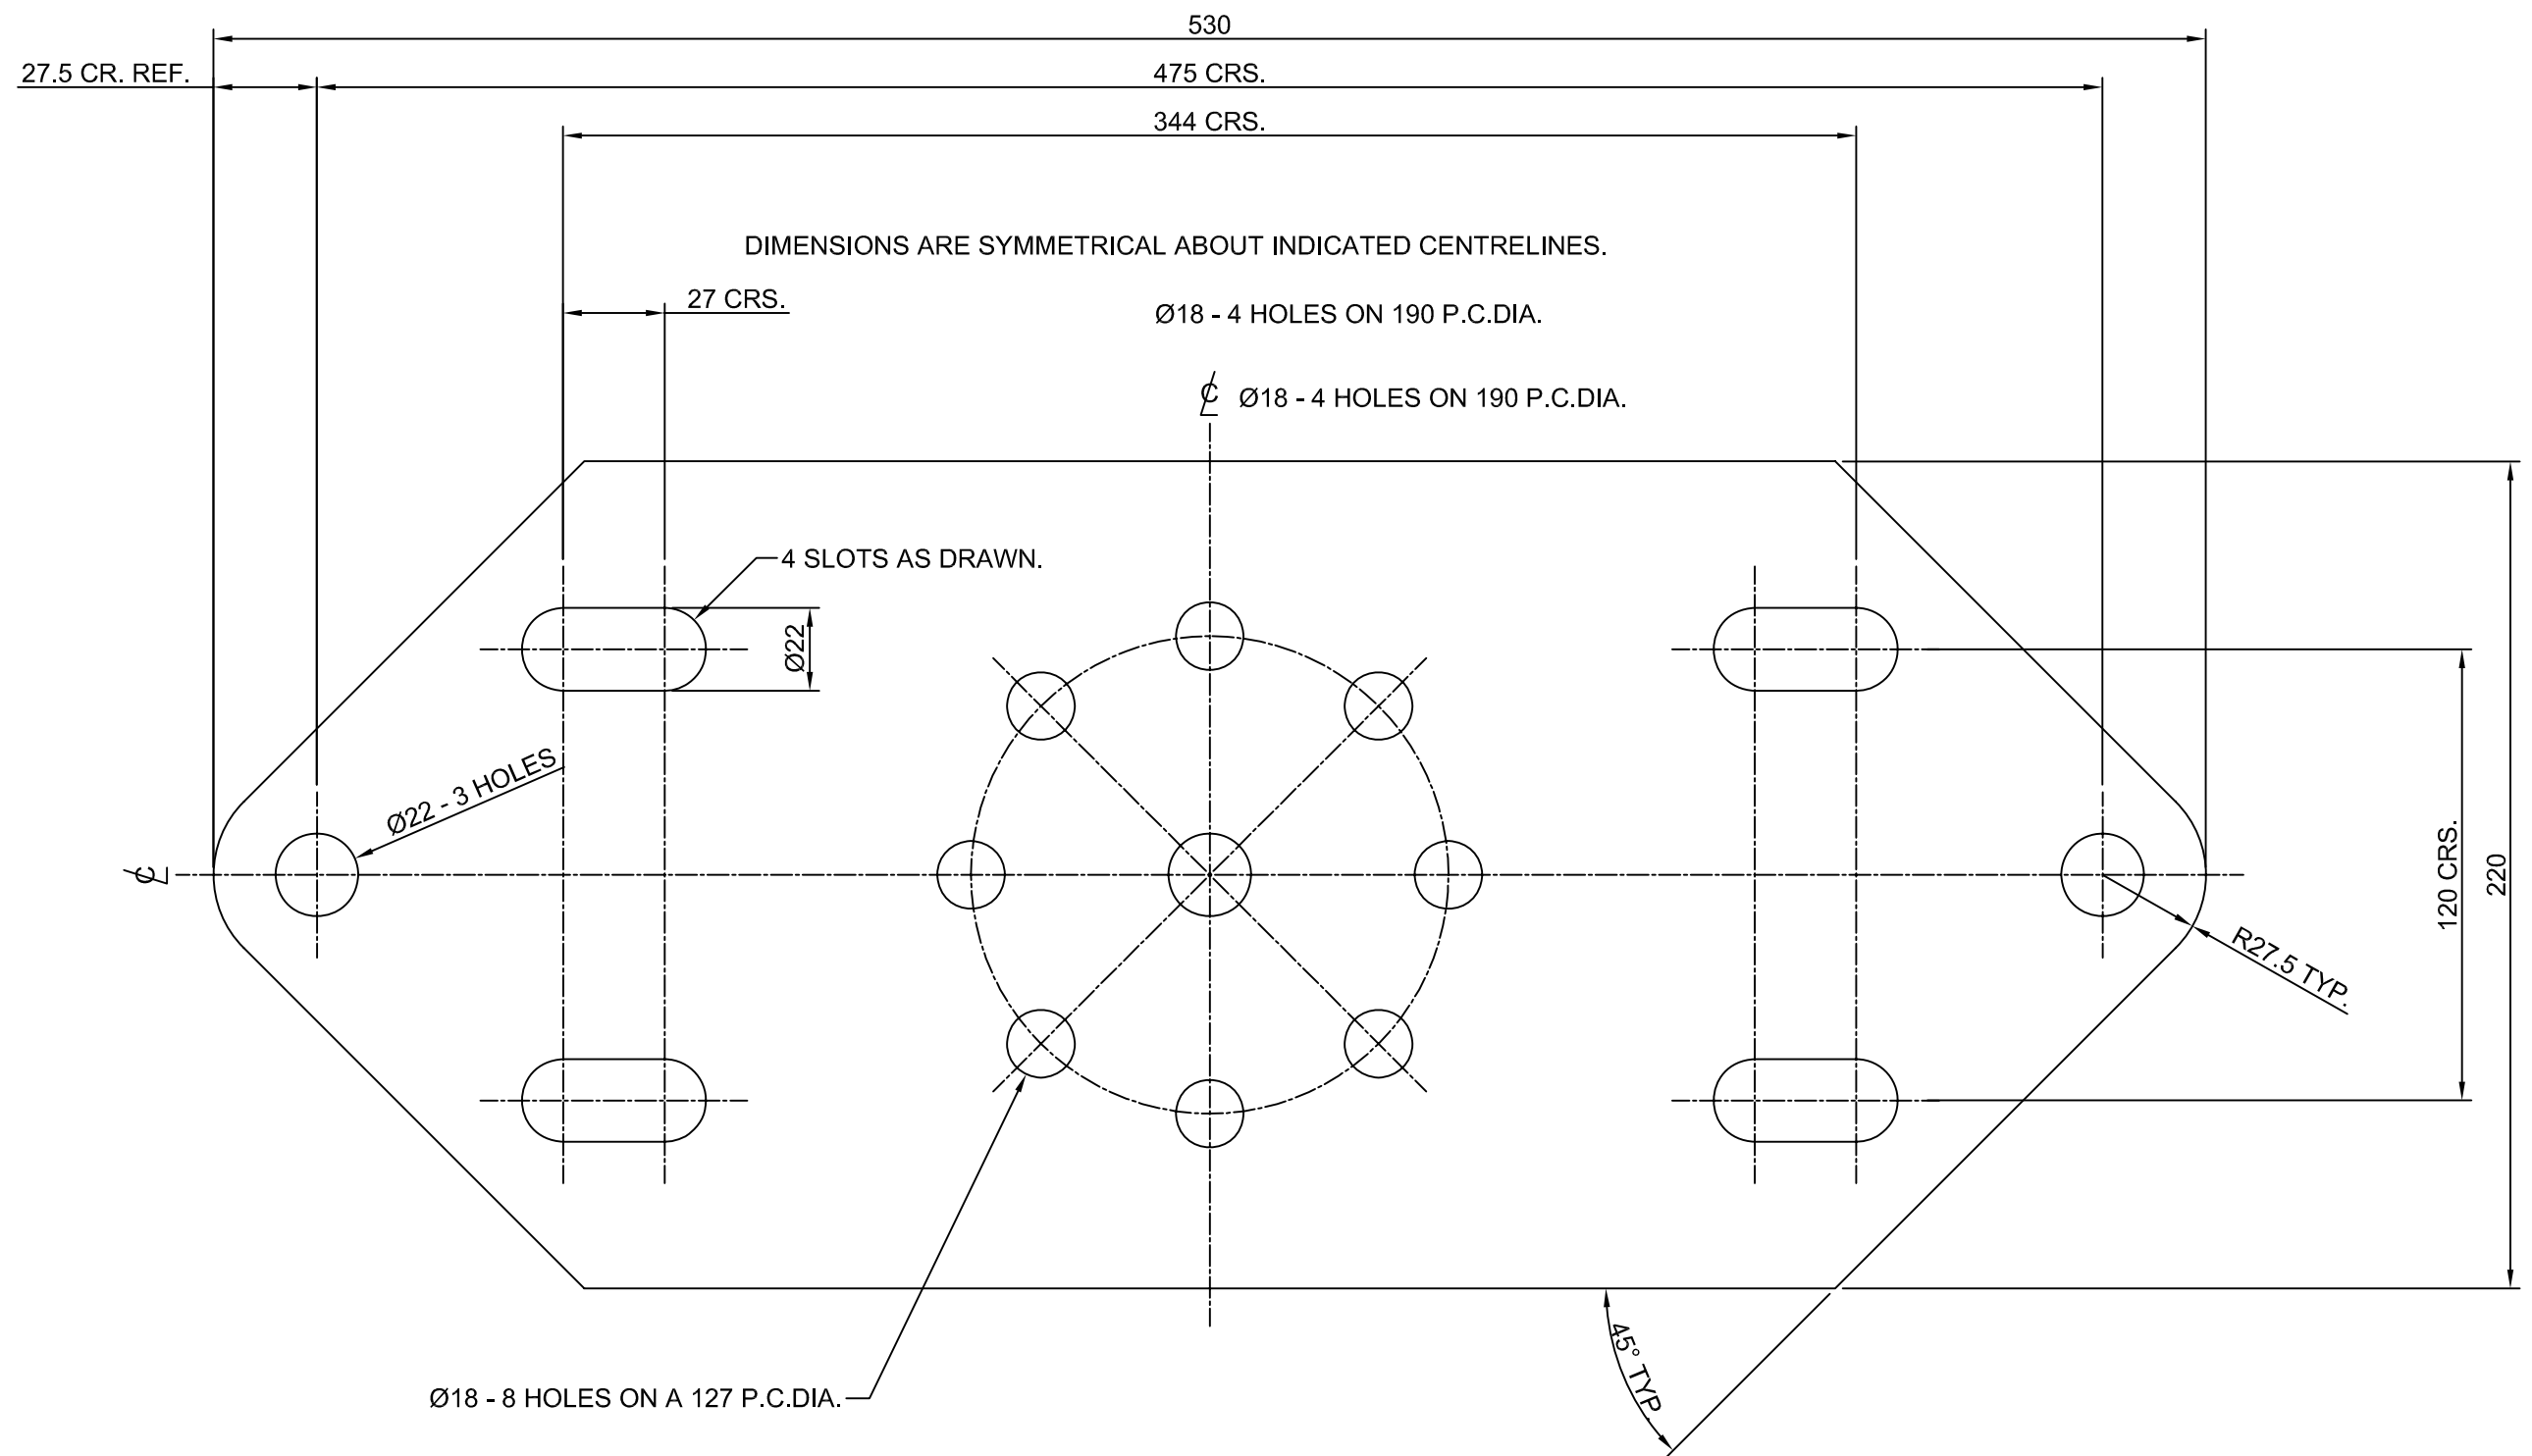

CE Electric UK

Manufacturer Details

Sheet No.
1

Scale
1:2

Prepared By
TREVOR R. WILKIN

Revised

Grid Reference

Date Issued
1/02/2006

Checked By

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

**132kV OVERHEAD LINES
POST INSULATOR & TENSION PLATE DETAIL
ITEM No.1**

Type
OVERHEAD

DOCUMENT_SUB_CLASS

Ref No. **62470B**

Historic
Drg.No.

1 09 101 0675

Revision Notes